

6/3/97cpd
PERMIT IS SUBJECT TO REVOCATION IF SITE PLANS OR INTENDED USE CHANGE

WARREN COUNTY HEALTH DEPARTMENT

- () Suitable
(L) Provisionally suitable
() Upgrading of existing system
() Repair of existing system
() Pump system

ENVIRONMENTAL HEALTH DIVISION

201 EAST MACON STREET
WARRENTON, N. C. 27589
PHONE: (919) 257-1538
FAX: (919) 257-4460

Permit No. **Nº 1652**

Fee **\$100.00**

Paid **5/13/97cpd**

IMPROVEMENT PERMIT

Owner William H. Hayes 257-4901
Address Rt #2 Box 10-G, Warrenton, NC 27589
Subdivision Name _____ Lot# _____ Block# _____ Section# _____
Directions to lot (RPR#) Hwy 401 (S) Turn on SR 1603 Approx 1 1/2 mi
(R) Blue pick up body in front. N 2 mi. on RT.

Application Date 3-10-97

IMPROVEMENT PERMIT APPROVAL

Date 5-8-97 Paul Brown, R
Environmental Health Specialist

* IMPROVEMENT PERMIT IS GOOD FOREVER
UNLESS SITE PLANS OR INTENDED
USE CHANGE

CONSTRUCTION AUTHORIZATION

Original Deed Date 3-10-97 Land Use House # of bedrooms 3 # of people 3
Water Supply Well Distance from well and/or water lines _____
Well installed at time of inspection () Yes (X) No Dist. from septic system _____
Design daily flow of sewage 360 gals. Kitchen garbage grinder NO Other _____
Septic tank capacity 1000 gals. Nitrification field 1200 Sq. Ft. (4-100ft. leech)
Maximum trench depth 36 inches Artificial drainage required NO
(if yes, see attached plan)

CONSTRUCTION AUTHORIZATION APPROVAL

Date 4-8-97 Paul Brown, R
Environmental Health Specialist

* CONSTRUCTION AUTHORIZATION IS VALID FOR 5
YEARS FROM DATE OF ISSUE

Scrap sidewalks and drest
with lime.
Repair area road at .25' and
install 36 in. dia.

COMMENTS: (1) RUN TRENCHES 3' WIDE AND AT LEAST
9' ON CENTERS (2) RUN LINES CONTOUR TO SLOPE
(3) RUN LINES OF EQUAL LENGTH

THE SEPTIC TANK SYSTEM AND OTHER IMPROVEMENTS THAT ARE
MADE SHALL BE INSTALLED AS SHOWN IN THE SITE SKETCH PLAN. NO
CHANGES SHALL BE MADE WITHOUT APPROVAL FROM THE HEALTH
DEPARTMENT.

ANY VARIATIONS FROM THE CONDITIONS AND REQUIREMENTS
PREVIOUSLY DESCRIBED WILL VOID THE PERMIT. THIS IS AN OFFICIAL
DOCUMENT. PLEASE RETAIN WITH OTHER VALUABLE PAPERS.

*DO NOT LANDSCAPE LOT BEFORE HEALTH DEPARTMENT APPROVAL.
DO NOT LOCATE DRIVEWAYS, PARKING AREAS, OR OTHER BUILDINGS
OVER SEPTIC TANK SYSTEM. LANDSCAPE AREA OVER SEPTIC TANK
SYSTEM TO PREVENT PONDING OF WATER. SEED WITH GRASS TO HELP
PREVENT SOIL EROSION AND TO IMPROVE EVAPOTRANSPIRATION.

OPERATION PERMIT


OPERATION PERMIT APPROVAL

DATE 5-30-97 Mary Whaley
ENVIRONMENTAL HEALTH
SPECIALIST

CONTRACTOR: Jerry Bolton

NOTE: THE SEPTIC TANK, AND NITRIFICATION FIELD MUST BE INSPECTED BY
A REPRESENTATIVE OF THE HEALTH DEPARTMENT BEFORE THEY ARE COVERED.
THE SIGNING OF THIS CERTIFICATE SHALL INDICATE THAT THIS SYSTEM
HAS BEEN INSTALLED IN COMPLIANCE WITH THE CURRENT LAW & RULES FOR
SANITARY SEWAGE COLLECTION, TREATMENT AND DISPOSAL SET FORTH IN
ARTICLE 11 OF GENERAL STATUTE 130A. SECTION .1900 OF THE NORTH CARO-
LINA ADMINISTRATIVE CODE TITLE 10, HEALTH SERVICES. ENVIRONMENTAL
HEALTH SUBCHAPTER 10A SANITATION AND SHALL IN NO WAY BE A GUAR-
ANTEE THAT THE SEPTIC TANK SYSTEM WILL FUNCTION SATISFACTORILY FOR
ANY GIVEN PERIOD OF TIME.

S.R. 1603 - Rifle Range Road

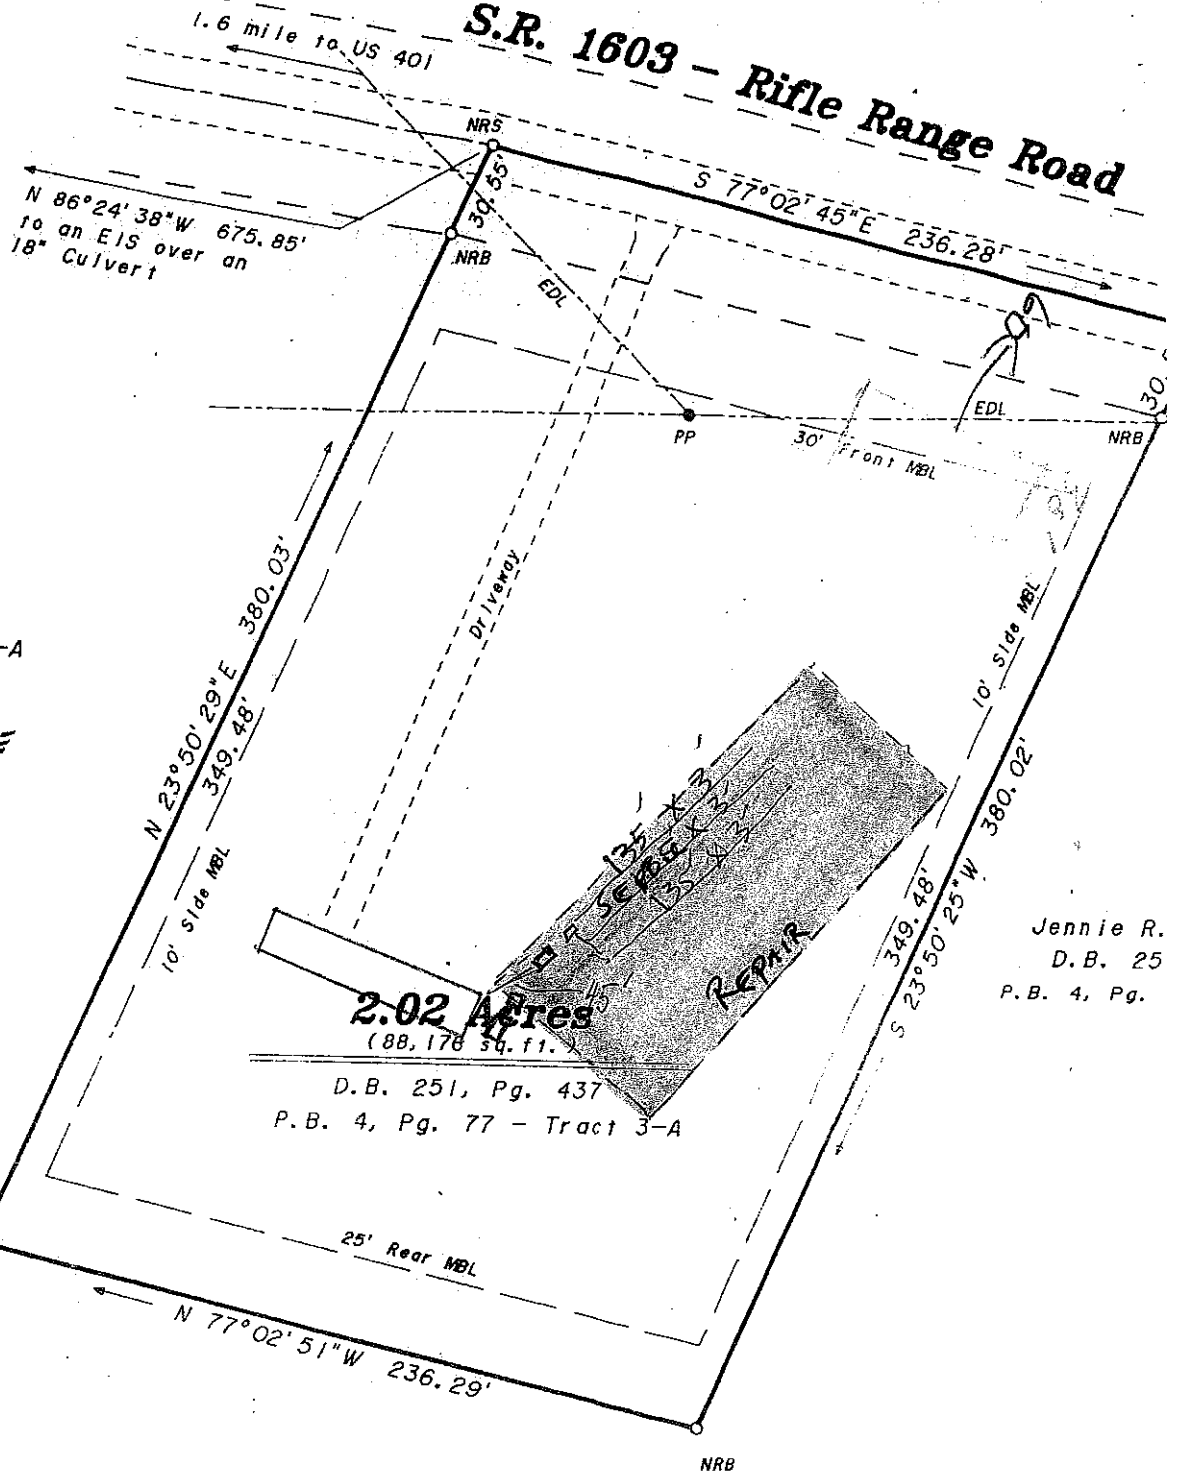

Jennie R. Hayes Heirs
D.B. 251, Pg. 437
P.B. 4, Pg. 77 - Tract 3-A

NOT TO SCALE

1" = 60'

Jennie R.
D.B. 25
P.B. 4, Pg.

D.B. 251, Pg. 437
P.B. 4, Pg. 77 - Tract 3-A

Jennie R. Hayes Heirs
D.B. 251, Pg. 437
P.B. 4, Pg. 77 - Tract 3-A