


PERMIT NUMBER 2416

GRANVILLE - VANCE DISTRICT HEALTH DEPARTMENT
IMPROVEMENT AND OPERATION PERMITS

COUNTY: VANCE	TAX NO.	TYPE OF ESTABLISHMENT			*THIS PERMIT SHALL BE ACCOMPANIED BY A LAYOUT SHOWN ON A PLAT, INCLUDING SYSTEM REQUIREMENTS. *THE IMPROVEMENTS PERMIT MUST BE ATTACHED TO A CONSTRUCTION AUTHORIZATION BEFORE OBTAINING BUILDING PERMIT OR OTHER CONSTRUCTION PERMITS AND BEFORE A WASTEWATER SYSTEM IS INSTALLED. *THIS IMPROVEMENT PERMIT IS SUBJECT TO REVOCATION IF THE INTENDED USE CHANGE FROM THOSE SHOWN ON THE IMPROVEMENT PERMIT. CHANGES SHALL REQUIRE HEALTH DEPARTMENT APPROVAL.
	SER NO.	RESIDENCE ☒ BUSINESS ☐ OTHER ☐	NUMBER OF BEDROOMS: 4	NUMBER OF OCCUPANTS: ≤ 8	
OWNER: CREATIVE					
APPLICANT: 0369A01007 DONALD GUDTON		WATER SUPPLY			
APPLICANT'S ADDRESS: P.O. Box 1958		PUBLIC ☐	WELL ☒	OTHER ☐	
PROPERTY ADDRESS/LOCATION: STAKE COACH RD. 77 Baytree Lane		TYPE OF WASTEWATER SYSTEM			
SUBDIVISION: CROWDER FARM		DESCRIPTION	INITIAL INSTALLATION	REPAIR	
LOT NUMBER: 7		DESIGN FLOW:	480 gal/day		
		LTAR:	0.3		
REFERENCE SKETCH (SEE PLAT FOR DETAILS)		ABSORPTION AREA:	1600 FT²		
		TRENCH WIDTH:	3'		
		TRENCH SPACING:	9' ON CENTERS		
		TOTAL TRENCH LENGTH:	400'		
		NUMBER OF TRENCHES:	(3)-5		
		GRAVEL DEPTH:	12"		
		TANK SIZE:	1000 GAL		
		CONDITIONS:	24" TRENCH DEPTH		
FOR: DONALD GUDTON		IMPROVEMENT PERMIT			DATE: 3-30-2008
ISSUED BY: Paul C. Lane					
SYSTEM INSTALLED BY: Wayne Arscue		OPERATION PERMIT			DATE: 10-23-2000
ISSUED BY: W. Vaughn					

Robert Lee Coyer Jr.

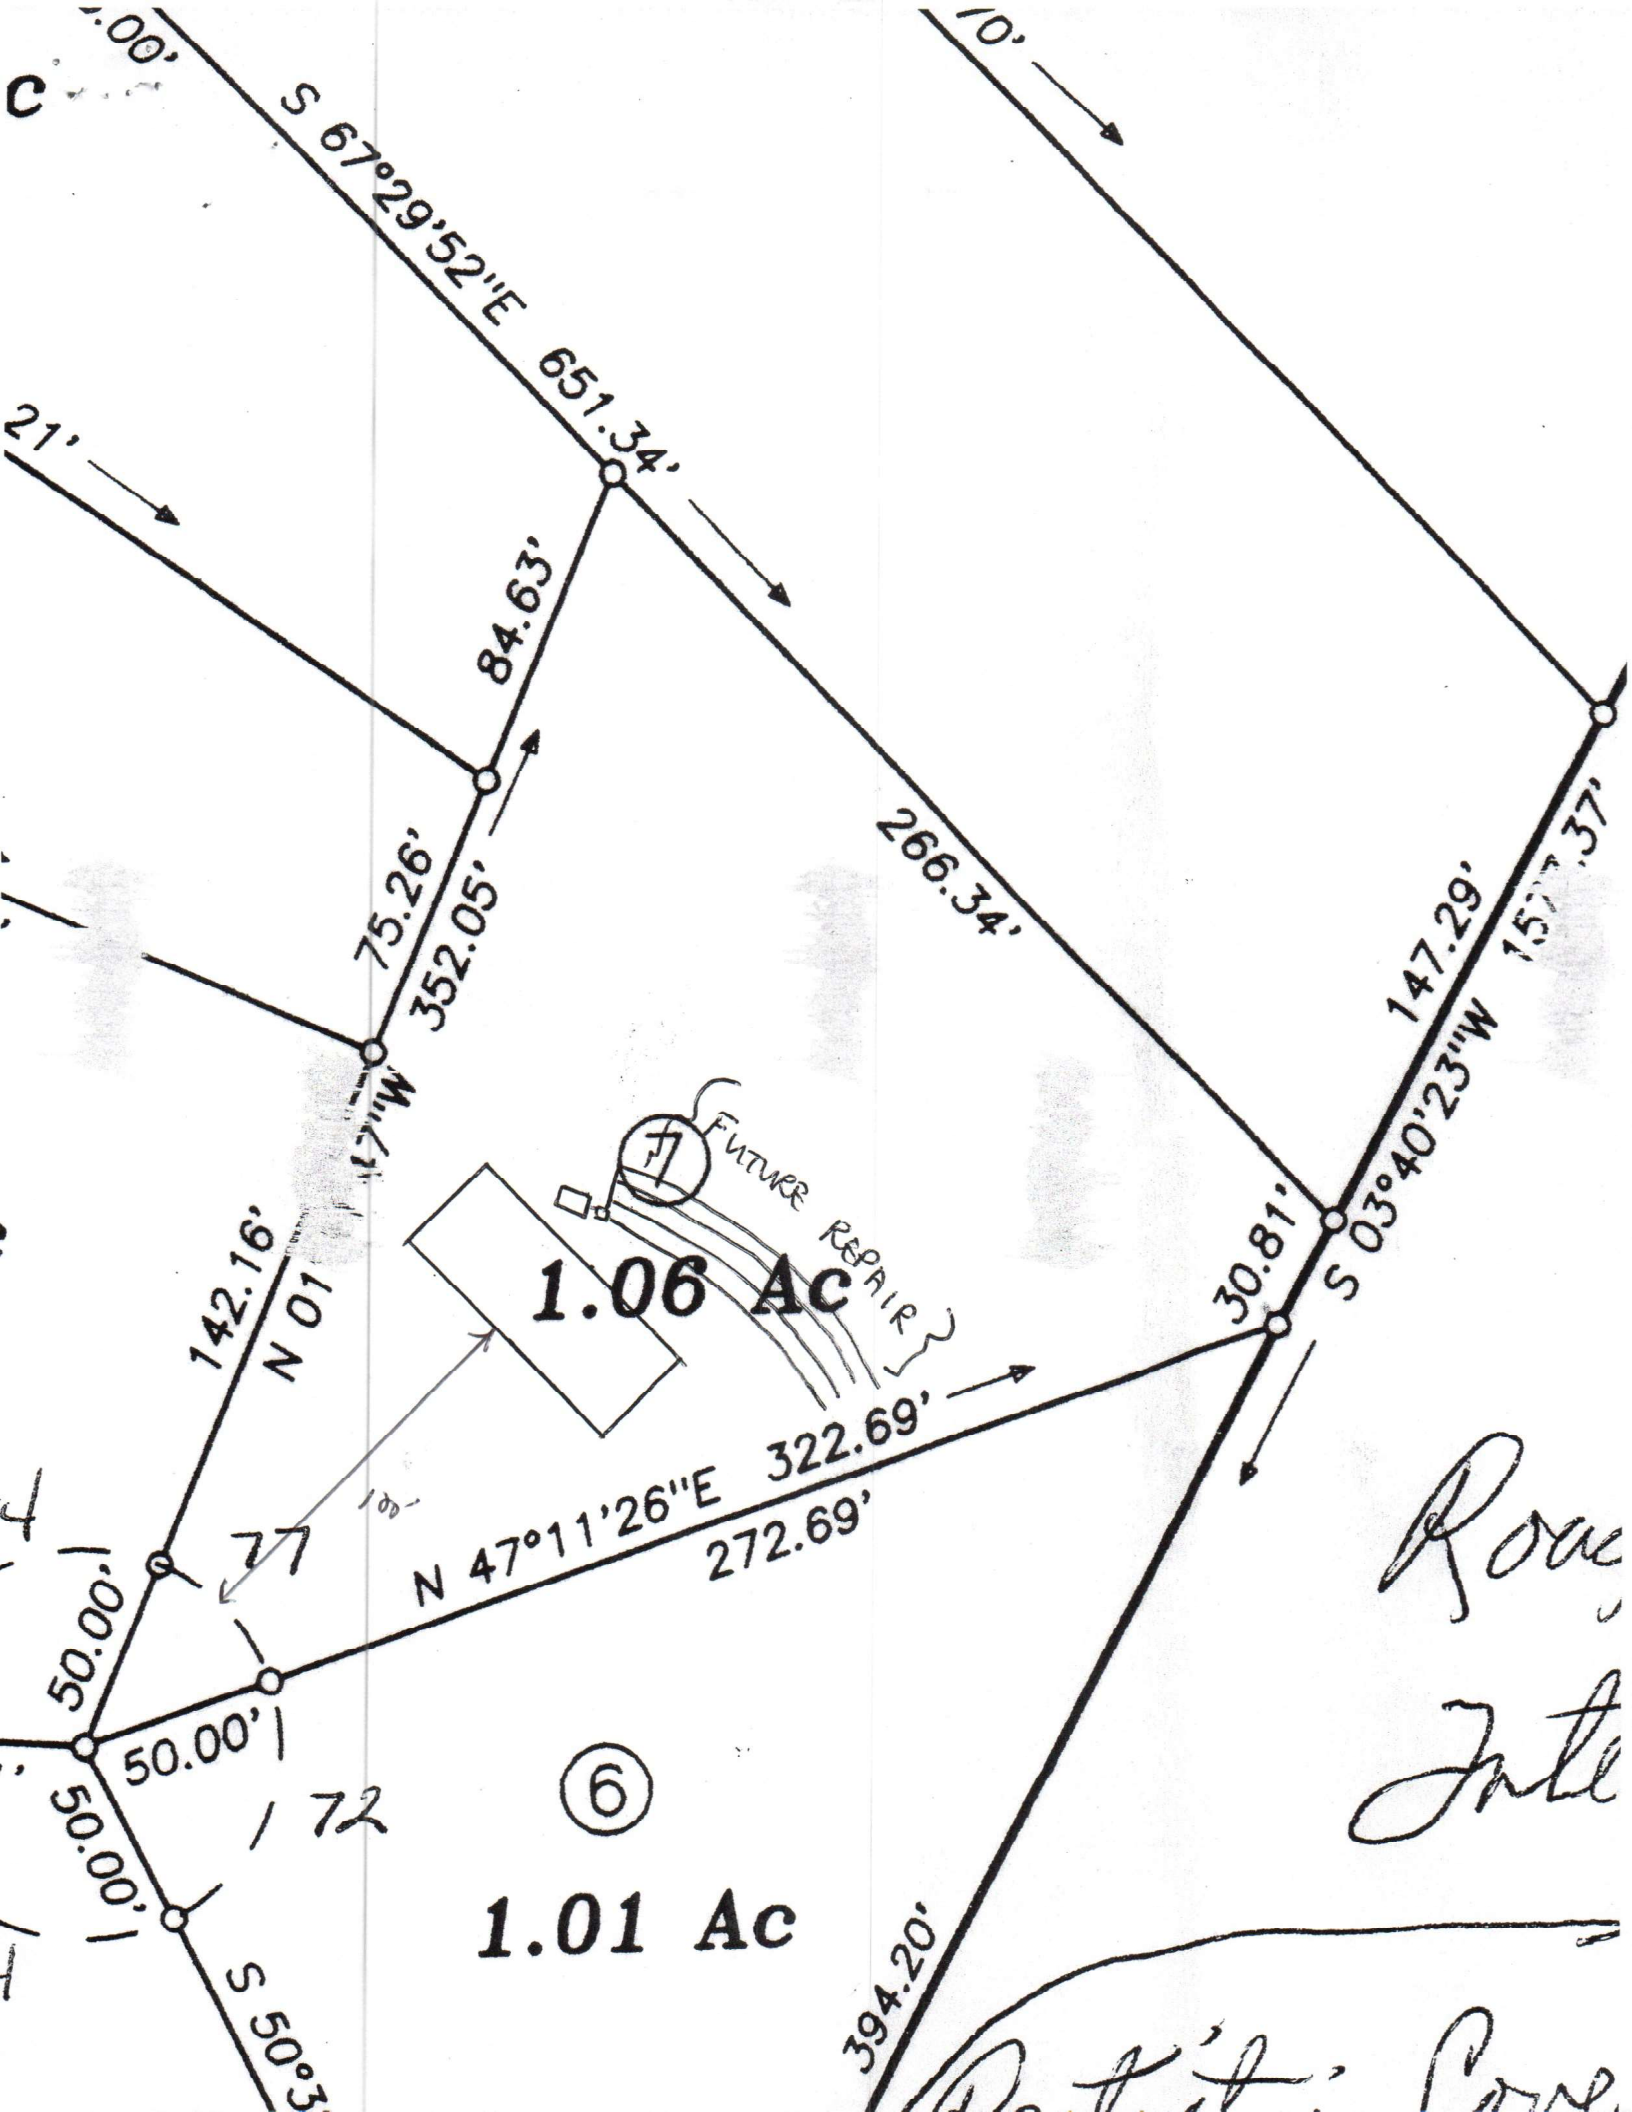

OWNER Creative PERMIT NUMBER 2416
 DATE 10-23-2000 CONTRACTOR Wayne Ayseue
 WEATHER CONDITIONS Sunny SOIL WETNESS CONDITIONS OK

SEPTIC AND PUMP TANK INSPECTION

	INITIAL	DATE
SEPTIC TANK		
MANUFACTURER <u>GCP</u>	<u>WTV</u>	<u>10-23-2000</u>
DATE OF MANUFACTURE <u>8-30-2000</u>		
STAMP		
CAPACITY <u>1000</u>		
TEE		
BAFFLE		
SEALANT		

PUMP TANK		
MANUFACTURER		
DATE OF MANUFACTURE		
STAMP		
CAPACITY		
SEALANT		
MANHOLE		
DRAW DOWN TEST		

MECHANICAL INSPECTION

PUMP		
MANUFACTURER AND MODEL NUMBER		
CONTROL PANEL		
ALARM		
ELECTRICAL CONNECTION		

NITRIFICATION DISTRIBUTION AND DRAINFIELD INSPECTION

DISTRIBUTION BOX		
LEVEL <u>✓</u>		
EQUAL DISTRIBUTION <u>✓</u>		
OTHER		

DISTRIBUTION MANIFOLD		
PIPE SIZE		
GATE VALVES		
OTHER		

OTHER DISTRIBUTION TYPE		
-------------------------	--	--

	LINE 1	LINE 2	LINE 3	LINE 4	LINE 5	LINE 6
NITRIFICATION LINES						
TRENCH WIDTH	<u>3</u>	<u>3</u>	<u>3</u>			
TRENCH LENGTH	<u>133</u>	<u>133</u>	<u>133</u>			
TRENCH GRADE	<u>✓</u>	<u>✓</u>	<u>✓</u>			
STONE DEPTH	<u>12</u>	<u>12</u>	<u>12</u>			

NOTES: _____

