

Edgecombe County Health Department / Operation Permit

PARCEL 04 4841 98 8838 IMPROVEMENT PERMIT NUMBER 2021202-IP/CA

Owner Franks Home Place

Location 486 Cutchin Farm Rd

New Modification Repair Change of Flow Maximum # of Occupants 6

Type of Facility DWMH # Bedrooms 3 Water Supply Public

Septic Tank Size 1000gal Mfg Mills Serial # 5TB858 Filter Red Poly Lock

Pump Tank Size - Mfg - Serial # - Pump -

Grease Trap Size - Mfg - Serial # -

System Type IICAH Review Frequency - D-Box Type Serial diste.


Trench Material Infiltrator Quick 4 Trench Bottom Depth 12" Trench Width 3'

Sq. Ft. Eg 1200ft² # Lines 4 Cover 6"-8" Estimated Flow 3600gpd

Installer Alfred Tyson.

Remarks Installed 4 lines @ 75' x 3' wide alt. trench.

Reference Permits _____

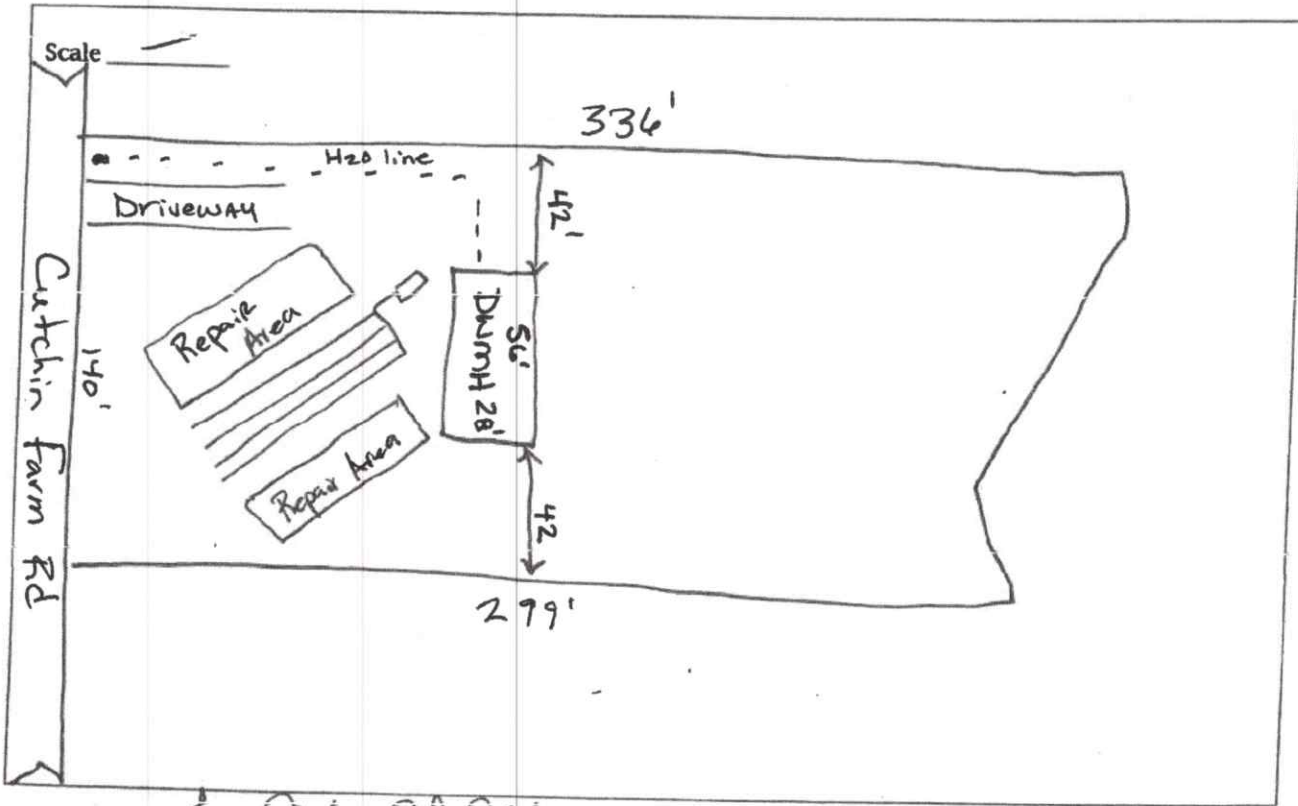

Inspected By George F. Williams PEHS Date of Issue 12/1/21