

Robert & Jennifer Spaulding


MOORE COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH SECTION
OPERATION PERMIT

Bouchelle, Janet E
LAK # 27792
113 Holly Place, Lot 8
3 BR System

Permit # _____ Receipt # 11634 P.I.N. # 852412775251
Installer: Wynn Sharpe Telephone: (919) 499-9411
Address: 3827 Hwy 87S Sanford
System Type: Conventional Maximum Design Flow: 360 (gallons/day)
Wastewater Characteristics: Domestic
Septic Tank Capacity: 1000 (Gallons) Tank I.D. # STB 103 8/21
Nitrification Line Dimensions: 1 @ 150x3
Effluent Distribution Device: _____ Gravel Depth: 12"
Depth To: _____ Top of Tanks: _____ (Inches) Trench Bottom 24" (Inches)

Diagram of Actual Installation: (Depict Property Boundaries, Structures, Driveways, Trees, Water Lines, Water Supplies, Etc.)

Scale: _____ Inch = _____ Feet.

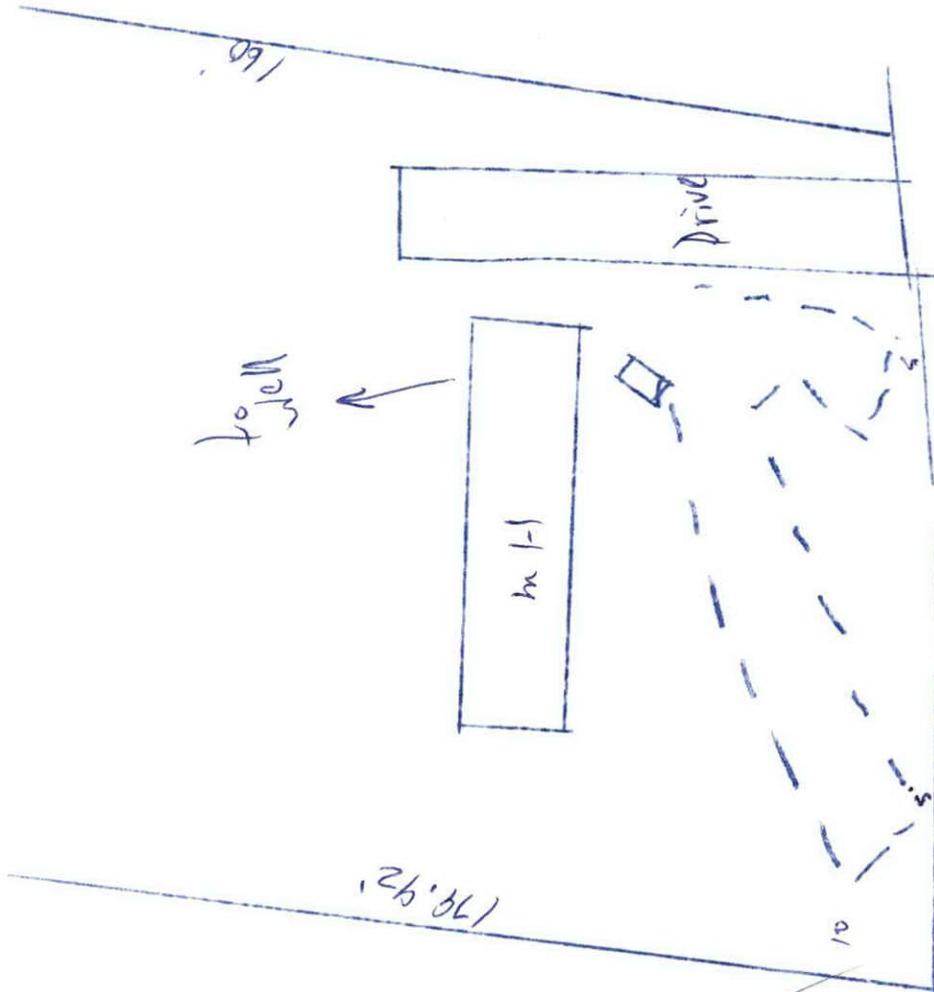

Comments and Conditions: owner staked house too close (50') from road - system changed to meet setbacks # of Attachments: _____

Issued By: Charles S. Rice Date: 9/17/96

FINAL APPROVAL OF THIS SYSTEM SHALL INDICATE THAT THE SYSTEM HAS BEEN INSTALLED IN ACCORDANCE WITH APPLICABLE PERMIT CONDITIONS, LAWS AND RULES, BUT IN NO WAY SHOULD BE TAKEN AS A GUARANTEE THAT THE SYSTEM WILL FUNCTION SATISFACTORILY FOR ANY GIVEN TIME.