

Permit # 33136 PID or LRK# 20190299
 Property Address 346 Pine Laurel Drive, Carthage, NC

Page 1 of 1
 Number of Bedrooms 4




Moore County Health Department

Environmental Health Section
 P.O. Box 279, Carthage, NC 28327
 Phone: 910-947-6283 Fax: 910-947-5127

Operation Permit

Owner: Caviness & Cates Phone # (910)778-7902
 Installer: Garner's Septic Tanks Phone # (910)624-0808
 Address: 121 Stanton Hill Road, Carthage, NC
 System Type: Chamber tech. (25% reduction) Maximum Design Flow: 480 gpd
 Wastewater Characteristics: Domestic
 Septic Tank Capacity: 1000 gal. Date: 11/15/2021 Tank ID# STB-939, GTS-1000
 Pump Tank Capacity: _____ Date: _____ Tank ID# _____
 Nitrification Lines Dimensions: 3 ft. X 78 ft., 70 ft. (148 ft. total line)
 Effluent Distribution Device: _____ Serial _____ Media Depth: _____
 Depth To: Septic Tank: 6 in. (at install) Trench Bottom: 30 in. (at install)

Scale: NTS Inch = _____ Feet

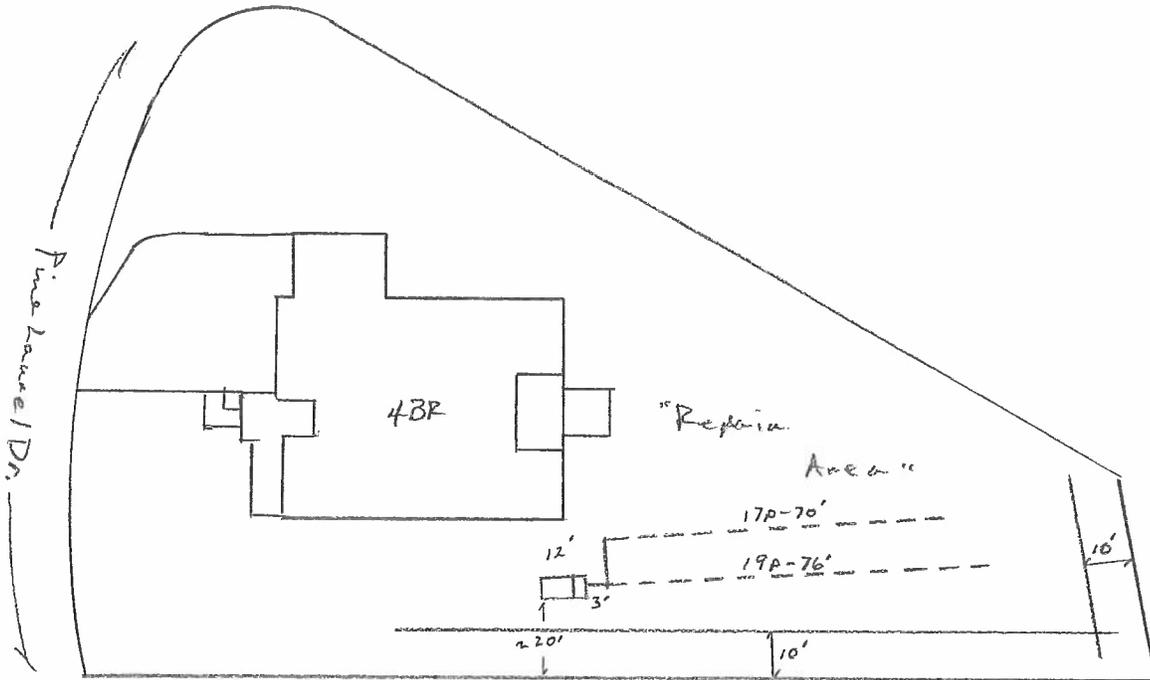

Issued By: WR Dunlop, PE Date: 12-22-21

Final Approval of This System Shall Indicate That The System Has Been Installed in Accordance With Applicable Permit Conditions, Laws and Rules, But in No Way Should Be Taken as a Guarantee That The System Will Function Satisfactorily For Any Given Time.