

PITT COUNTY HEALTH DEPARTMENT

1825 West Sixth Street  
Greenville, North Carolina 27834

Permit No. 1588-89-E RE: 1272-93

New  Existing  Repair

CERTIFICATE OF COMPLETION (COMPLIANCE)

Ground Absorption Sewage Disposal System (Septic Tanks)  
N.C. General Statutes, Chapter 130A-Article 11

Date 7-1-93 Parcel# 49104

Owner Ng, Kenny  
Last First Middle

Location Rock Springs lot 18A

Type of Use: Residence House #Bedrooms 5  
Other \_\_\_\_\_

System Type: IIa

Capacity 1500 Mfgt. SW Serial# 577-128

Distance From House 12' Cover 10"-12"

Sq. Ft. 1800 #Lines 6 Width 3'


Drainage Required no Completed \_\_\_\_\_

Water Supply BA

Comments \_\_\_\_\_

Installed by Stallings Co.

Inspected by [Signature]

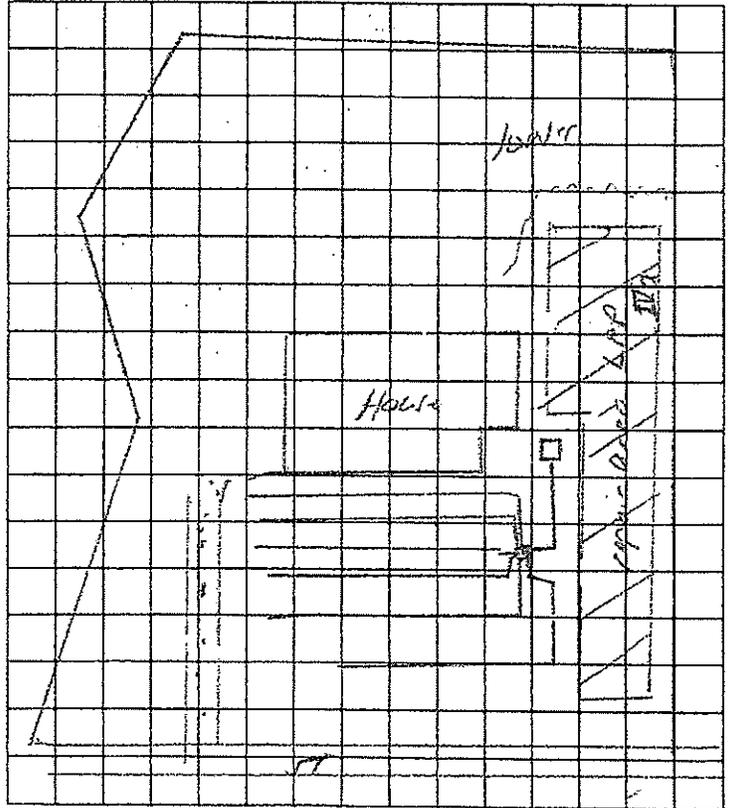

Suitable  
 Provisionally Suitable  
 Unsuitable

**PITT COUNTY HEALTH DEPARTMENT  
 ENVIRONMENTAL HEALTH DIVISION**  
 1825 West Sixth Street  
 Greenville, N.C. 27834 — Phone 830-6380

Eddie Halligan  
 2/30  
 Friday  
 Existing \_\_\_\_\_  
 New   
 Repair \_\_\_\_\_  
 RE: 1272-93

3:30  
 Tax Parcel # 49104

**APPLICATION**

Article 11 of Chapter 130A of The General Statutes of North Carolina

51262  
 951 White Horse Drive

In Reply Please Refer To:

Date Received 11-14-89  
 Permit Number 1598-99  
 Owner ~~Will Thomas~~ K. A. N. Phone ~~756-4111~~ 756-4111  
 Address ~~2005 Venture Ave~~ 2911 Church Hill Rd, Unit C City Greenville, SC Zip 27834  
 Subdivision Name Rock Springs Farm, Phase II Lot No. 18A Block No. 4  
 Directions Highway 45 North

Land Use house Bedrooms 4 1/2 Water Supply Well Artesian  
 Plot Plan Required: Yes  No \_\_\_\_\_

\*\*\*This is an official document. Please retain with other valuable papers.

Owner's Signature or Agent

**IMPROVEMENT PERMIT**

**LAYOUT SKETCH**

Site Classification Information:

Topography S Soil Texture PS  
 Soil Structure SS Soil Depth S  
 Restrictive Horizon: S Flood Plain OTR  
 Soil Drainage: Internal S External S  
 Other \_\_\_\_\_ Estimated Flow 420600  
 Septic Tank Capacity 1500  
 Nitrification Square Footage 1800  
 Keep Rock 3/4" inches from the natural soil surface.  
 Comments The area for all water in the  
pool system area must be measured - no other  
building can be there.

**SEPTIC TANK SYSTEM  
LOCATION APPROVED**

BY Travis Shultz

DATE 8-10-92

PERMIT # 1598-99

*9-9-92 Horse location + drive  
revised - refer to L. 888  
if needed other house is completed*

FRONT

Date Issued 8-10-92 (original) By Travis Shultz Sanitarian  
 Date 7-1-93 By Travis Shultz Sanitarian

**INSPECTION COMPLETED**

White—OWNER'S COPY  
 Yellow—HEALTH DEPARTMENT COPY  
 Pink—BUILDING INSPECTOR'S COPY

**VALID FOR 36 MONTHS**

PITT COUNTY HEALTH DEPARTMENT

1825 West Sixth Street  
Greenville, North Carolina 27834

Rev 1588-93

Permit No. 1272-93-I

New  Existing  Repair

CERTIFICATE OF COMPLETION (COMPLIANCE)

Ground Absorption Sewage Disposal System (Septic Tanks)  
N.C. General Statutes, Chapter 130A-Article 11

Date 9-16-93 Parcel# 49104

Owner Ng, Kenny  
Last First Middle

Location Rock Springs lot 18A

Type of Use: Residence Home #Bedrooms 5

Other

System Type II

Capacity 1500 Mfg. Serial#

Distance From House Cover

Sq. Ft. 1800 #Lines 6 Width


Drainage Required Completed

Water Supply B.A.

Comments repair is for areas cut by a trencher

Installed by Stallings

Inspected by [Signature]

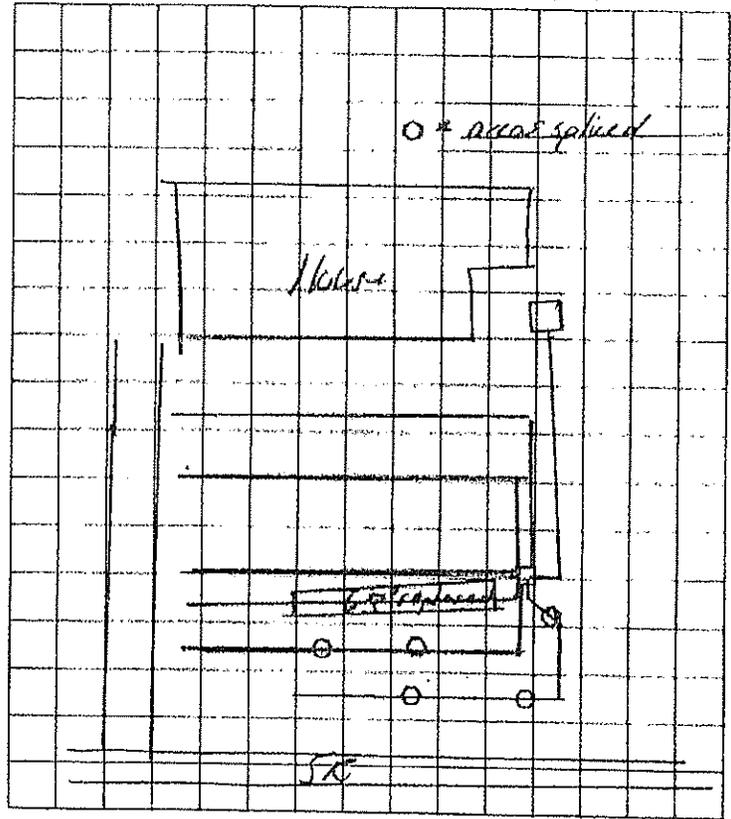

09/10/1993  
12:01:54

PITT COUNTY HEALTH DEPARTMENT

Stallings  
C300

ENVIRONMENTAL HEALTH DIVISION  
1717 WEST FIFTH STREET  
GREENVILLE, N.C. 27834  
PHONE 413-1253

PAID  
YES  
NA NO

EXISTING \_\_\_\_\_  
NEW \_\_\_\_\_  
REPAIR X

APPLICATION

9 51 White Horse Drive  
Rc-1588-89

ARTICLE 11 OF CHAPTER 130A OF THE GENERAL STATUTES OF NORTH CAROLINA

DATE RECEIVED: 09/10/1993

PERMIT NUMBER: 1272-93  
PARCEL NUMBER: ~~4104~~ 5126

APPLICANT: KENNY NG  
ADDRESS: 2911 CEDAR CREEK RD  
UNIT C  
GREENVILLE, NC 27834

IDENTIFIER #: 21578-0001

PHONE: HOME 919-756-9661 WORK 919-000-0000  
SUBDIVISION NAME: ROCK SPRINGS FARM PHASE 11  
LOT NO: 18 A

DIRECTIONS: HWY 43 N

BLOCK NO:


LAND USE: HOUSE  
WATER SUPPLY: BELL ARTHUR  
BEDROOMS: 005 EMPLOYEES: 000  
SIZE OF LOT/DIMENSIONS:

\*\*\*THIS IS AN OFFICIAL DOCUMENT. PLEASE RETAIN WITH OTHER VALUABLE PAPERS.  
TANK SIZE Ex. 1500 ROCK WITHIN \_\_\_\_\_ INCHES  
NITRIFI. Ex. 1800 PLOT PLAN REQ'D \_\_\_\_\_  
FLOOD PLAIN \_\_\_\_\_ DATE OF EVAL. \_\_\_\_\_  
APPLICANT'S SIGNATURE \_\_\_\_\_  
SYSTEM TYPE \_\_\_\_\_  
OPER. REQ'D \_\_\_\_\_

REMARKS:

- This ~~new~~ permit is for the repair of the existing system, cut-by-by a trench.
- Expose distribution box to be checked for cracks - replace if needed.
- Expose and repair all areas cut by trench (sch. 40 pipe and rock lines) - 3'x3' area to be spined on rock lines - clear all pipes of excess dirt & roots.
- The line totally to cut must be dug up and the rock lines removed and a new line installed (3' wide to 12' rock).
- Any other area disturbed must be repaired.

LAYOUT SKETCH

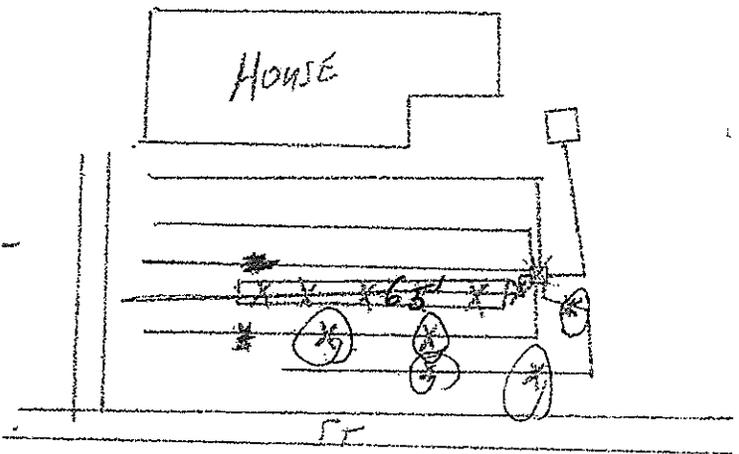

DATE ISSUED 9-13-93

ENVIR. SPECIALIST


*[Signature]*

DATE APPROVED 9-16-93

ENVIR. SPECIALIST

*[Signature]*

VALID FOR 60 MONTHS

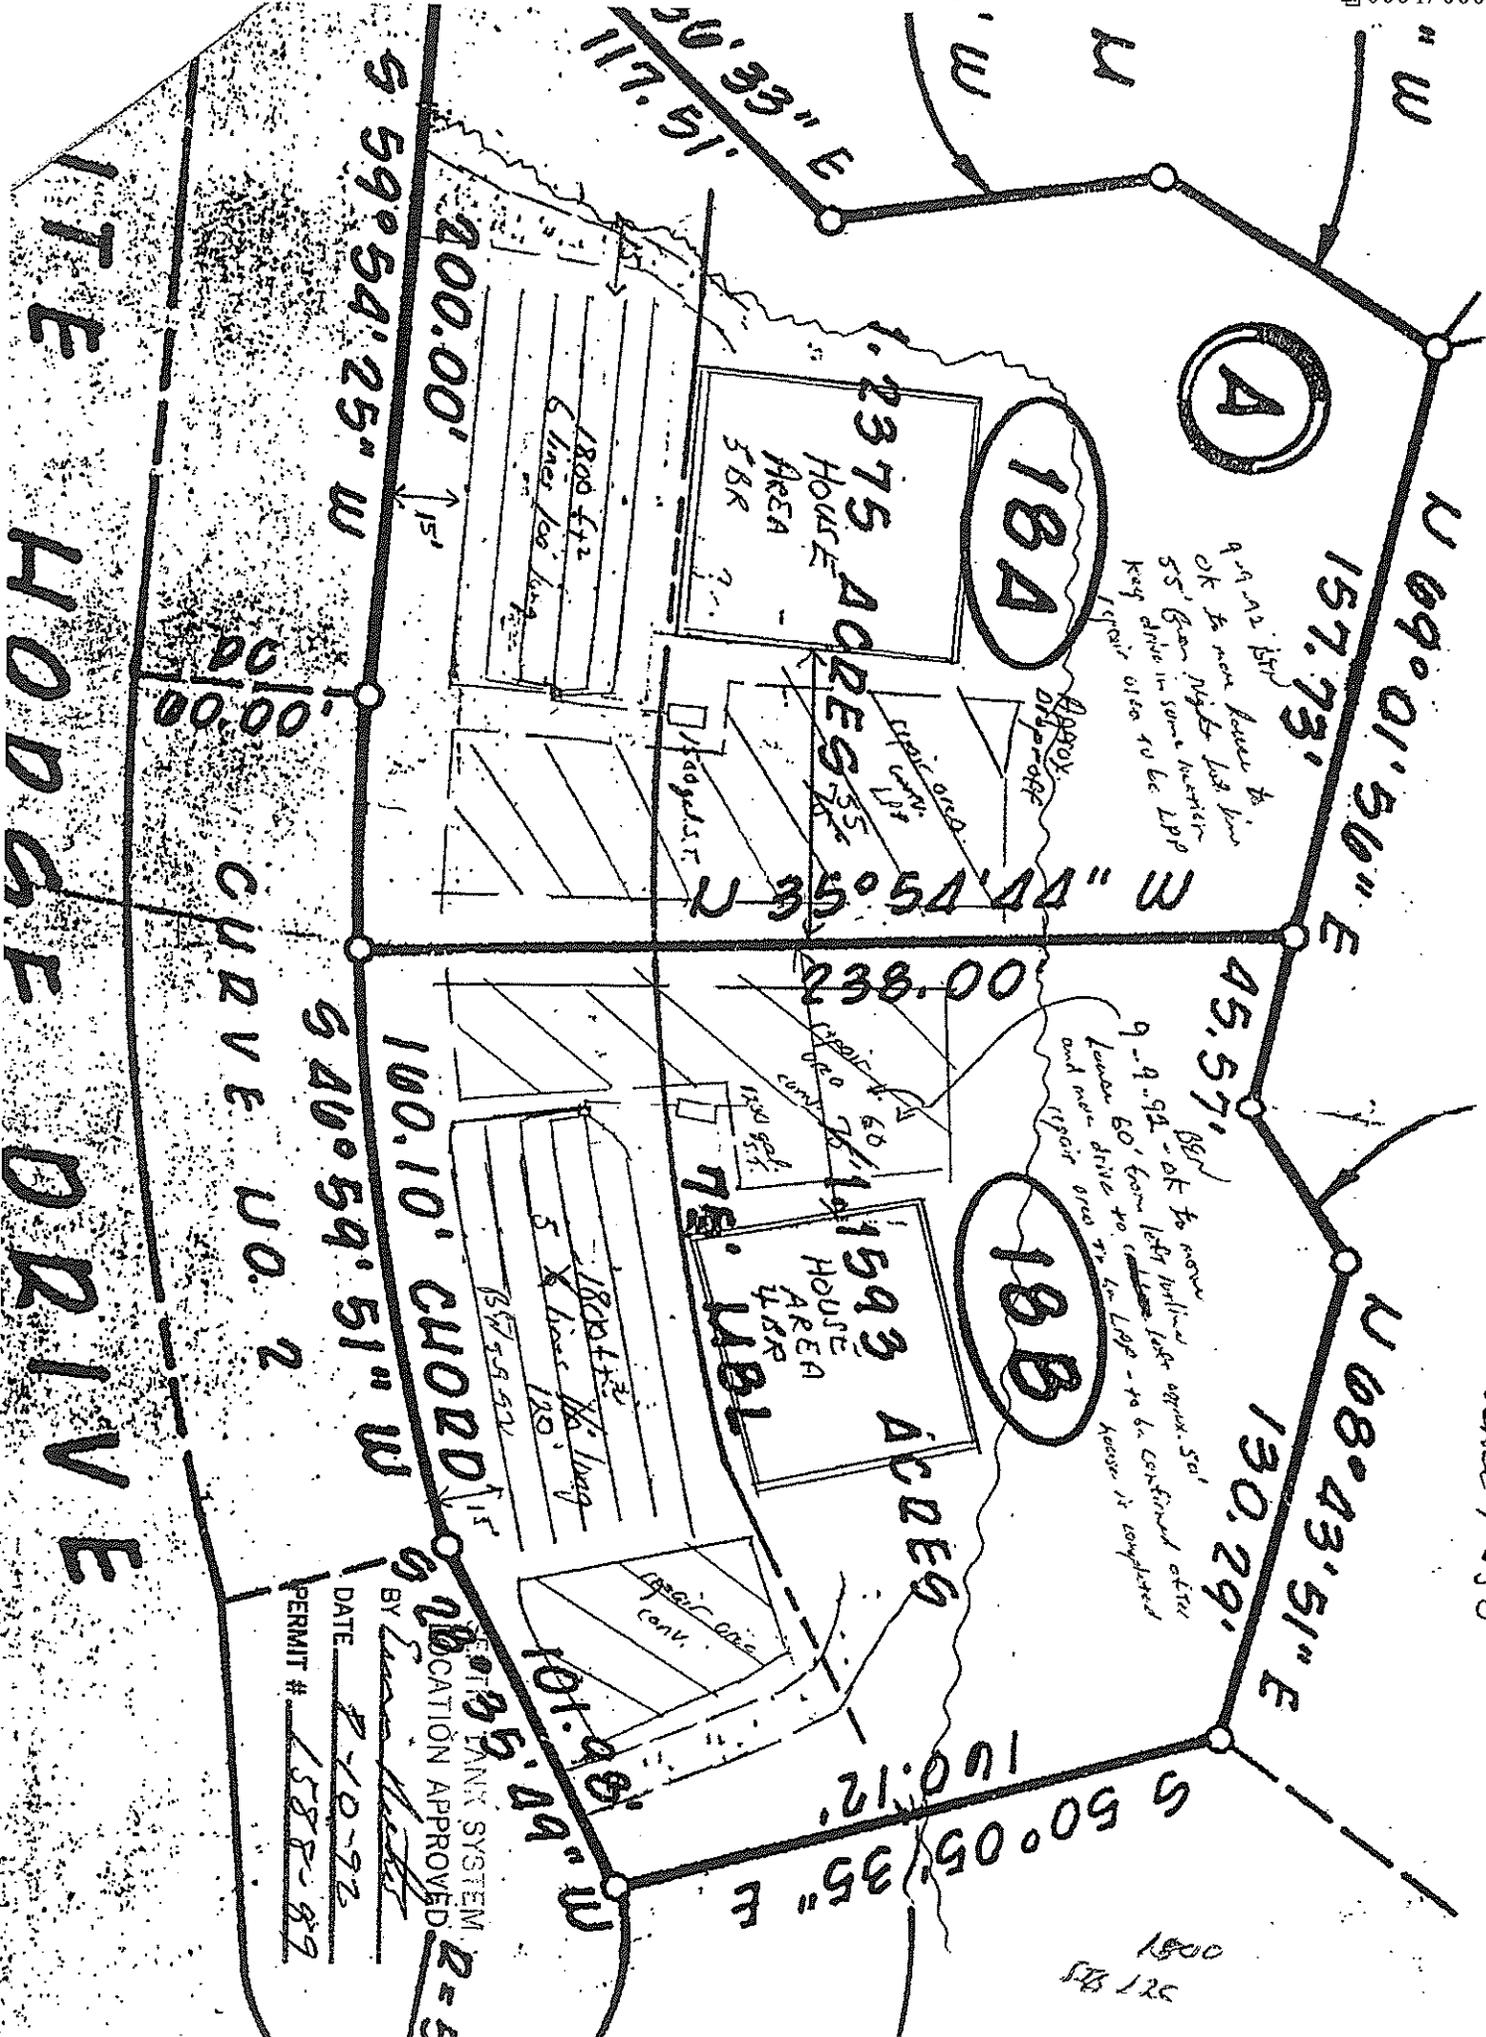

ITE HODGE DRIVE

SCALE 1/4" = 50'

DATE 11-10-92  
 BY [Signature]  
 PERMIT # 15888-89  
 REGISTRATION SYSTEM APPROVED  
 R-5

1800  
0001  
277 275