

Permit: 337798



ALBEMARLE REGIONAL HEALTH SERVICES
Partners in Public Health

Currituck


PIN: 010B00000030000

Owner:
SBMK INVESTMENTS LLC
111 CURRITUCK COMMERCIAL DR STE B
MOYOCK, NC 27958

Applicant:
QUALITY HOMES OF CURRITUCK
417-D CARATOKE HWY
MOYOCK, NC 27958

LTAR: 0.300
Water: PUBLIC
TYPE III C.
SINGLE FAMILY
GPD: 600

Location:
107 TYLER WAY

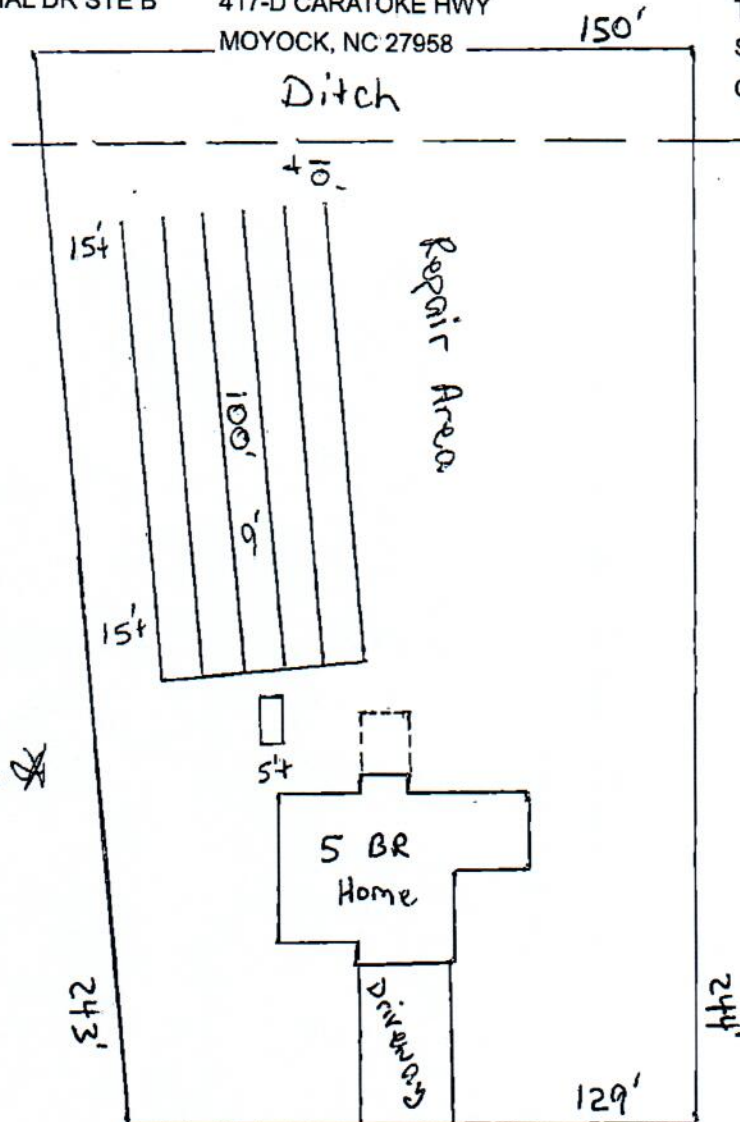

*1250 Gallon
Septic Tank*

- **Set tank high (12 inches minimum) so top of lines are at filled surface**
- **Keep septic system 50'+ from any well**
- **Fine Sandy Loam @ 4.5 feet**
- **Fill house pad higher than finished septic tank grade**
- **Consult with plumber & septic installer prior to starting of home construction to ensure finished floor, plumbing stub-out, and septic tank elevations are met per septic permit requirements**

Authorized Agent: Kevin Carver
Carver, Kevin

Date: 02/10/2021

Approved: [Signature] R 645194

Date: 7-7-2021

ALBEMARLE REGIONAL HEALTH SERVICES
Final Inspection

Name: SBMK INVESTMENTS LLC

Permit #: 337798

System Installer: BRAD SPARKS

Manufacturer: NRM-1250/STB-198

Septic Tank Serial: 198

Gallons: 1,250


Drain Field Type: EZFLOW EZ 1203H-GEO

Distribution Type: GRAVITY - PARALLEL (eq. d-box)

Number of Nitrification Lines: 6 x 100

Total Trench Length: 600

Comments: _____

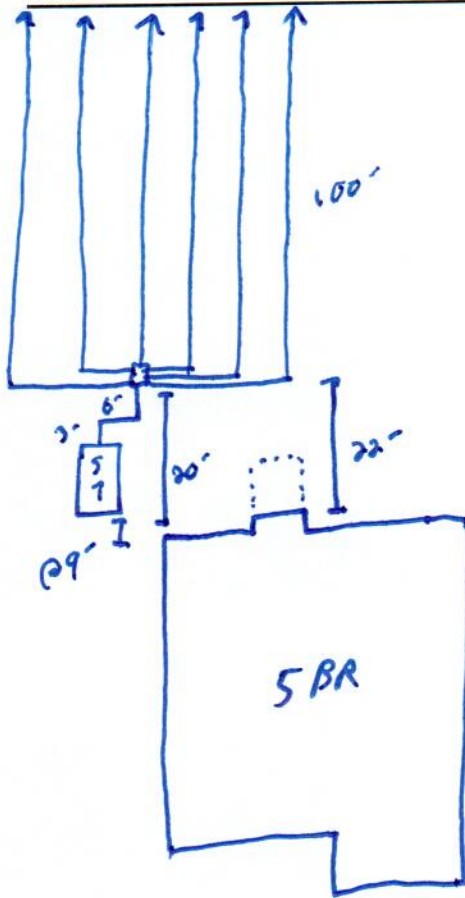

Tyler

EHS:  RBAS 194

Date: 07/07/2021

Swinney, David