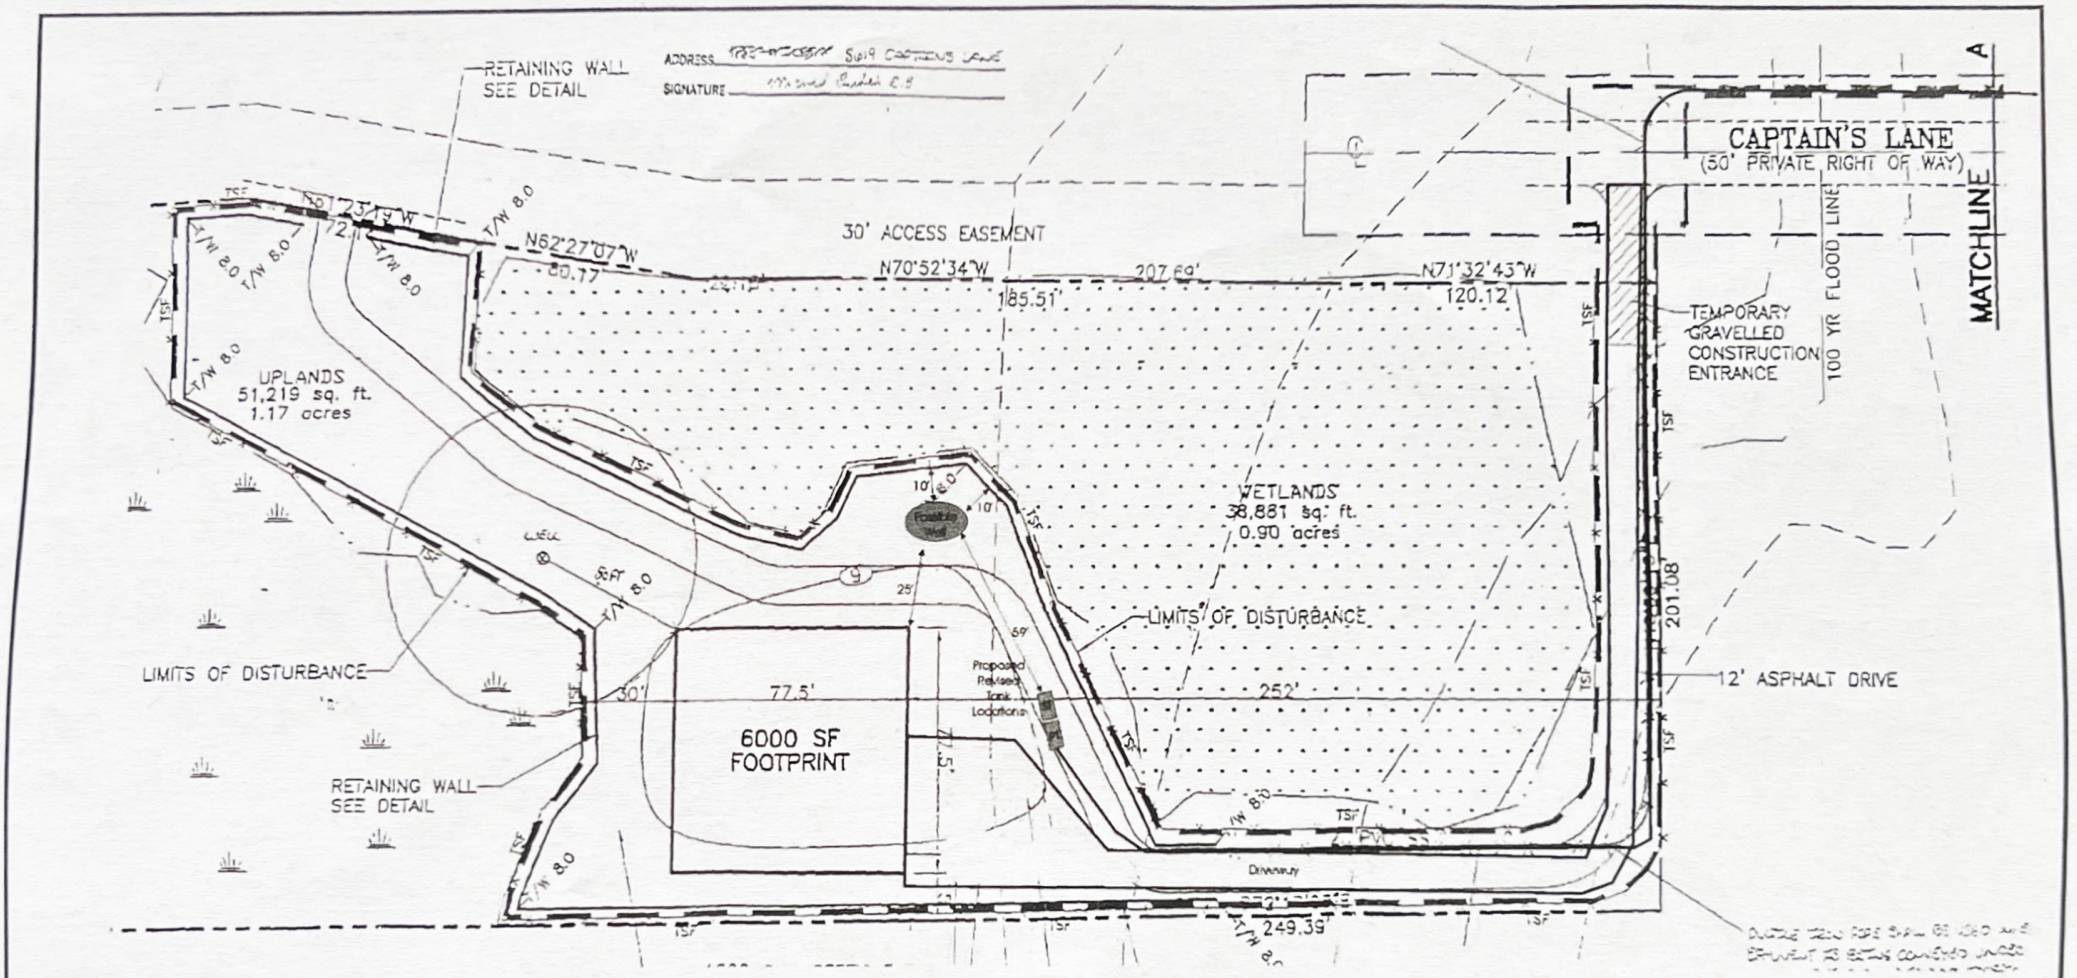

Note: Supply line to be installed at least 30" deep under any area subject to vehicular traffic and out of delineated wetland area.
Supply line to be constructed of ductile iron at any point that is less than 50' from any private water supply.
Supply line easement from lot to off-site area to be field staked prior to final system inspection.

Map adapted from previous permit site plan supplied by New Hanover County Environmental Health

Applied Resource Management PC
P.O. Box 882, Hampstead, NC 28443
(910) 270-2919 FAX 270-2988

TITLE: Cape Fear Land Managers Captains Lane				FIGURE:
JOB: 07239	SCALE: 1"= 50'	DATE: 4/03/08	DRAWN BY: GY	1