


MOORE COUNTY HEALTH DEPARTMENT  
ENVIRONMENTAL HEALTH SECTION  
SUBSURFACE SEWAGE DISPOSAL SYSTEM  
PERMANENT RECORD

LRK 23544  
25 Quail Hollow Dr  
Lot W-14  
3 Bedroom septic

Installer Robert Crissman Phone 947 5648  
Address Carthage  
Tank Capacity 1000; 1000 - per CCNC Tank I.D. # MCP 814 1/27 X2  
Nitrification Line Dimensions 2 @ 75x3'  
Distribution Box 40' Gravel Depth 12"  
Depth To: Top of Tank 12" Trench Bottom (Average) 24"  
Pump \_\_\_\_\_ Size \_\_\_\_\_ Brand Name \_\_\_\_\_ Pump Tank Capacity \_\_\_\_\_

Diagram of Actual Installation (Depict Property Boundaries, Driveways, Trees, Water Lines, Water Supplies, Etc.)

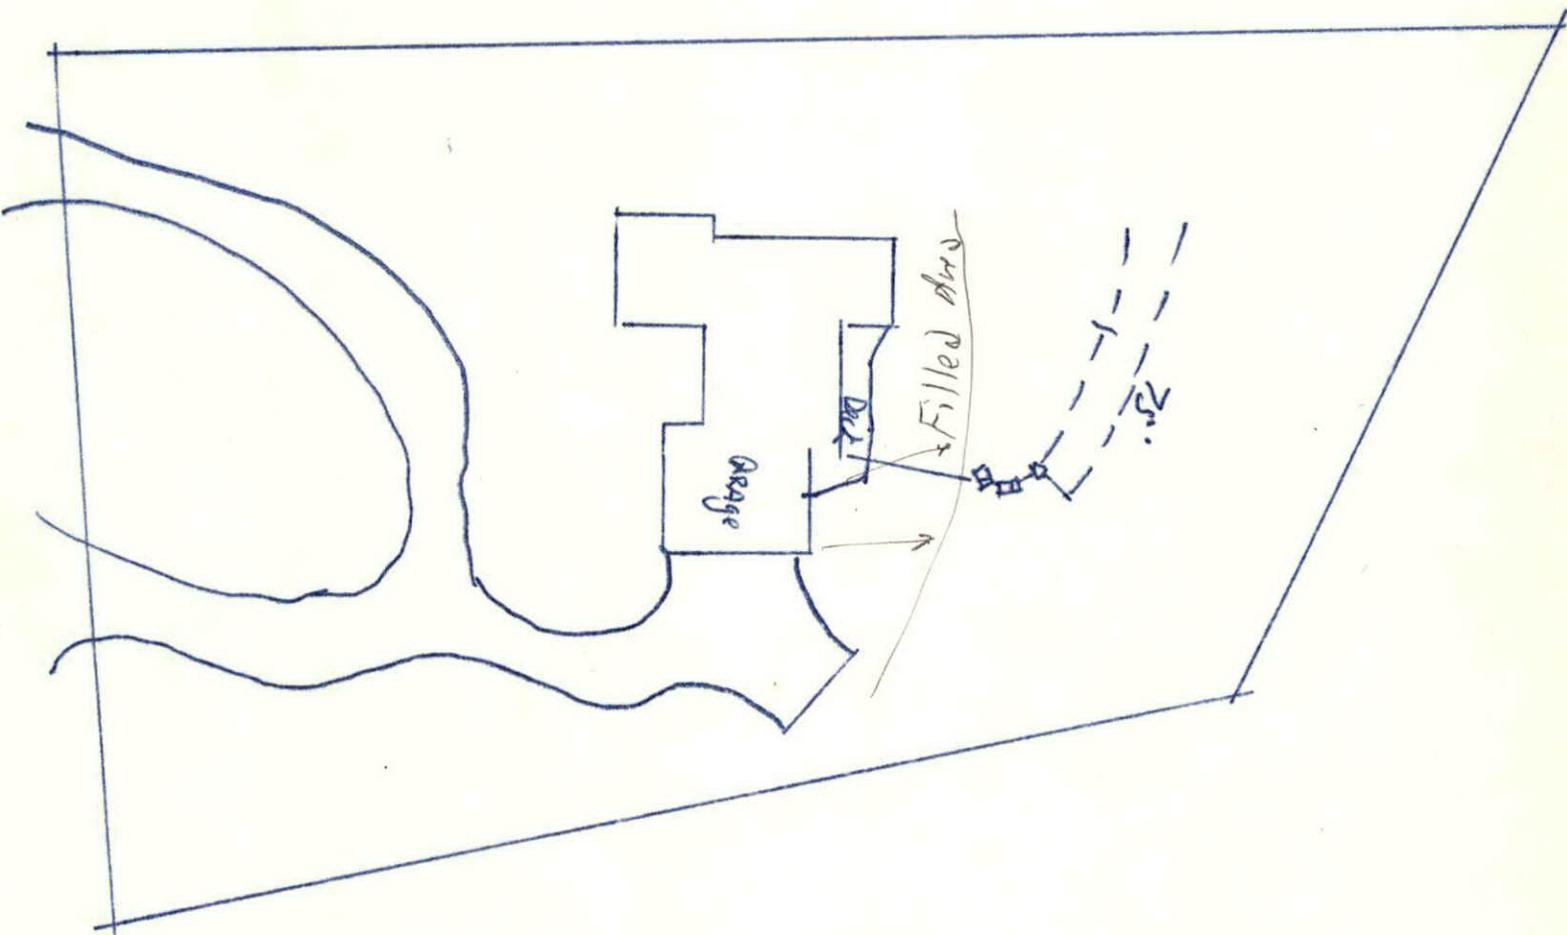

Comments: \_\_\_\_\_

Approved By: Charles D. Riggs Date: 3/16/84