




## Moore County Health Department

Environmental Health Section  
 P.O. Box 279, Carthage, NC 28327  
 Phone: 910-947-6283 Fax: 910-947-5127

### Operation Permit

Owner: <u>Eric &amp; Heather Hunt</u>	Phone # <u>(910) 639-4805</u>
Installer: <u>Yellow Dog</u>	Phone # <u>(910) 890-0328</u>
Address: <u>Lillington</u>	
System Type: <u>Gravity to chamber tech</u>	Maximum Design Flow: <u>480 GPD/ 4 BR</u>
Wastewater Characteristics: <u>Domestic</u>	
Septic Tank Capacity: <u>MCP 1000g</u>	Date: <u>6/18/2021</u> Tank ID# <u>STB 814</u>
Pump Tank Capacity: <u>N/A</u>	Date: _____ Tank ID# _____
Nitrification Lines Dimensions: <u>168' X 3'</u>	
Effluent Distribution Device: _____	Media Depth: <u>12"</u>
Depth To: <u>Top of Tanks: &lt;6"</u>	Trench Bottom: <u>31"</u>

Scale: NTS Inch = \_\_\_\_\_ Feet

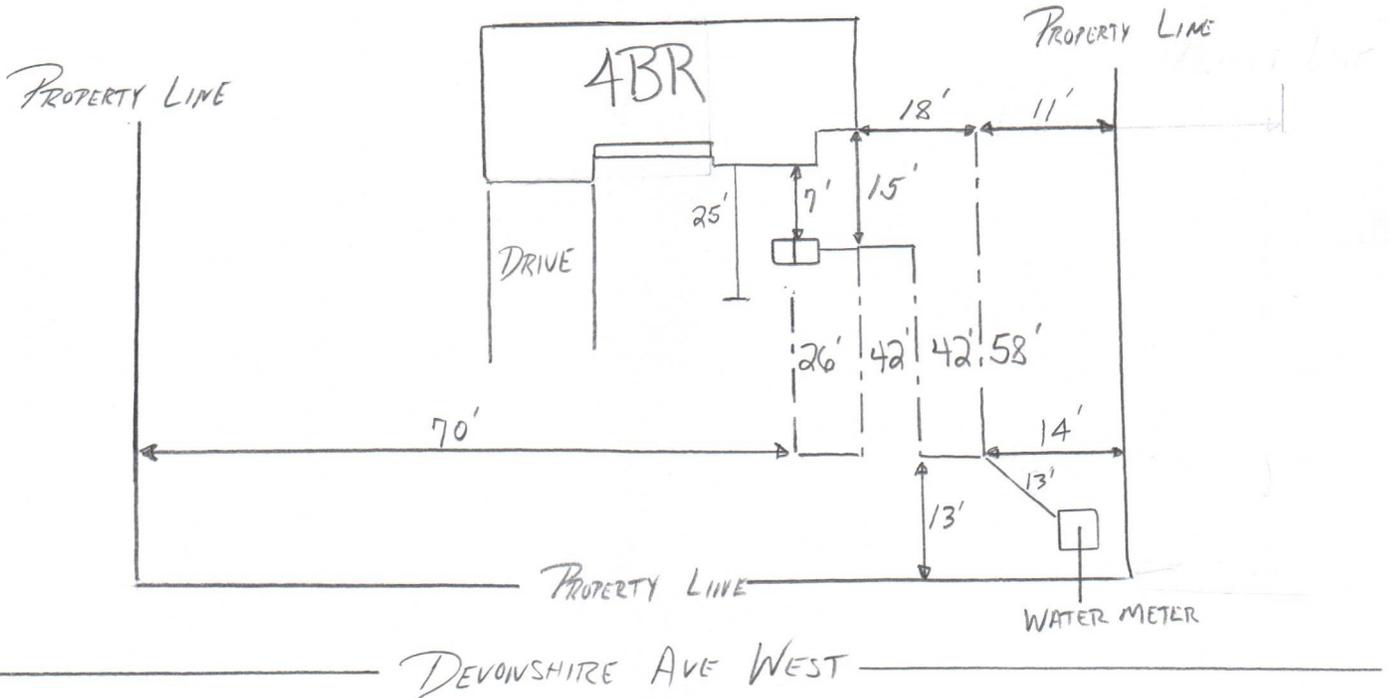

Issued By: *[Signature]* Date: 9-7-21

Final Approval of This System Shall Indicate That The System Has Been Installed in Accordance With Applicable Permit Conditions, Laws and Rules, But in No Way Should Be Taken as a Guarantee That The System Will Function Satisfactorily For Any Given Time.