



BREAK

**Carteret County
Environmental Health**

Section: Current Wastewater Information

Repair Job

89411

Form: HB-296
CCHD

**PUBLIC HEALTH SANITATION DIVISION
CARTERET COUNTY HEALTH DEPARTMENT**

CERTIFICATE OF COMPLETION: (Ground Absorption Sewage Disposal System - G-S Chapter 130 - Article 13c)

OWNER: Guy M. Styron DATE: 2-26-81

INSTALLER Same DATE COMPLETED: 3-20-81

Notice: This certification of completion in no way binds the Public Health Sanitation Division of Carteret County Health Department nor implies a guarantee that this system will function in all circumstances, but that the system is properly installed in accordance with applicable rules and regulations of the Carteret County Health Department and can reasonably be expected to perform properly under normal conditions of use and maintenance.

By: [Signature]

**PUBLIC HEALTH SANITATION DIVISION
CARTERET COUNTY HEALTH DEPARTMENT**

LAND USE

IMPROVEMENT PERMIT

Repair Job

89411

OWNER: Guy M. Styron

PHONE: _____

DATE: 2-26-81

ADDRESS: Rt. 1 Box 682
Beaufort, N.C. 28516

* Grease TRAP - Keep drainline 15 feet from ditch

PROPERTY LOCATION: Laurel Rd.

TYPE STRUCTURE: Existing House

NO. BEDROOMS: 2 NO. BATHS: 1

WATER SOURCE: Existing well

GARBAGE GRINDER: YES () NO (X)

AUTO DISHWASHER: YES () NO (X)

AUTO WASHING MACHINE: YES (X) NO ()

Perc. Rate (if applicable): _____

SIZE OF TANK: Grease Trap (200) GAL.

NO. LINES: _____ WIDTH: 36


TOTAL: 180 SQ. FT.

TOTAL LENGTH: 50 FT.

HORIZONTAL DISTANCE FROM WELL: 100+ FT.

NOTICE: Construction must comply with all state and local regulations. Do not install well until well site has been approved. Do not cover any portion of system until approved on final inspection.

IMPROVEMENTS PERMIT BY: Charles W. SAN I...
Agent

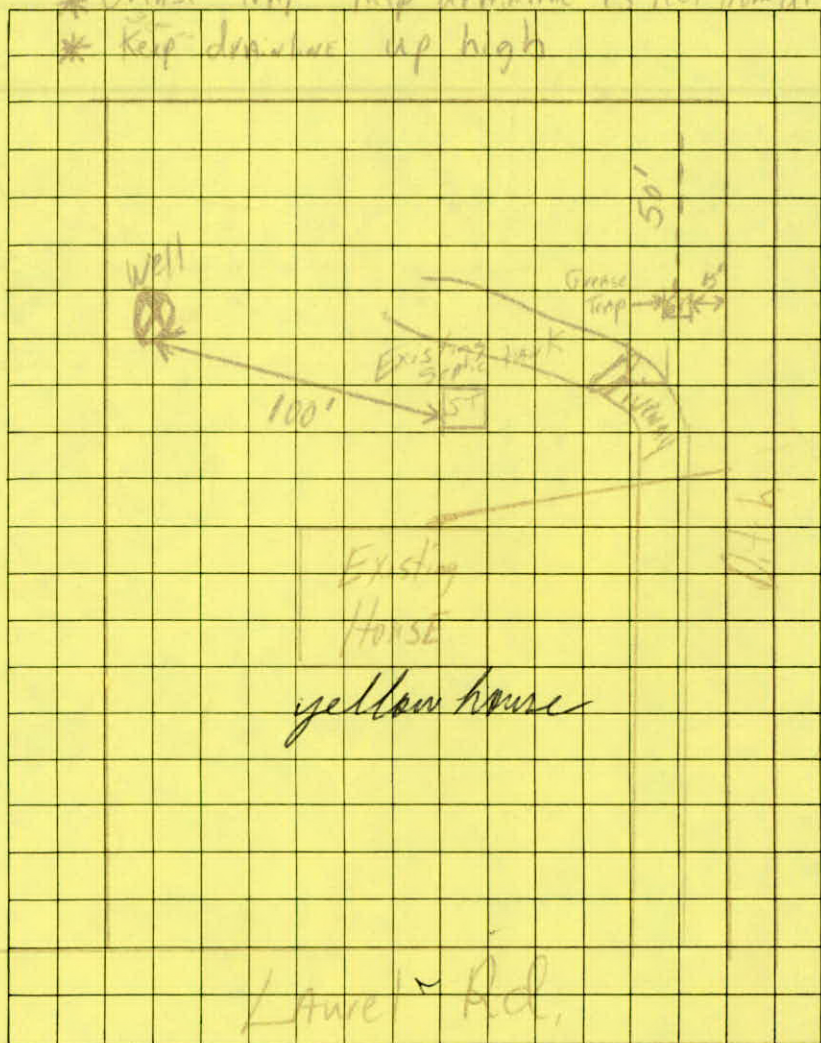

**PUBLIC HEALTH SANITATION DIVISION
CARTERET COUNTY HEALTH DEPARTMENT
BEAUFORT, N. C. 28516**