


**MOORE COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH SECTION
SUBSURFACE SEWAGE DISPOSAL SYSTEM
PERMANENT RECORD**

Ford, Wes & Kay
LRK 42805
750 Mimosa Dr
Lot 117-B
3 bedroom septic

Installer Larry Sharp Phone _____
 Address Sanford
 Tank Capacity 1000 gallon Tank I.D. # _____
 Nitrification Line Dimensions 3(65'x3')
 Distribution Box Yes Gravel Depth 12"
 Depth To: Top of Tank 12" Trench Bottom (Average) 24"
 Pump Yes Size 1/2 Brand Name Gould Pump Tank Capacity 1000

Diagram of Actual Installation (Depict Property Boundaries, Driveways, Trees, Water Lines, Water Supplies, Etc.)

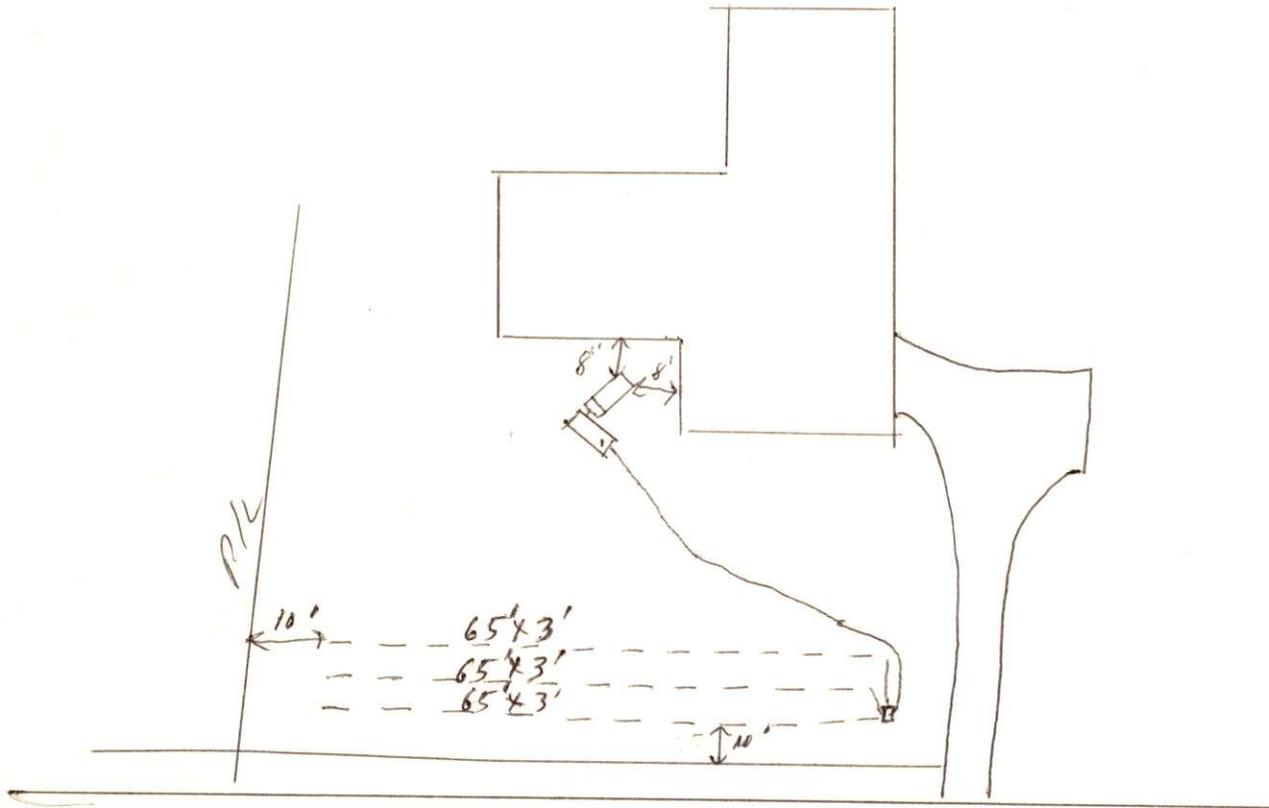

Comments: _____
sandy soil

Approved By: JR Smith Date: 2-5-92