JOHNSTON COUNTY ENVIRONMENTAL HEALTH DEPARTMENT

309 E. Market Street
Smithfield, North Carolina 27577
Telephone: 919-989-5180 • Fax: 919-989-5190

Application # 98064 **Parcel #** _____

Name: Linda Todle Address: Little Rd. Kenly NC 27542

Location: I 95 N, tpr t. bagley Rd. T/R Princeton Kenly Rd. T/L Hinnant Ed. Rd. T/L Little Rd. On left.

Facility - Type: S.F.D. S/D & Lot # N/A

Soil Site Classification: P.S. LTAR: .4

Bedrooms: 3 Design Daily Sewage Flow: 360 Lot Area: 10 ac

New Construction: YES Repair: N/A Upgrade: N/A Water Supply: Well

Septic Tank Size: 1,000 g Grease Trap Size: N/A

Pump Tank Size: N/A Pump(s) Size: N/A

Drainfield Type: Gtr or Acc. Square Feet: 900 ft

# of Lines: 4 Width: 36" Length: 75' Depth: 18"-20"

Design/Layout by: T.R. Improvement Permit Issued by: T.R. Date: 8-24-12 Exp. Date 8-24-17

Inspection: Lines: Gtr T.R. Septic Tank: T.R. D-Box: T.R.

Pump Tank: N/A Pump(s)/Pressure: N/A

Drainage: N/A Contractor: G&M Backhoe

AUTHORIZATION FOR WASTEWATER SYSTEM CONSTRUCTION

ISSUED BY: [signature] REHS DATE ISSUED: 9-4-12

By rule, this septic system requires the use of an effluent filter and a waterproof seal. A riser and septic marker may also be required. Systems shall be installed as shown in sketch or according to attached plans and specifications. Any unauthorized site disturbance, filling, soil removal, or layout changes may result in the permit being revoked. Improvement permit is valid for 5 years from date of issuance unless otherwise indicated. The owner/agent accepts & verifies the conditions of the permit as indicated below.

OWNER/AGENT: _____ DATE: _____

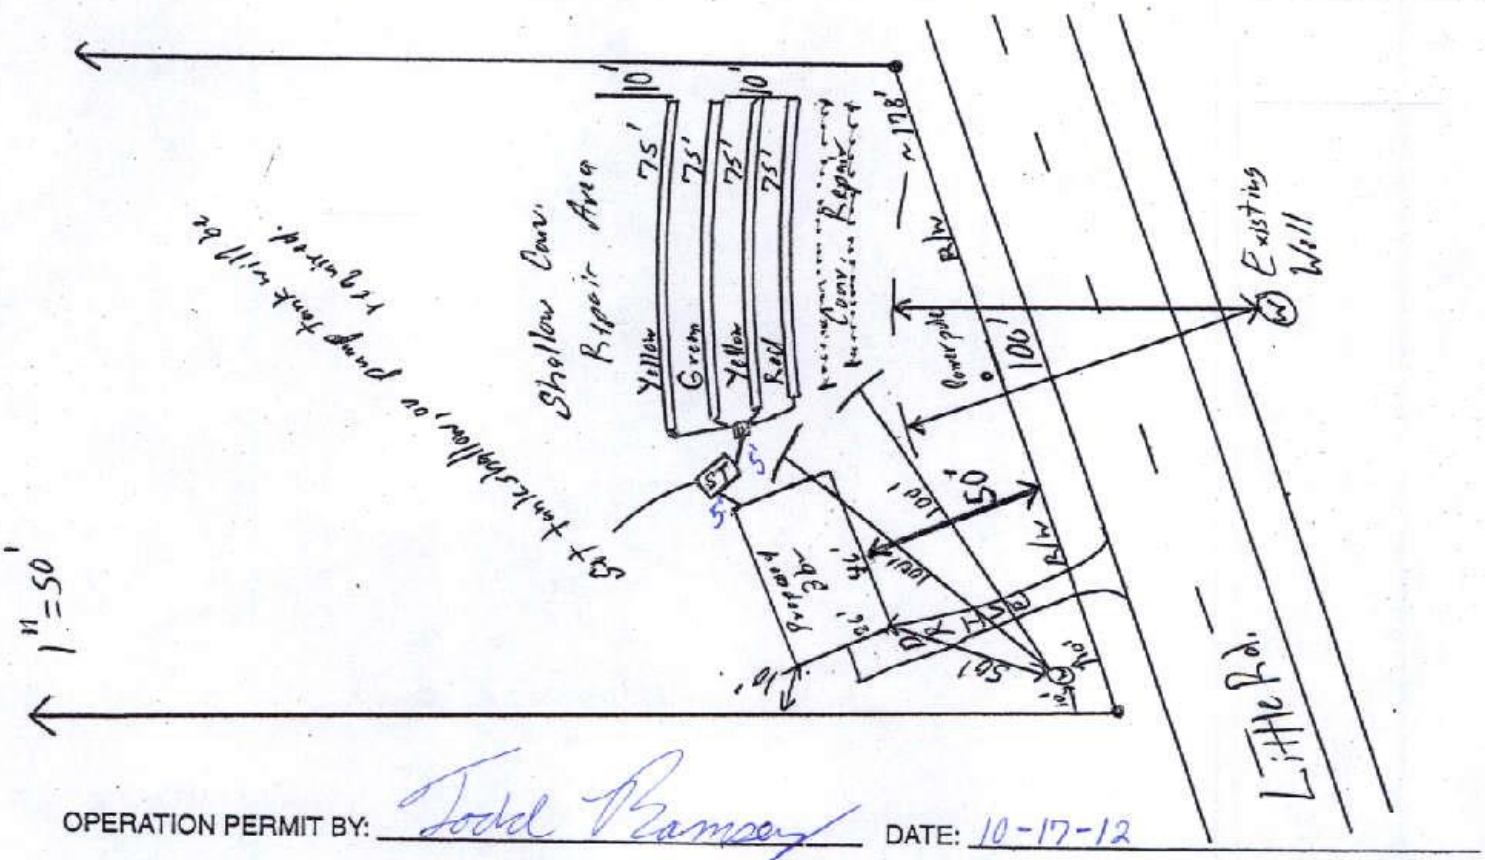

OPERATION PERMIT BY: Todd Ramsey DATE: 10-17-12