

f:\enviro-1\septic-1\sub_01\septic-1.pdw 07-09-2024





PAMLICO COUNTY HEALTH DEPT
PO BOX 306 BAYBORO, NC 28515
(252) 745-5634

Dennis McCarty
7203 Brigantine Blvd. Oriental

Initial Site
Wastewater System: Low Pressure Pipe
Long Term Acceptance Rate(GPD/SQFT): 0
Trench Width: 1.5 FT
Trench Spacing (OC): 10 FT
Trench Bottom From NGL: 0 IN
Mound Height: 18 IN
Septic Tank Volume: 1000 GAL
Pump Tank Volume: 1000 GAL

Repair Site
Wastewater System: Low Pressure Pipe
Long Term Acceptance Rate(GPD/SQFT): 0
Trench Width: 1.5 FT
Trench Spacing (OC): 10 FT
Trench Bottom From NGL: 0 IN
Mound Height: 18 IN
Septic Tank Volume: 1000 GAL
Pump Tank Volume: 1000 GAL

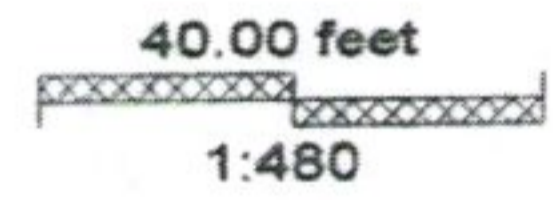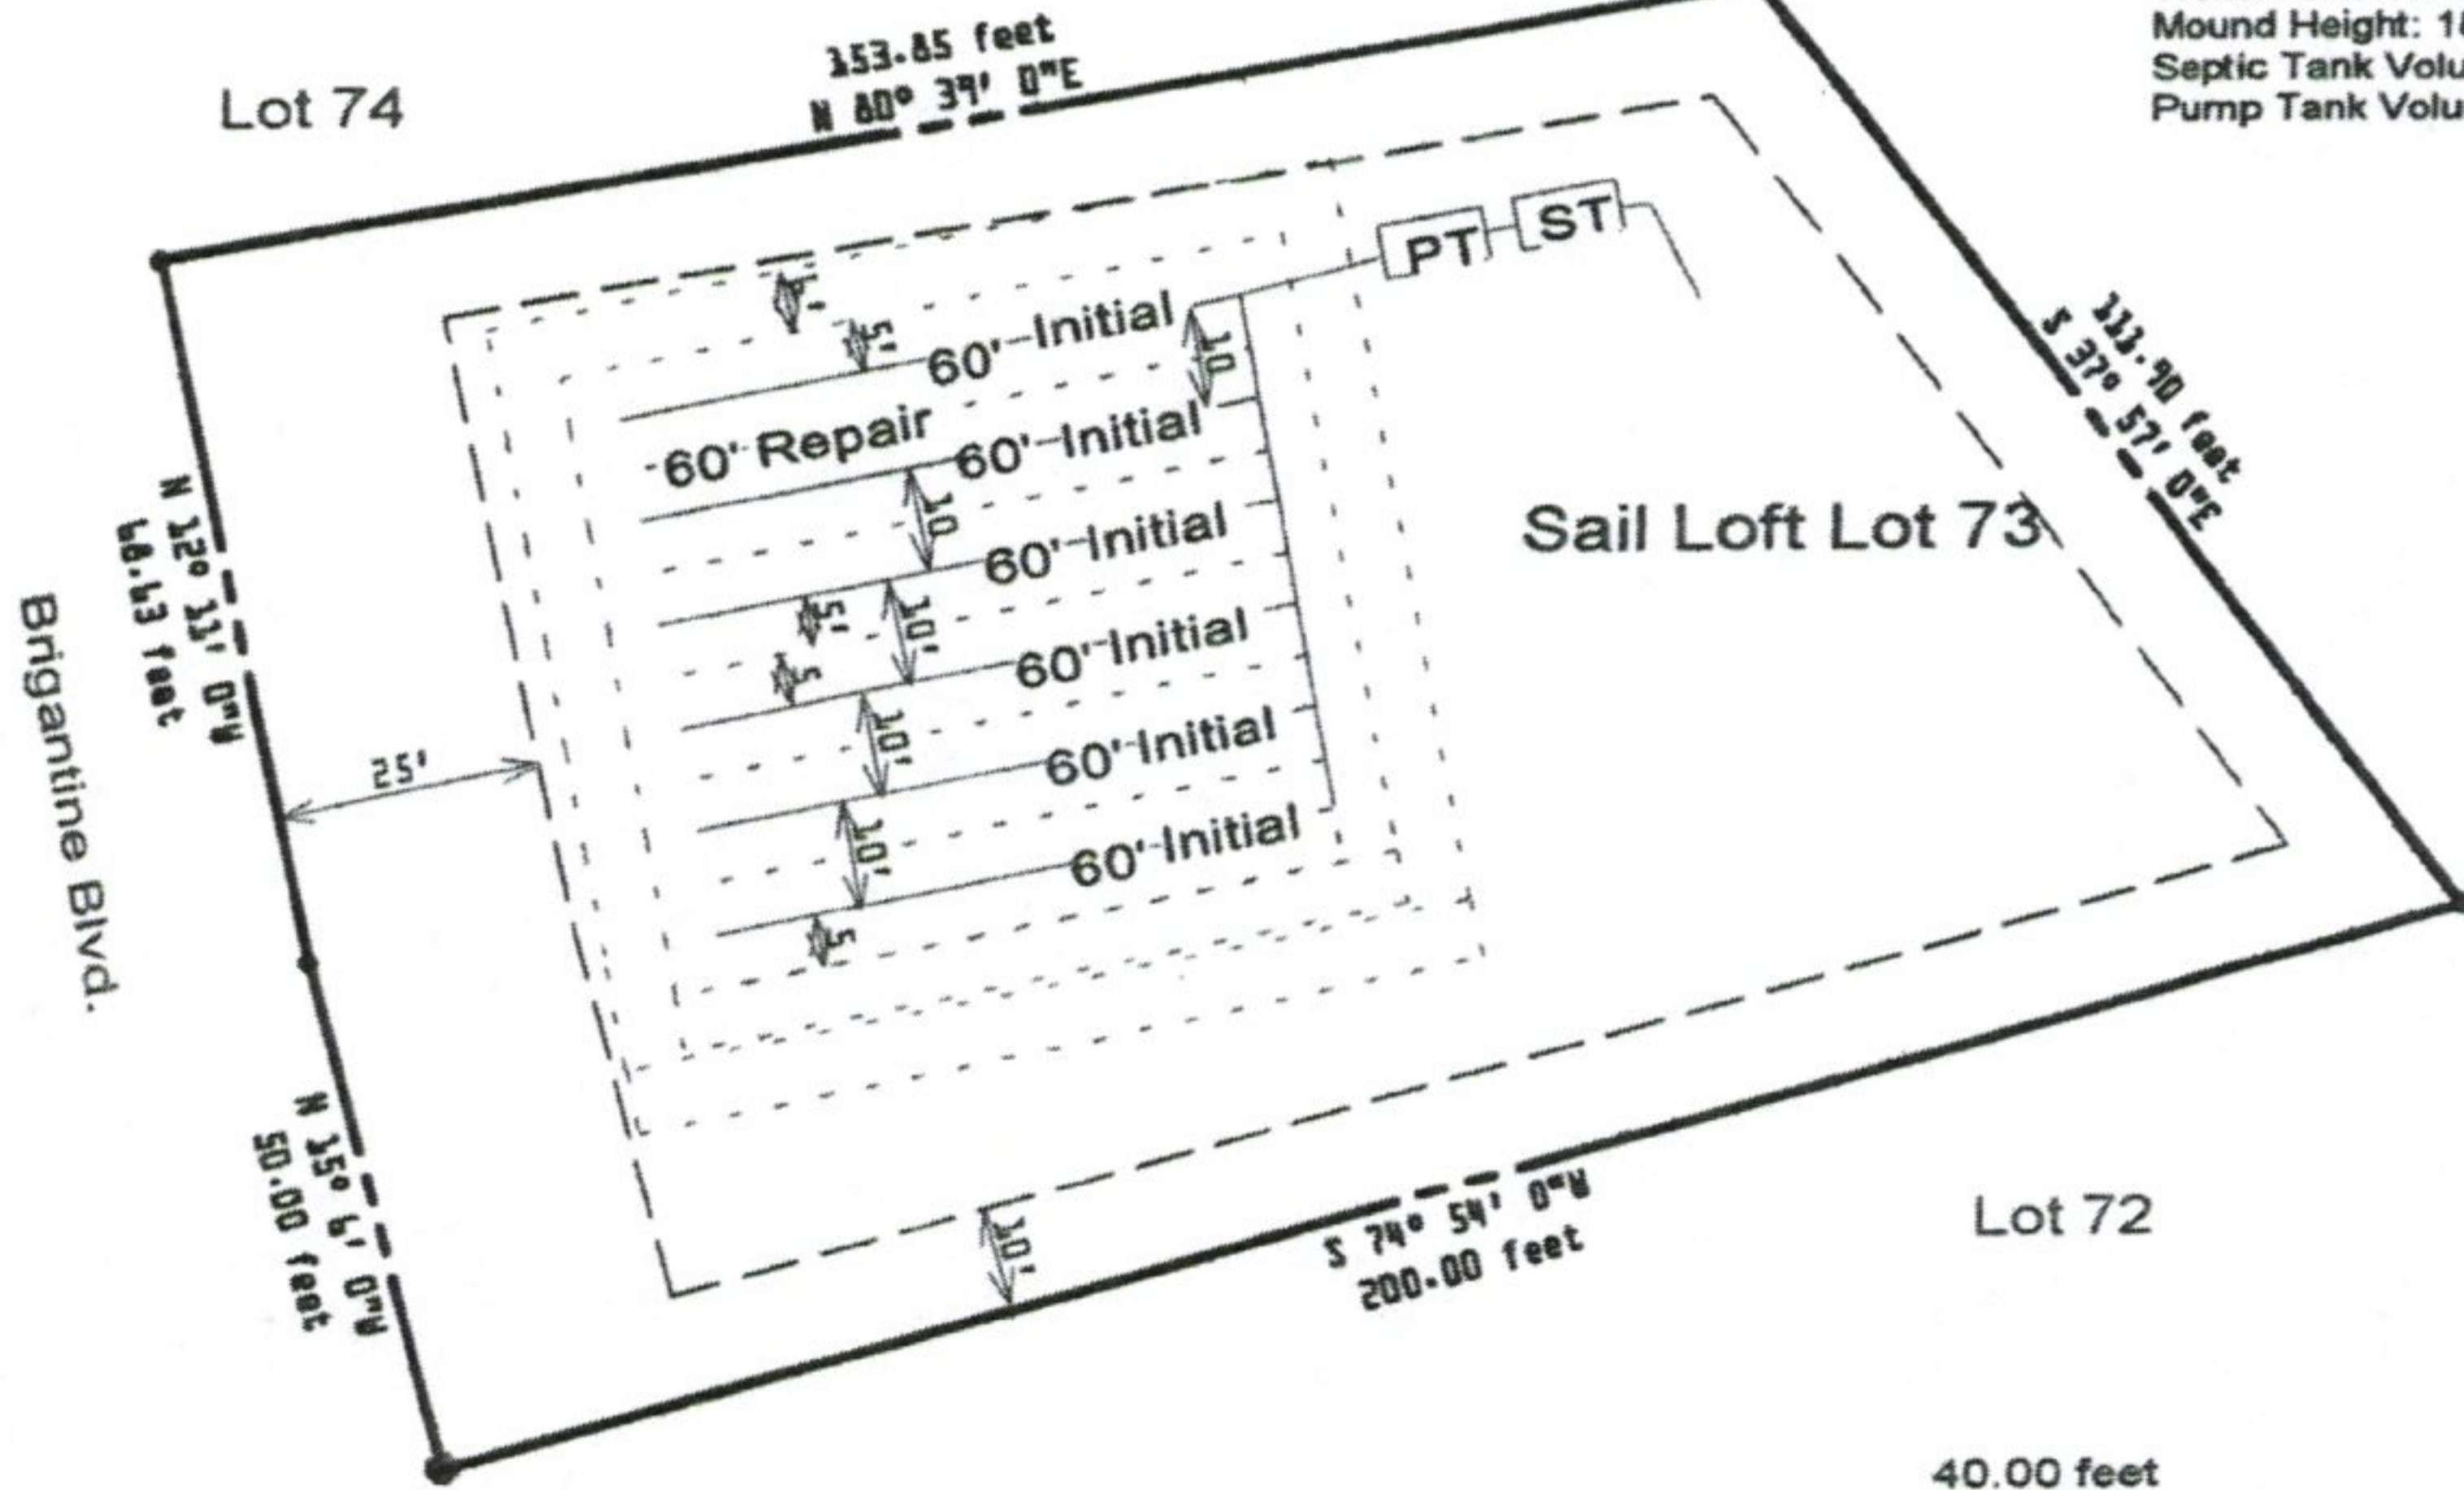

THE PAMLICO CO. HEALTH DEPT. RESERVES THE RIGHT TO REVOKE THIS PERMIT IF THE SITE IS ALTERED, INTENDED USE CHANGED, OR ANY INFORMATION IS FALSIFIED.

AN AUTHORIZATION TO CONSTRUCT MUST BE OBTAINED AND ALL FEES PAID PRIOR TO WASTEWATER SYSTEM INSTALLATION.

ANY CHANGES TO THIS PERMIT WILL REQUIRE A REDESIGN PERMIT AND SUBSEQUENT FEE.

Authorized Agent: Elizabeth Chagaris Date 7/20/2000
ELIZABETH A. CHAGARIS REHS

Eugene Maly 7/9/2024 - Expires 7/9/2029