



# WAYNE COUNTY

## DEPARTMENT OF PUBLIC HEALTH




WAYNE COUNTY  
NORTH CAROLINA

### Operation Permit

PIN: 103633469059 Permit Number: 23070104349  
 Subdivision or Road: Creeks Edge Lot #: 22 Section: \_\_\_\_\_  
 Specific System Installed: Chamber  
 Septic Tank Size: 1000 gallons Pump Tank Size: \_\_\_\_\_ gallons Trench Length: 4 (50'x3')  
 System Type: III GPD: 360 Number of Bedrooms: 3 Maximum Number of Occupants 6  
*Types V and CI systems expire in 5 years in accordance with Table Va. Owner must contact health department 6 months prior to expiration for permit renewal.*

SES Constructors Owner's Name System Installer D+W

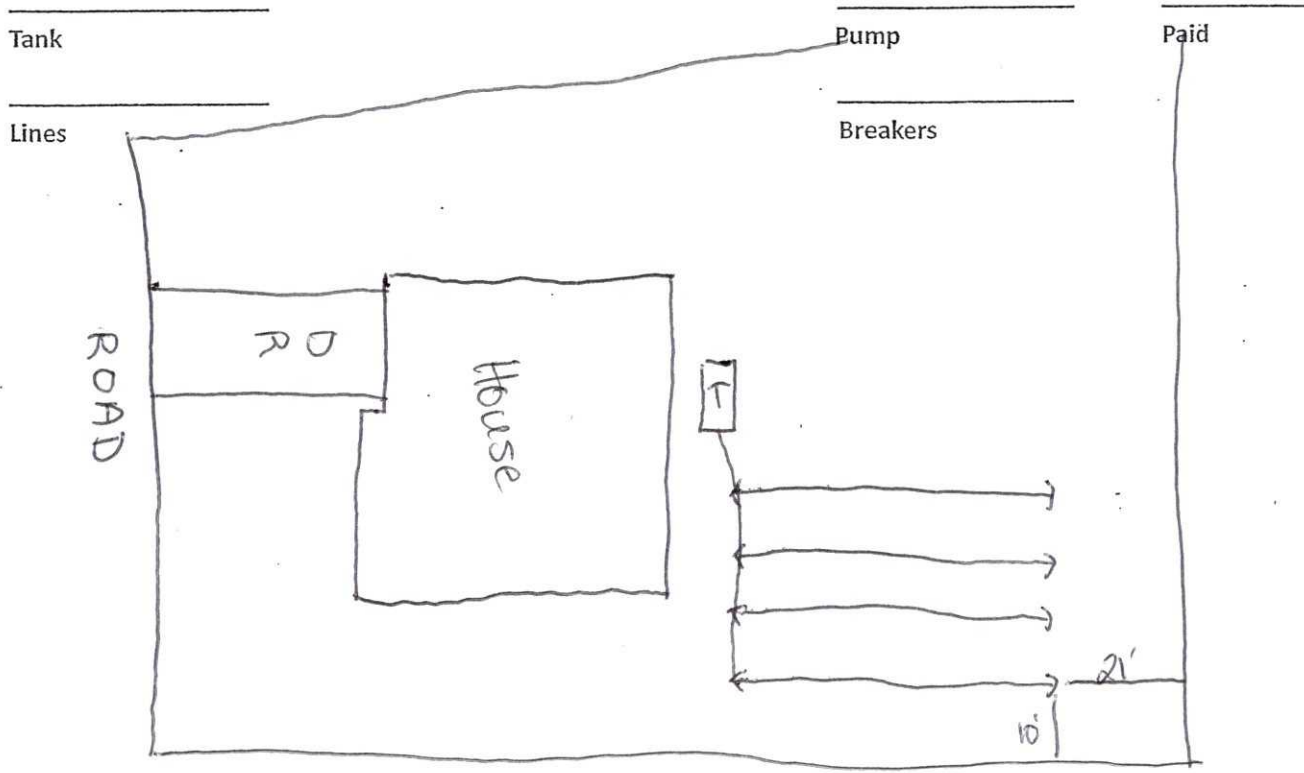

L. Morris-Chilton  
Authorized State Agent

12-3-24  
Date of Operation Permit Issuance

This system has been installed in compliance with applicable NC General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961
- II. Monitoring: As required by Rule .1941
- III. Maintenance: Ground absorption sewage treatment and disposal systems shall be checked, and the contents of the septic tank removed periodically from all compartments to ensure proper operation of system. Contents shall be pumped whenever solid levels are found to be more than 1/3 of the liquid depth of any compartment.