


**MOORE COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH SECTION
OPERATION PERMIT**

C2CE 5-8-07
5 BR System *gje*

Owner: Tony PRESICCI Address: 230 Red Fox Ridge
 Permit # _____ Receipt # _____ LRK# 20050147
 Installer: Don GARDY Telephone: _____
 Address: Cameron
 System Type: Pump To Gravel Maximum Design Flow: 600 (gallons/day)
 Wastewater Characteristics: DOMESTIC
 Septic Tank Capacity: 1000 1250 57 1250 (Gallons) Tank I.D. # _____
 Nitrification Line Dimensions: 4 (160' x 3')
 Effluent Distribution Device: DIRT. Box Gravel Depth: 12"
 Depth To: Top of Tanks: 4" (Inches) Trench Bottom 19" (Inches)

Diagram of Actual Installation: (Depict Property Boundaries, Structures, Driveways, Trees, Water Lines, Water Supplies, Etc.)

Scale: _____ Inch = _____ Feet.

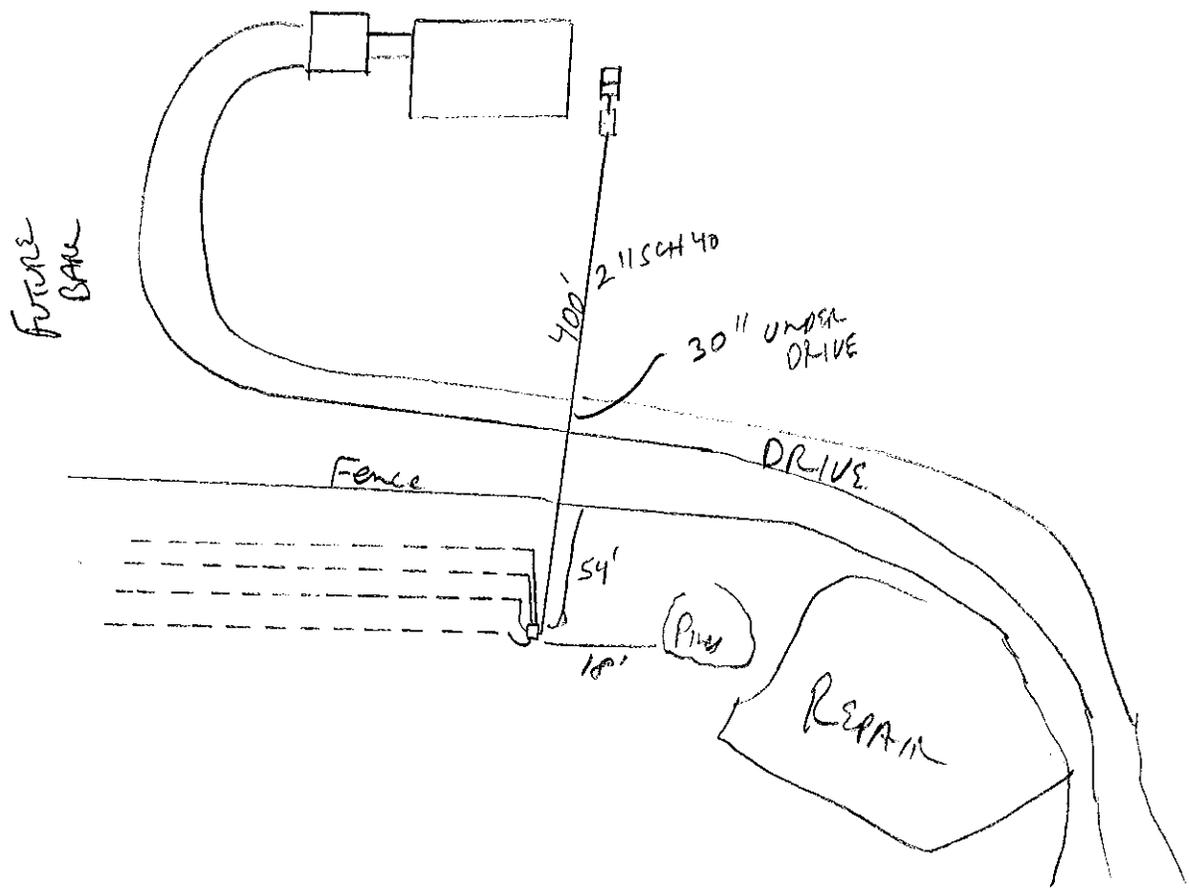

Red Fox Ridge

Comments and Conditions: _____
Lines & Tanks App 2-23-06 # of Attachments: _____
 Issued By: Tony PR Date: 5-7-07

FINAL APPROVAL OF THIS SYSTEM SHALL INDICATE THAT THE SYSTEM HAS BEEN INSTALLED IN ACCORDANCE WITH APPLICABLE PERMIT CONDITIONS, LAWS AND RULES, BUT IN NO WAY SHOULD BE TAKEN AS A GUARANTEE THAT THE SYSTEM WILL FUNCTION SATISFACTORILY FOR ANY GIVEN TIME.