

Aug. 24, 2017 1:01PM
ENVIRONMENTAL HEALTH DIVISION
CARTERET COUNTY HEALTH DEPARTMENT
COURTHOUSE SQUARE
BEAUFORT, NC 28516 (919) 728-8499

AFIUV
 Tom Steyer
 1 pg

No. 4972 P. 1
 OPERATION PERMIT # TUC0523
 IMPROVEMENT PERMIT # A-1820


OPERATION PERMIT
 SATISFACTORY EXISTING SYSTEM - AUTHORIZATION TO CONNECT

OWNER: Thomas & Jandra Wilson
 MAILING ADDRESS: 147 Bestman Rd.
 CITY, STATE, ZIP: Beaufort NC 28516 PHONE: _____
 TAX PARCEL: 649001960588 COPY OF ORIGINAL PERMIT AVAILABLE YES NO
 PROPERTY LOCATION: 153 Country Club Lane Beaufort Bk Y @ L331
 SYSTEM DESCRIPTION: Wetland Septic Tank 4 lines @ 50' lots 32+33 32
 DESIGN DAILY SEWAGE FLOW: 240 gpd BASED ON: 2 Bedrooms
(BEDROOMS, SEATS, PEOPLE, ETC.)
 WATER SOURCE: Well
 ADDITIONAL REQUIREMENTS: Pump septic tank every 3 to 5 years

This Operation Permit shall be valid as long as the sanitary sewage system is in compliance with Article 11 of G. S. Chapter 130A Laws and Rules for Sewage Treatment and Disposal Systems (15 NCAC 18A.1900) of all conditions of this permit, including the items specified below.

1. The sewage collection, treatment and disposal system shall be operated and maintained at all times to prevent public health hazards, to prevent seepage or discharge of sewage effluent to the surface of the ground or surface waters, and to prevent the direct discharge of effluent to the ground water.
2. In event system fails, repair must be permitted and installed within thirty (30) days.
3. This permit does not constitute a warranty and does not negate or supersede any zoning restriction or restricted covenants in the chain of title. It is the responsibility of the permittee to determine whether or not such restrictions apply.
4. This permit is transferable and is valid only with respect to the facilities described herein and the specified design flow. Prior to any expansions or revisions a revised permit shall be obtained from the Carteret County Health Department.
5. Septic tank sludge accumulation shall be evaluated every three (3) years and pumped when sludge level is found to be 12" or greater in depth.
6. Structure shall be placed so that gravity flow is achieved or pump system shall be required.
7. Do not park, pave, drive or build over any part of septic system or repair area.
8. Maintain a minimum 5 feet between any foundation and any part of septic system or repair area.

SITE PLAN

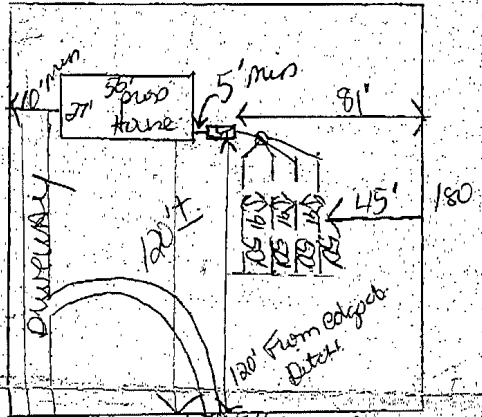

*NO sign of failure during inspection

The Carteret County Health Department reserves the right to make inspections of these sewage collection, treatment, and disposal facilities as necessary to assure compliance with the provisions of this Operations Permit and the North Carolina Laws and Rules for Sanitary Sewage Collection, Treatment and Disposal.

ISSUED: 5/14 @ 2013
 BY: Heather M. Jones, P.E.
 ENVIRONMENTAL HEALTH SPECIALIST