

ONslow COUNTY
HEALTH DEPT.

OPERATIONS PERMIT
(GS 130A-337)

Permit N^o 5431 ³⁰⁰
System Type: II

Owner: Woodcreek Estates
Address: Lot #6 sect. I
Location: Queens Creek Rd., across from
Tom's Steak and Ale
SR # 1509

FINAL PLOT/REMARKS
5-27-03
STB 1020
STB-11

THIS DOES NOT CONSTITUTE A
WARRANTY OR GUARANTEE.

Installed By: Roy Hea
Signed By: [Signature]
Date: 7-30-03

ONslow COUNTY
HEALTH DEPT.

CONSTRUCTION AUTHORIZATION
(GS 130A-336)

Permit N^o 5431
Fee: —

THIS AUTHORIZATION FOR WASTEWATER SYSTEM CONSTRUCTION SHALL
BE VALID FOR A PERIOD EQUAL TO THE PERIOD OF VALIDITY OF
THE IMPROVEMENT PERMIT, NOT TO EXCEED 5 YEARS.

Owner: Woodcreek Estates
Address: Lot #6 sect. I
Location: Queens Creek Rd., across from
Tom's Steak and Ale
SR # 1509
System type/description: Conventional LTAR .6 gpd/sq. ft.
Septic tank size: ≥ 900 gallons
Nitrification area: 600 sq. ft. 200 lin. ft.
No. of lines: 3 Line lengths: 67'
Trench bottom depth: 24"
(SEE ATTACHED PAGES 1 - 1 of 1 FOR ADDITIONAL PERMIT CONDITIONS)
Signed: Wade J. Payne Date: 12-4-98

ONslow COUNTY
HEALTH DEPT.

IMPROVEMENT PERMIT
(GS 130A-336)

Permit N^o 5431
Fee: 100⁰⁰

- Valid for 5 years from date of issuance
- Valid without expiration

Owner: Woodcreek Estates
Address: Lot #6 sect. I
Location: Queens Creek Rd., across from
Tom's Steak and Ale
SR # 1509
System type/description: Conventional LTAR .6 gpd/sq. ft.
Facility/Daily design flow:
Water supply: On-site well ___ Comm. well ___ Public Other ___
(SEE ATTACHED PAGES 1 - 1 of 1 FOR ADDITIONAL PERMIT CONDITIONS)
Signed: Wade J. Payne Date: 12-4-98


NOTE: Permit is subject to revocation if site plans or intended use change.

PLOT PLAN

Owner: Woodcreek Estates
 Address: Lot # 6
 Location: Queens Creek Rd.
N.C.S.R. 1509
Across from Tom's STEAK & ALE

Additional Permit Conditions:

- 1) Do not park or drive on any part of system or repair area.
- 2) Nitrification trench aggregate shall covered with straw, untreated paper or other approved materials prior to final cover/backfilling.
- 3) Do not install system under wet conditions.
- 4) Adhere to minimum set back requirements as stated in Rule .1950 and .1951 of NC Laws and Rules for Sewage Treatment and Disposal System. (Article 11, G.S. Chapter 130A). Unless otherwise indicated in this permit.
- 5) Rock used in soil absorption systems shall be clean, washed gravel or crushed stone and graded or size in accordance with size numbers 3, 4, 5, 57, or 6 of ASTM D-448 (standard sizes of coarse aggregate) which is hereby adopted by reference in accordance with G.S. 150 B-14 (c). Documentation of aggregate size shall be available upon request.

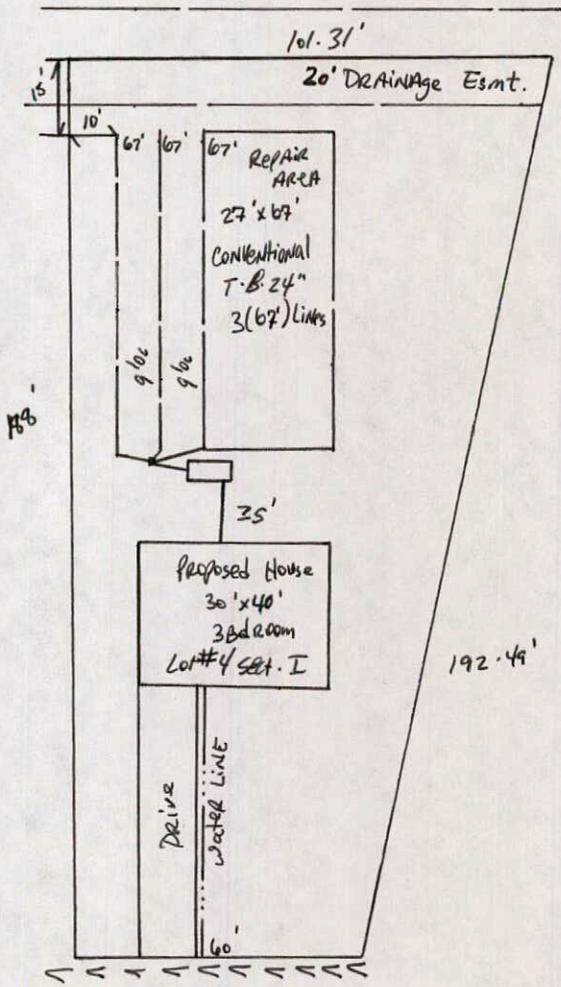

~1"=40'

6) CONVENTIONAL SYSTEM: 600 sq. ft.
200 L.F.
3(67') LINES.

7) Trench bottoms 24" at deepest point.

N.C.S.R. 1509
 QUEENS CREEK ROAD