

Permit: 330681

PIN: 017997008732750000



Camden

Owner:
SICARIO PROPERTIES
P.O. BOX 176
MOYOCK, NC 27958

Applicant:
SICARIO PROPERTIES
P.O. BOX 176
MOYOCK, NC 27958


LTAR: 0.400
Water: PUBLIC
TYPE II C.
SINGLE FAMILY
GPD: 480

Location:
145 BEECHNUT AVE.

* HOUSE PAD MUST BE
FILLED HIGHER THAN
SEWER GRADE!

* SEWER MUST BE AT
LEAST 10 FT FROM
↳ WATER LINES
↳ PROPOSED LINES

RESERVE
AREA




D
R
I
V
E

* CARRY ELEVATION FROM
RIDGE AREA, CENTER OF LOT,
ACROSS DRAINFIELD.


* EXCAVATE S LINES 80 FT
LONG TO A DEPTH OF 12 IN
INSTALL 12 IN DRAINFIELD
AND COVER WITH 6 IN OF
IMPORTED FILL

* CHANGE
IN LAYOUT!

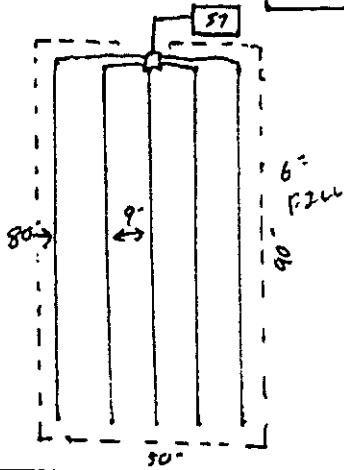

145 BEECHNUT DRIVE

Authorized Agent:


REWS 1911
Swinney, David

Date: 10/02/2020

Approved:


REWS 1911

Date: 1/20/2021

ALBEMARLE REGIONAL HEALTH SERVICES
Final Inspection

Name: SICARIO PROPERTIES

Permit #: 330681

System Installer: TREVOR OLD

Manufacturer: NRM-1000/STB-830

Septic Tank Serial: 830

Gallons: 1,000


Drain Field Type: EZFLOW EZ 1203H-GEO

Distribution Type: GRAVITY - PARALLEL (eq. d-box)

Number of Nitrification Lines: 6 X 60 ft

Total Trench Length: 360

Comments: _____

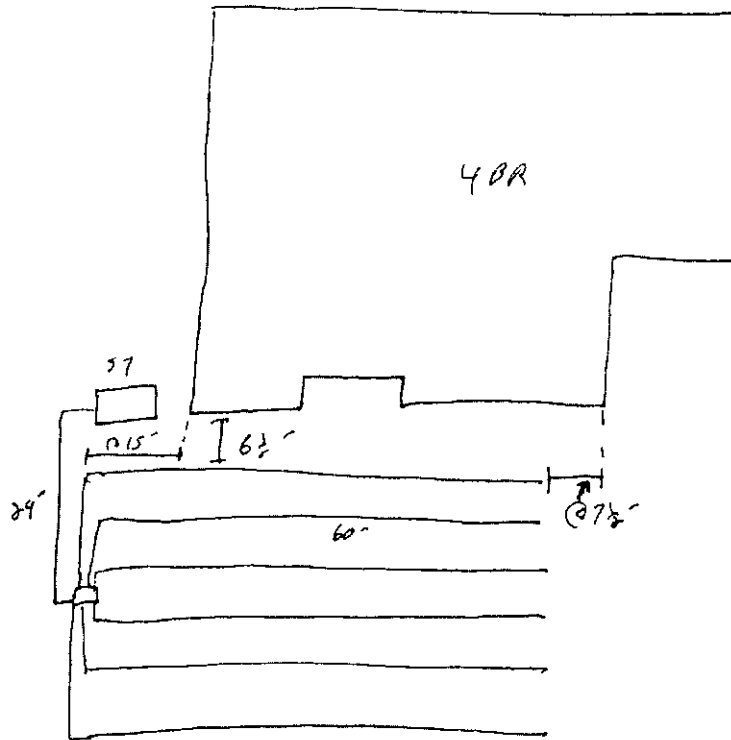

* WATER
LINE MUST
BE 10 FT
FROM ANY
SEPTIC!

EHS: [Signature] REMS 1911
Swinney, David

Date: 01/20/2021