


Albemarle Regional Health Services

Operation Permit Gates

PIN _____ Permit Number 405727
 Specific System Installed Backfill
 System Type: V GPD: 480 Number of Bedrooms: 4 Maximum number of occupants: 8
 Types V and VI systems expire in 5 years in Accordance With Table Va. Owner must contact health department 6 months prior to expiration for permit renewal.
 Owner's Name Monte Crowl System Installer Giles Russell
El Evans Date of Operation Permit Issuance 6-4-24
 Authorized State Agent _____

This system has been installed in compliance with applicable NC General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

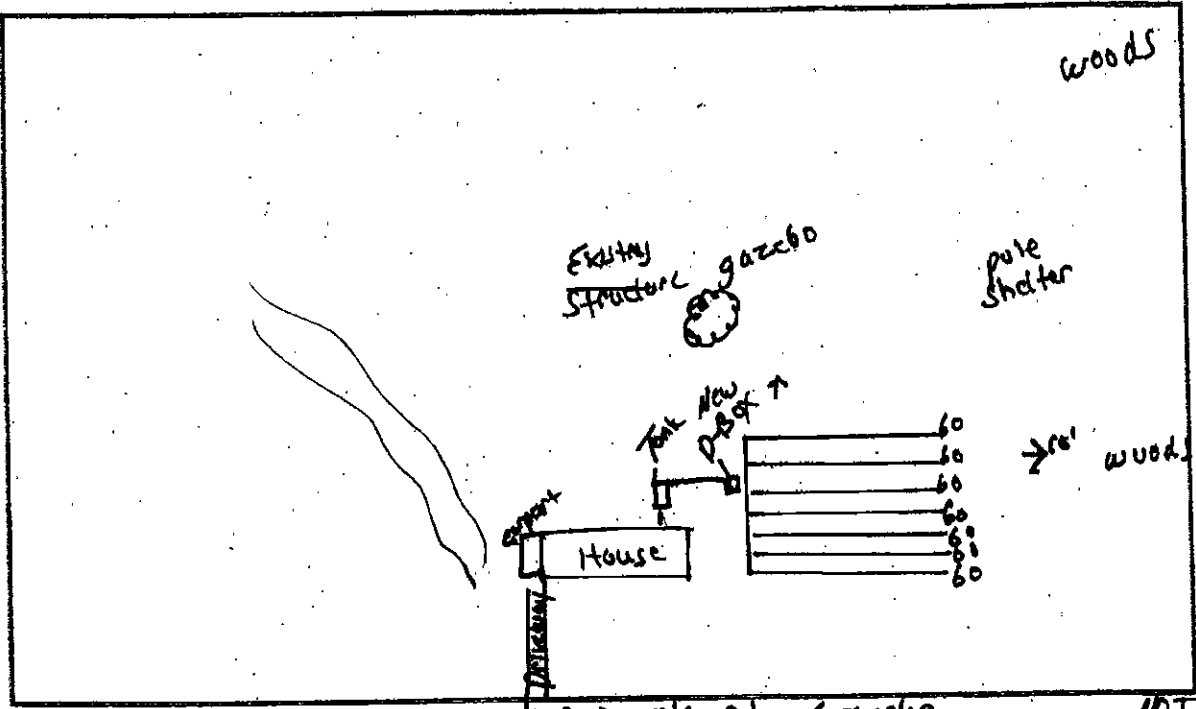

NOT TO Scale

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: Ground absorption sewage treatment and disposal systems shall be checked, and the contents of the septic tank removed, periodically from all compartments, to ensure proper operation of the system. The contents shall be pumped whenever the solids level is found to be more than 1/3 of the liquid depth in any compartment.

Other: NA
 Subsurface system operator required? Yes ___ No ___

If yes, see attached sheet for additional operation conditions, maintenance and reporting.

- IV. Operation: NA
- V. Other: NA

Repair

405727

CONSTRUCTION AUTHORIZATION

(Requirement for Building Permits)

The construction and installation requirements of Rules 1950, 1952, 1954, 1955, 1956, 1957, 1958, and 1959 are incorporated by reference into this permit and shall be met. Systems shall be installed in accordance with the attached system layout.

ISSUED TO: Monte Crowl

PROPERTY LOCATION: 758 Daniels Rd
Corapeake, NC 27926

Facility Type: House New Expansion Repair
 Basement? Yes No Basement Fixtures? Yes No
 Type of Wastewater System** Existing (Initial) Wastewater Flow: 480 GPD
 See note below, if applicable Backfill (Repair)

Installation Requirements/Conditions

Septic Tank Size: Ex 4/4 gallons
 Pump Tank Size: N/A gallons
 Pump Requirements: N/A TDH vs. N/A GPM

Total Trench Length: New 7-60' feet
 Trenches shall be installed on contour at a
 Maximum Trench Depth of: 18 inches
 (Trench bottoms shall be level to $\pm 1/4"$
 in all directions)
 Aggregate Depth: 6 inches above pipe 6 inches below pipe 12 inches total

Trench Spacing: 9 Feet on Center
 Soil Cover: 6 inches
 (Maximum soil cover shall not exceed
 36" above the trench bottom)

Conditions: 1) Knock hole in side of tank 2) Install PVC Sockey Tee with Filter.
New D-Box & 7-60' Et Drain line Backfill. Dip Out (lay 60" inches)


If applicable:
 I understand the system type specified is different from the type specified on the application. I accept the specifications of this permit.

Owner / Legal Representative Signature: _____ Date: _____

This Construction Authorization is subject to revocation if the site plan, plat, or the intended use changes. The Construction Authorization shall not be transferred when there is a change in ownership of the site. This Construction Authorization is subject to compliance with the provisions of the Laws and Rules for Sewage Treatment and Disposal and to the conditions of this permit.

Authorized State Agent: El Eans Date of Issuance: 2-8-24 See attached site sketch.

Construction Authorization Expiration Date: 5/30/25 PAGE 1 OF _____

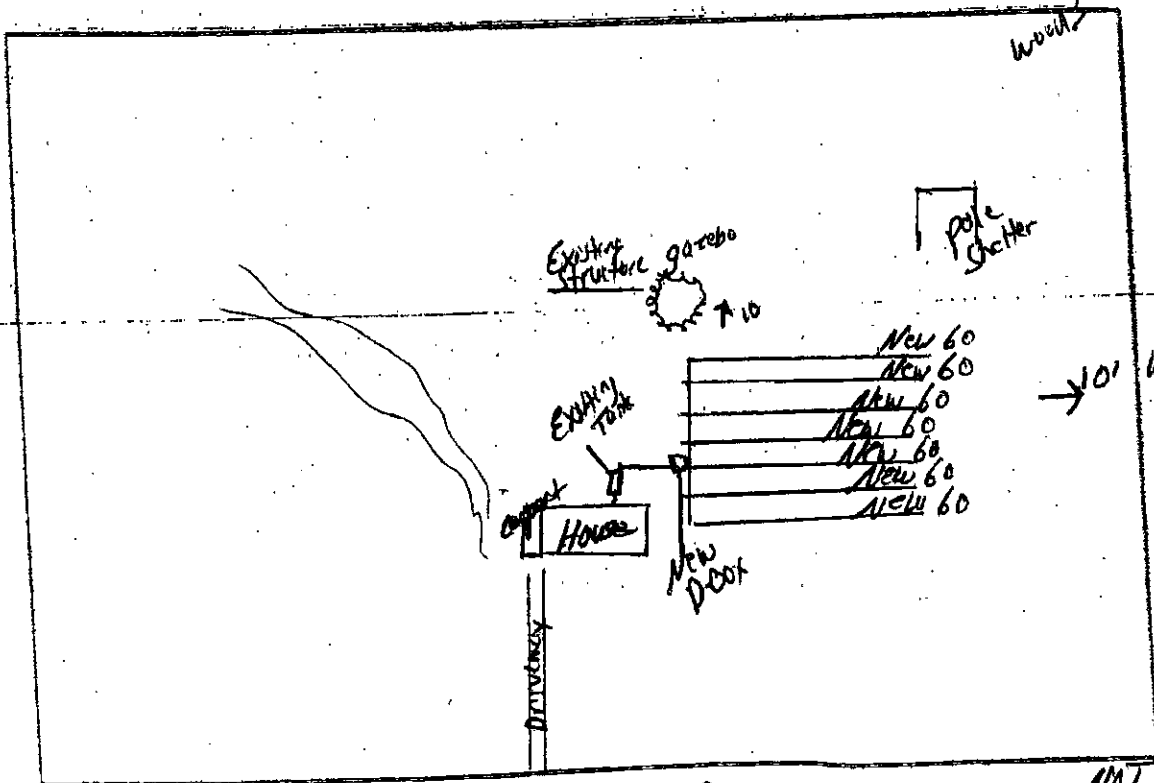

Daniels Rd

NOT TO Scale

THE AUTHORIZATION FOR WASTEWATER SYSTEM CONSTRUCTION (CONSTRUCTION AUTHORIZATION) SHALL BE VALID FOR A PERIOD OF 60 MONTHS AFTER THE DATE OF ISSUANCE.

The issuance of the Improvement Permit or Construction Authorization in no way guarantees the issuance of other local, state or federal permits.

Wastewater systems and water supplies shall meet state and/or local regulations.

NO CHANGES IN THIS DOCUMENT ARE ALLOWED UNLESS PRIOR APPROVAL IS OBTAINED FROM THE HEALTH DEPARTMENT. IF THE INFORMATION SUBMITTED IN THE APPLICATION FOR THE IMPROVEMENT PERMIT OR CONSTRUCTION AUTHORIZATION IS FOUND TO BE INCORRECT, CHANGED, OR IF THE SITE IS ALTERED, THE IMPROVEMENT PERMIT OR CONSTRUCTION AUTHORIZATION SHALL BECOME INVALID AND MAY BE SUSPENDED OR REVOKED.

When contacting the Environmental Health offices concerning this document, be sure to know the application number. The number must be used in all inquiries and inspection requests.

The Environmental Health Staff can be located at the following telephone numbers between 8:00 a.m. and 8:30 a.m., Monday through Friday, except holidays. The office telephone numbers are:

Camden.....	(252) 338-4460	Pasquotank.....	(252) 338-4490
Chowan.....	(252) 482-1199	Perquimans.....	(252) 426-2100
Currituck.....	(252) 232-6603	Bertie.....	(252) 794-5303
Hertford.....	(252) 862-4054	Gates.....	(252) 357-1380

Wastewater system installers are responsible for notifying the Environmental Health offices for final inspections. Wastewater systems must be inspected and approved by a representative of the Environmental Health staff before any portion of the installation is covered and/or used.

ISSUANCE OF AN OPERATIONS PERMIT SHALL INDICATE THE WASTEWATER SYSTEM HAS BEEN CONSTRUCTED TO THE STANDARDS SET FORTH IN THE REGULATIONS, BUT SHALL IN NO WAY BE TAKEN AS A GUARANTEE THAT THE SYSTEM WILL FUNCTION SATISFACTORILY FOR ANY GIVEN PERIOD OF TIME.

Wastewater systems shall be operated and maintained in such a manner as to not create a public health hazard. Septic tanks should be pumped out every 3 to 5 years by a permitted pumpout. Please conserve water!

Minimum Distances*

Ground Absorption Wastewater Systems to:

1. Private water supply sources 100'
2. Public water supply sources 100'
3. Coastal waters (mean high water mark) 50'
4. Streams, canals, marshes, or other surface waters 50'
5. Lakes and ponds 50'
6. Groundwater lowering ditches and devices 25'
7. Embankments or cuts 15'
8. Swimming pools 15'
9. Property Lines 10'
10. Water lines 10'
11. Building foundations 5'

Private Walls to:

1. Wastewater systems 100'
2. Building foundations 25'
3. Surface waters 50'
4. Property lines 10'

*Variances can be given on some distances; please call the Environmental Health office if you feel a variance is necessary.

Septic tanks, nitrification fields, and repair areas shall not be located under paved areas or areas subject to vehicular traffic.

Does the site contain any jurisdictional wetlands?	<input type="checkbox"/>	<input checked="" type="checkbox"/>
Does the site contain any wastewater systems?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Is any wastewater going to be generated on the site other than domestic sewage?	<input type="checkbox"/>	<input checked="" type="checkbox"/>
Are there any easements or right of ways on this property?	<input type="checkbox"/>	<input checked="" type="checkbox"/>
Is this facility subject to approval by another public agency?	<input type="checkbox"/>	<input checked="" type="checkbox"/>
Are there any wells, springs, or existing water lines on this property?	<input type="checkbox"/>	<input checked="" type="checkbox"/>


INITIAL

- J 1. THE APPLICANT SHALL MARK THE SITE AND MAKE THE SITE ACCESSIBLE FOR A SITE EVALUATION.
- D 2. A \$60.00 REVISIT FEE WILL BE CHARGED IF THE PROPERTY IS UNIDENTIFIABLE OR INACCESSIBLE DUE TO VEGETATIVE OVERGROWTH, LOCKED GATES, LOOSE DOGS, ETC.
- D 3. IF THE INFORMATION SUBMITTED BY THE APPLICANT IS FOUND TO BE INCORRECT, OR IF THE SITE AND SOIL CONDITIONS ARE ALTERED, ANY IMPROVEMENT PERMIT SHALL BECOME INVALID.

PLEASE ALLOW UP TO 2 WEEKS FOR COMPLETION.

I have read this application and certify that the information provided herein is true, complete, and correct. Authorized county and state officials are granted right of entry to the property to conduct the services requested.

Date: 2/6/24

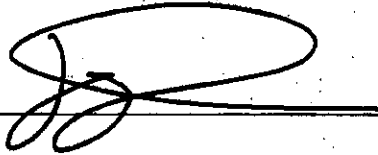Owner or Agent Signature: 

Mail To: ARHS Environmental Health; P.O. Box 189; Elizabeth City, NC 27907

Bertie Co. P: (252) 794-5303 F: (252) 794-5361	Camden Co. P: (252) 338-4460 F: (252) 338-4475	Chowan Co. P: (252) 482-1199 F: (252) 482-6020	Currituck Co. P: (252) 232-6603 F: (252) 232-1912	Gates Co. P: (252) 357-1380 F: (252) 357-2251	Hertford Co. P: (252) 862-4054 F: (252) 862-4263	Pasquotank Co. P: (252) 338-4490 F: (252) 337-7921	Perquimans Co. P: (252) 426-2100 F: (252) 426-2104
---	---	---	--	--	---	---	---