

**ALBEMARLE REGIONAL HEALTH SERVICES
ENVIRONMENTAL HEALTH SECTION INFORMATION REQUEST FORM**

**THERE IS NO GUARANTEE A PERMIT WILL BE FOUND BASED ON THE
INFORMATION YOU HAVE PROVIDED. Requestor's Signature**

Karey A. Priest Muller
dotloop verified
02/27/25 6:58 AM EDT
5175-0293-0241-0295

REQUESTORS NAME: Karey Priest Muller

COMPANY: Water Street Real Estate Group

MAILING ADDRESS: 102N Water Street, Elizabeth City, NC 27909

PHONE NUMBER: 757-771-6821 FAX NUMBER _____

Email address: karey@waterstreetgrp.com

**PLEASE PROVIDE ALL THE INFORMATION BELOW FOR THE REQUESTED
PROPERTY**

COUNTY Pasquotank

PHYSICAL ADDRESS OF PROPERTY 207 DOGWOOD TRAIL, Elizabeth City, NC

LOT # _____ BLOCK # _____ PHASE _____ SECTION _____

SUBDIVISION _____

PARCEL IDENTIFICATION NUMBER 891504835110

CURRENT OWNER BELLAMY, WESLEY M

PREVIOUS OWNER(S) _____

INFORMATION REQUESTED: _____ COPY OF SITE EVALUATION

COPY OF PERMIT _____ COPY OF SITE PLAN/SURVEY

_____ SLEEPING CAPACITY & NUMBER OF BEDROOMS APPROVED

**ONCE THIS FORM IS COMPLETED PLEASE FAX TO THE APPROPRIATE COUNTY
OFFICE . Fax Numbers for County Offices are below.**

Bertie 252-794-5361 Camden 252-338-4475 Chowan 252-482-6020
Currituck 252-232-6605 Gates 252-357-2251 Pasquotank 252-337-7921
Perquimans 252-426-2104

Permit: 47388

ALBEMARLE REGIONAL HEALTH SERVICES
Partners in Public Health

Pasquotank


PIN: 891504835110

Owner
BELLAMY, WESLEY
207 DOGWOOD TRAIL
ELIZABETH CITY, NC 27909

Applicant
BELLAMY, WESLEY
207 DOGWOOD TRAIL
ELIZABETH CITY, NC 27909

LTAR: 0.3
Water: Well
Type II
Residential
GPD: 140

Location: 207 DOGWOOD TRAIL

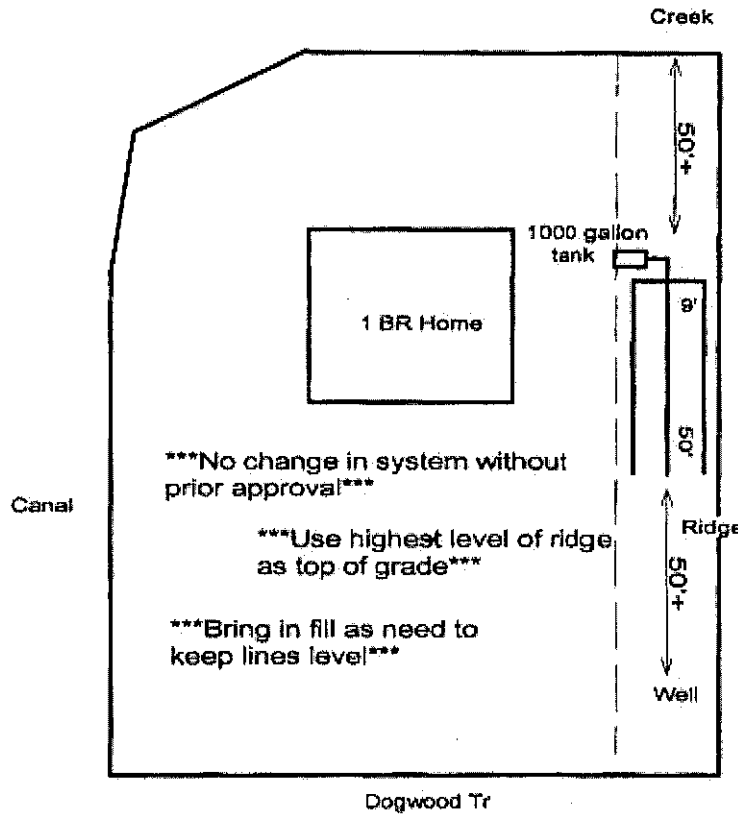

Install tank so that top of lines are no more than six inches below the highest original grade of the ridge. Use fill as needed to keep lines level with 6 inches of cover. Excavate 3 trenches 50' long, 3' wide, on 9' centers, and 18 inches below top of grade. Install 12 inches of gravel and pipe. Grade and landscape for proper runoff to surface water.

Authorized Agent:

Wesley Nixon

Date: 07/23/2013

Approved:


Date: 8-7-13

ALBEMARLE REGIONAL HEALTH SERVICES
Final Inspection

Name: BELLAMY, WESLEY

Permit #: 47388

Drain Field Type: In Fill
System Installer: Stacey Stokley
Septic Tank Serial: STB-830
Gallons: 1000
Pump Tank Serial:
Sanitary Tee/Filter: Pass
Conveyance Pipe: Pass
Baffle Wall: Pass
Distribution Box Outlets Level: Pass
Nitrification Lines: Pass
Number of Nitrification Lines: 3
Comments: 3-50's

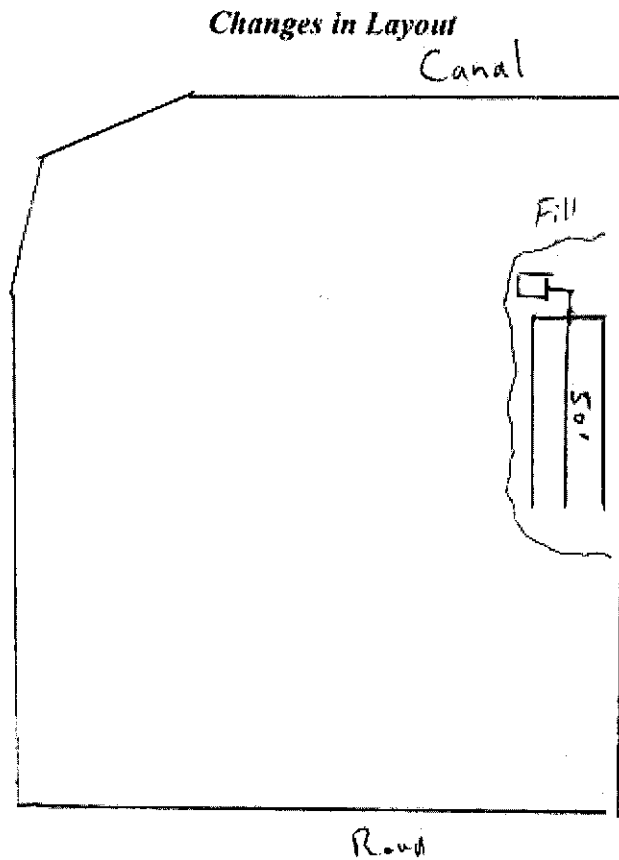

EHS


Wesley Nixon

Date: 08/07/2013