

BRUNSWICK COUNTY HEALTH DEPARTMENT

DATE REC:

FILE NO.: **2022076612**

ZONING:

Guy Auger

157KF00302

REC. FROM

AMT. PAID

TAX PARCEL

800 Joseph Willetts Dr SE

Winnabow

NC

28479

9103673426

ADDRESS

CITY

STATE

ZIP CODE

PHONE

AUGER GUY RAYMOND

CURRENT PROPERTY OWNER

LOT

BLOCK

SECTION

PROPERTY LOCATED TOWN/CITY/AREA:

BRUNSWICK COUNTY

SUBDIVISION:

BOILING SPRING LAKES

DIRECTIONS: **87 to Fifty Lakes Dr to left on Pinecrest, left on Bayside**

AUTHORIZATION FOR WASTEWATER CONSTRUCTION PERMIT

NEW: REVISION: _____ RELOCATION: _____ REPAIR: _____

Design Flow: 240 gpd Septic Tank Size: 900 gal Type: IIA

No. Bedrooms: 2 No. occupants/employees 4 Max 3-G Polystyrene

Trench/Bed Bottom Depth: 18 Inches:

No. Lines: 5 Length Each: 24' Bed Dimensions: 15' x 24'

Fill Check: -NA- Date Approved: -NA- Authorized Agent

See the attached Site Plan for the wastewater system location

PERMIT ISSUE DATE: 3/2/2022 Permit Expiration Date: 3/2/2027

Authorized Agent: Dustin S. Registration: 2816

NOTE: PERMIT IS SUBJECT TO REVOCATION IF SITE PLANS OR THE INTENDED USE CHANGES.

NOTES

1. Septic Tank shall have an approved effluent filter and access devices as applicable.
2. Maintain all setbacks distances for septic tank systems and wells.
3. All components of the septic systems shall be located 100 feet from well.
4. An "Accepted" system may be used in the place of a "conventional" system.

* Maintain Gravity Flow to Septic System

* Maintain all Setbacks "See Attached"

* Keep all parts of Septic System 50' to any Wells

* If any questions Contact BCHS at 910-253-2150

Waste Water System Installer: David Inman Date: 7/14/2022

Comments: (tank info/ barrier approved) FPS-1020, STB-11, 3-25-22

Rock: _____ Polystyrene Aggregate ✓ E21703-H6 Chamber: _____ Other: _____

OPERATION PERMIT: [Signature] Date: 7/14/2022

Authorized Agent Signature

Actions of local health department representatives or the State engaged in the evaluation and determination of measures required to effect compliance with the applicable laws and rules shall in no way be taken as a warranty that sewage treatment and disposal systems approved and permitted will function in a satisfactory manner for any given period of time. This issuance of its permit does not preclude the Permittee from complying with any and all statutes, rules and regulations or ordinances which may be imposed by other government agencies (local state, and federal) which have jurisdiction.



Brunswick County Environmental Health Services
Onsite Wastewater Information

BCHS File Number: 2022076612
Tax Parcel: 157KF00302



Site Plan For (Check One):

Improvement Permit

Fill Plan

Authorization to Construct Permit


Well Permit

Proposal

Existing System Reuse

Other: _____

SITE PLAN ONLY. THIS IS NOT A PERMIT

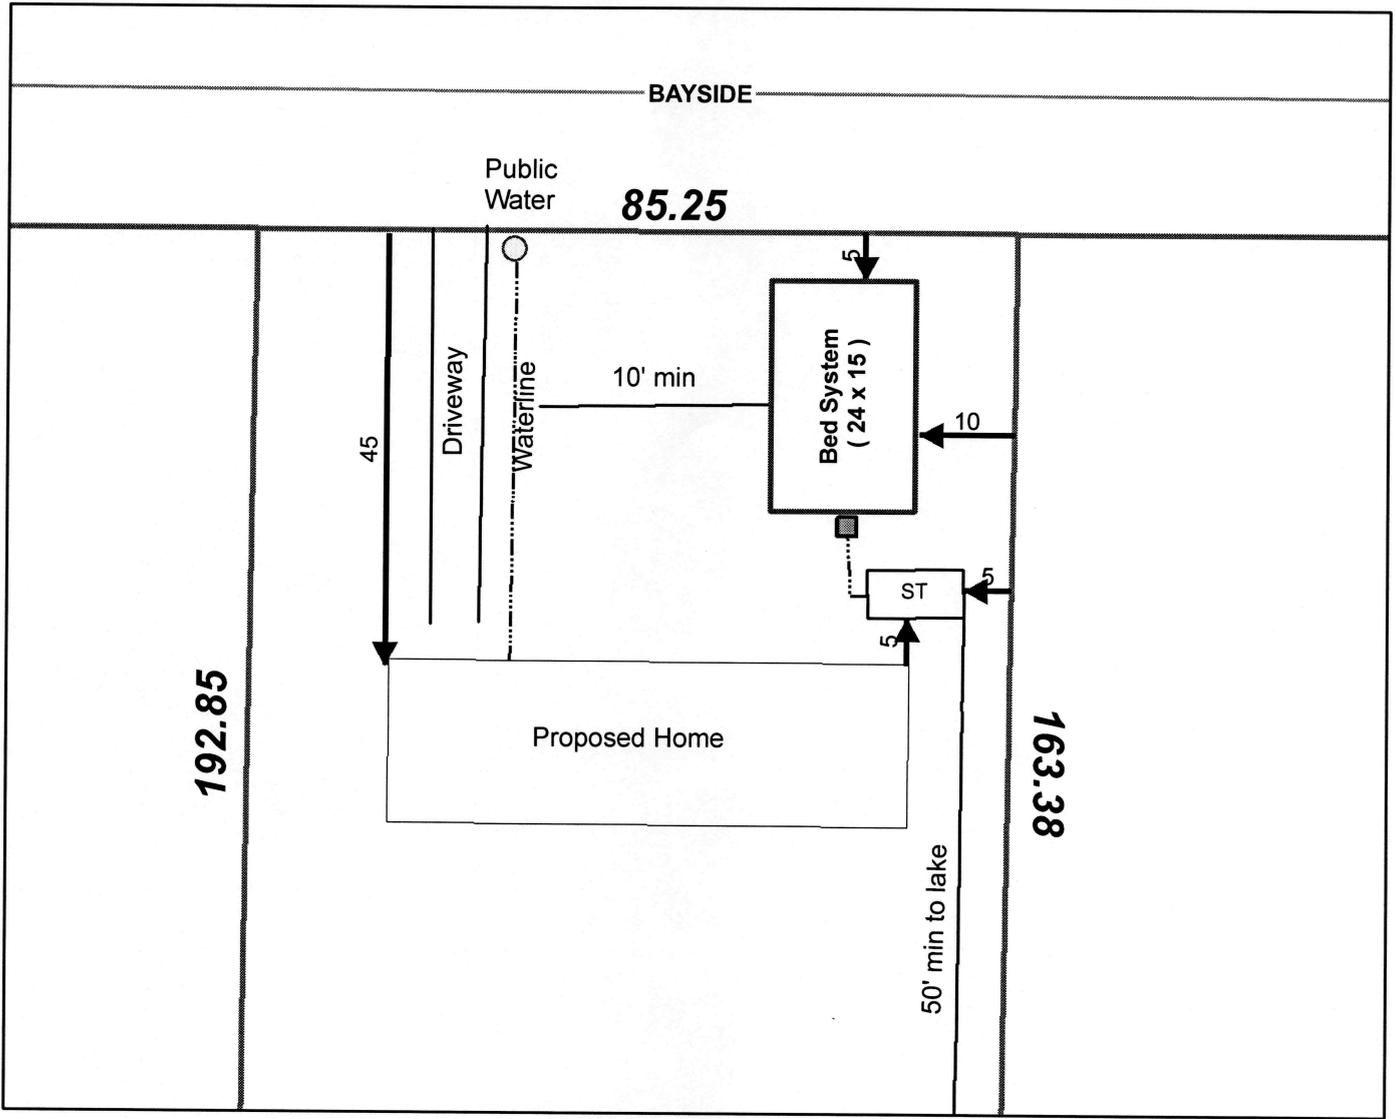

25 12.5 0 25 Feet

1 inch = 20 feet

Onsite Wastewater System Design Criteria

Type of Initial Wastewater System: 2-A

Number of Occupants/Employees (Max.): 4 People

Number of Bedrooms (Max.): 2 Bedroom

LTAR (gpd/ft²): 1.0

Design Flow (GPD): 240 GPD

Length of Lines (Feet): 24'

Number of Lines: 5

Width of Lines (Feet): 3'

Trench Bottom Depth (Max. Inches): 18"

Drainfield Square Feet: 360

Min. Size of Septic Tank (Gal.): 900 Min

Bed Dimensions (Feet x Feet): 15' X 24'

Min. Size of Pump Tank (Gal.): N/A

Other Information: _____

Min. Size of Grease Trap (Gal.): N/A

Other Information: _____

REHS Signature

3/2/2022
Date