

Permit: 337374

PIN: 022L00000820000



Water Leigh  
www.arhs-nc.org


Currituck

Owner:  
WATERLEIGH NC, LLC  
448 VIKING DR. STE 220  
VIRGINIA BEACH, VA 23452

Applicant:  
CHESAPEAKE HOMES  
448 VIKING DR. STE 220  
VIRGINIA BEACH, VA 23452

LTAR: 0.300  
Water: PUBLIC  
TYPE III C.  
SINGLE FAMILY  
GPD: 480

Location:  
221 MOORLAND WAY

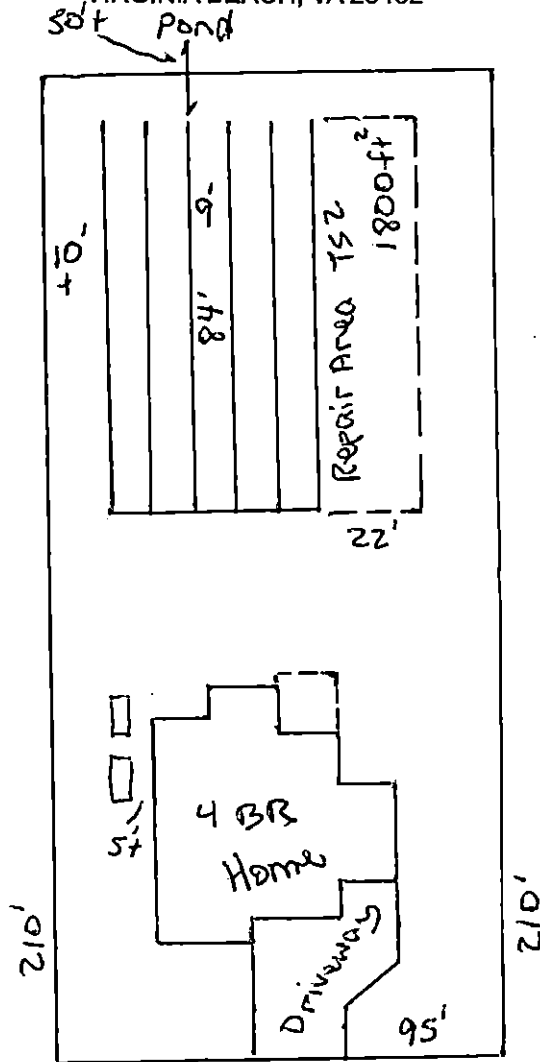

1000 gallon  
Pump Tank

- \*\*Set tank high (12 inches minimum) so top of lines are at filled surface**
- \*\*Keep septic system 50'+ from any well or surface water**
- \*\*Fine Sandy Loam @ 6 1/2 feet**
- \*\*Fill house pad higher than finished septic tank grade**
- \*\*Consult with plumber & septic installer prior to starting of home construction to ensure finished floor, plumbing stub-out, and septic tank elevations are met per septic permit requirements**
- \*\*Follow all .1900 rules pertaining to pump to gravity systems, if applicable**

Authorized Agent: Kevin Carver  
Carver, Kevin

Date: 02/17/2021

Approved: [Signature]

Date: 8-10-21

ALBEMARLE REGIONAL HEALTH SERVICES  
Final Inspection

Name: WATERLEIGH NC, LLC

Permit #: 337374

System Installer: Bazemore

Manufacturer: NRM

Septic Tank Serial: 830

Gallons: 1,000

Drain Field Type: EZFLOW EZ 1203H


Distribution Type: GRAVITY - PARALLEL (eq. d-box)

Number of Nitrification Lines: 6

Total Trench Length: 80

Comments:

221 Moorland Way, Lot 82, Waterleigh Subdivision, Phase 4, Moyock  
(Champion Pump, CPE4-12, 115v, 4/10hp, S/N Q215853) ( Pump Tank, NRM-1200, PT-174)

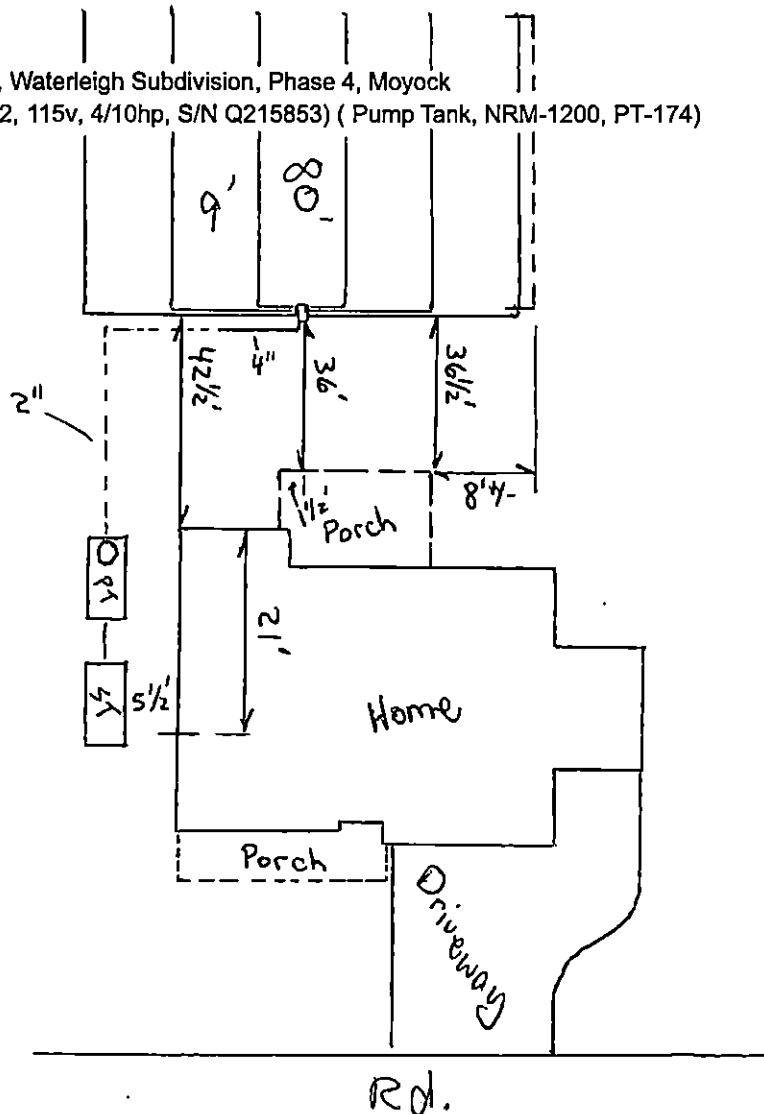

EHS: KE

Date: 08/10/2021

Carver, Kevin