


**SAMPSON COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH SECTION
OPERATION PERMIT**

10 020 220 301

Owner: ADAM McCLAMB Address: 3570 PENNY TEW MILL RD, ROSEBORO
 Permit #: DP21-000110 Receipt #: 155997 S.E. #: _____
 Installer: TEW/BARBER #2511 Telephone: 567-2567
 Address: 8908 DUNN RD, SALEMBOURG 28385
 System Type: EZ FLOW Maximum Design Flow: 360 (gallons/day)
 Wastewater Characteristics: DOMESTIC # Bedrooms: 3 Max # Occupants 6
 Septic Tank Capacity: 1020 (Gallons) FUTRELL Tank ID # STB 11
 Nitrification Line Dimensions: (2) 70'L X 3'W TRENCHES
 Effluent Distribution Device: D-BOX W/DIAL FLOWS 3' FROM TANK Gravel Depth: PSA 12
 Depth to: Top of Tank: 2-4 (Inches) Trench Bottom: 20-26 (Inches)

Diagram of Actual Installation: (Depict Property Boundaries, Structures, Driveways, Trees, Water Lines, Water Supplies, Etc.)
 Scale: NTS Inch = _____ Feet.

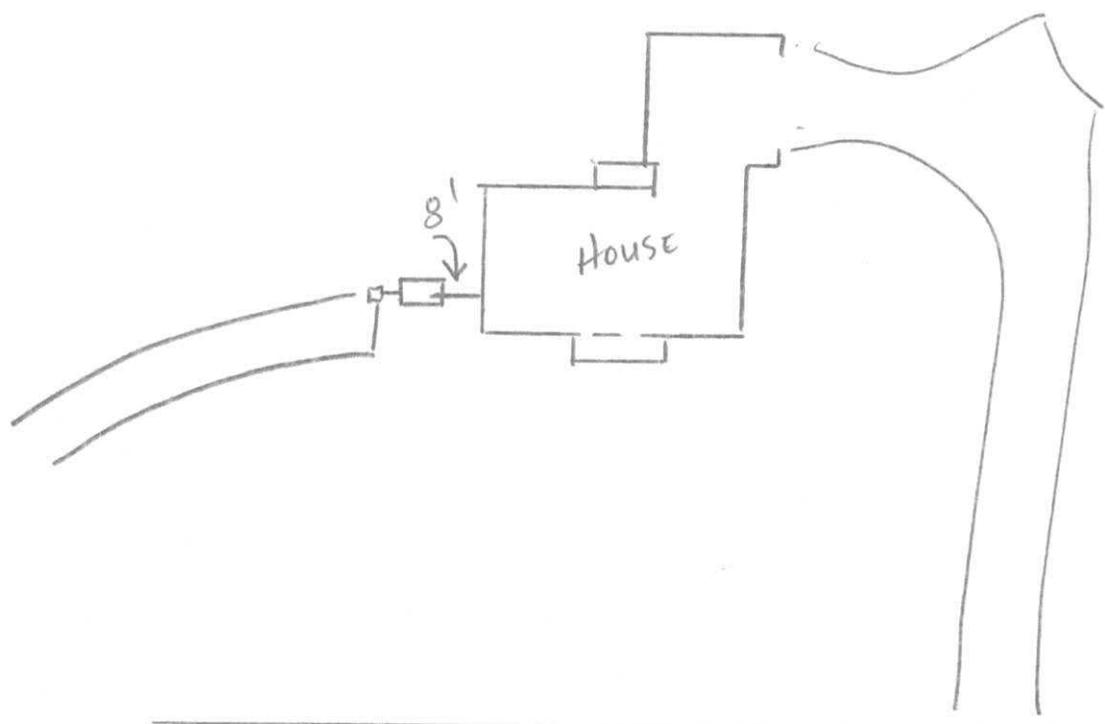

Comments and Conditions: SR 1456

Issued By: Oswald Newman, REHS # of Attachments: _____
 Date: 4/13/21

FINAL APPROVAL OF THIS SYSTEM SHALL INDICATE THAT THE SYSTEM HAS BEEN INSTALLED IN ACCORDANCE WITH APPLICABLE PERMIT CONDITIONS, LAWS AND RULES, BUT IN NO WAY SHOULD BE TAKEN AS A GUARANTEE THAT THE SYSTEM WILL FUNCTION SATISFACTORILY FOR ANY GIVEN TIME.