

NO

**Environmental Health Section
 Beaufort County Health Department
 220 N. Market St.
 Washington, North Carolina 27889
 (252) 946-6048 / Fax (252)946-2074**

- New Construction
- Repair
- Flow Addition

Improvements Permit

A Building Permit cannot be issued with only an Improvement Permit

*Improvements permit is valid for five years from the date of issue.

Owner: Brett Harris Phone: (252) 243-2784
 Address: 910 Anderson St. Wilson, NC 27893
 Subdivision: Carolina Shores Lot Number: 27
 State Road Number: N/A Directions: _____

10-DIGIT PIN 6691-06-5636

Property Size: 0.99 ac Type Structure: House

Design Flow: 360 No. Bedrooms 3 No. People: 6

Water Supply: Public Private (Maintain minimum 10 feet separation
 From any part of septic system and repair area.)

Classification: Suitable Provisionally Suitable PS with fill

Additional Drainage: crown system area to shed surface water

Seasonal Wetness Condition: 24" Soil Type II / III System Type II c

Septic Tank: 1,000 gal. Pump Tank: 1,000 gal.

Pump Required: Yes No May be required based upon final location & elevation of facilities

Nitrification Field: 1,200 square feet trench bottom

Trench Depth: 12" Fill Depth: 6" of cover (topsoil)

Comments: -set 1,000 gal. septic tank and install 4 lines (3' x 100') conventional rock trenches for initial and 4 lines (3' x 100') conventional rock trenches for repair; maintain setbacks


SEE ATTACHMENT

**AUTHORIZATION TO CONSTRUCT
 WILL BE ISSUED UPON
 APPROVAL OF FINAL SITE PLAN
 BY B.C.H.D.**

Site Plan

The issuance of this permit by the Health Dept. in no way guarantees the issuance of other permits. The permit holder is responsible for checking with appropriate governing bodies in meeting their requirements. This permit is subject to revocation if the site plan, plat, or the intended use changes, or site alterations occur. The Improvement Permit shall not be affected by a change in ownership of the site. This permit is subject to compliance with the provisions of the Laws and Rules for Sewage Treatment and Disposal and to conditions of this permit.

Additional for all systems: Landscape system area for surface water runoff and grass. Do not place drive or any building over the system area or repair area. Observe all proper setbacks (15A NCAC 18A .1950). Do not work soil or install in wet conditions. This permit must be on site during installation and inspection.


Authorized State Agent:  Date: 8 / 14 / 2008

White Owner/Contractor Yellow - Health Department Pink Building Inspections

08-14-2008

Owner: Brett Harris
 Owner Address: 910 Anderson St.
 Owner Address(2): Wilson, NC 27893
 Owner Phone #: (252) 243-2784
 Property Address: Carolina Shores
 Property Address(2): Lot #27
 PIN: 6691-06-5636
 Record #:
 Establishment Type: Home
 Type of Well: Public Well
 Design Flow (GPD): 360

Initial Site
 Wastewater System: Conventional Pipe
 Long Term Acceptance Rate (GPD/SQFT): .3
 Trench Width: 3 FT
 Trench Spacing (OC): 9 FT
 Trench Bottom From NGL: -12 IN
 Septic Tank Volume: 1000 GAL

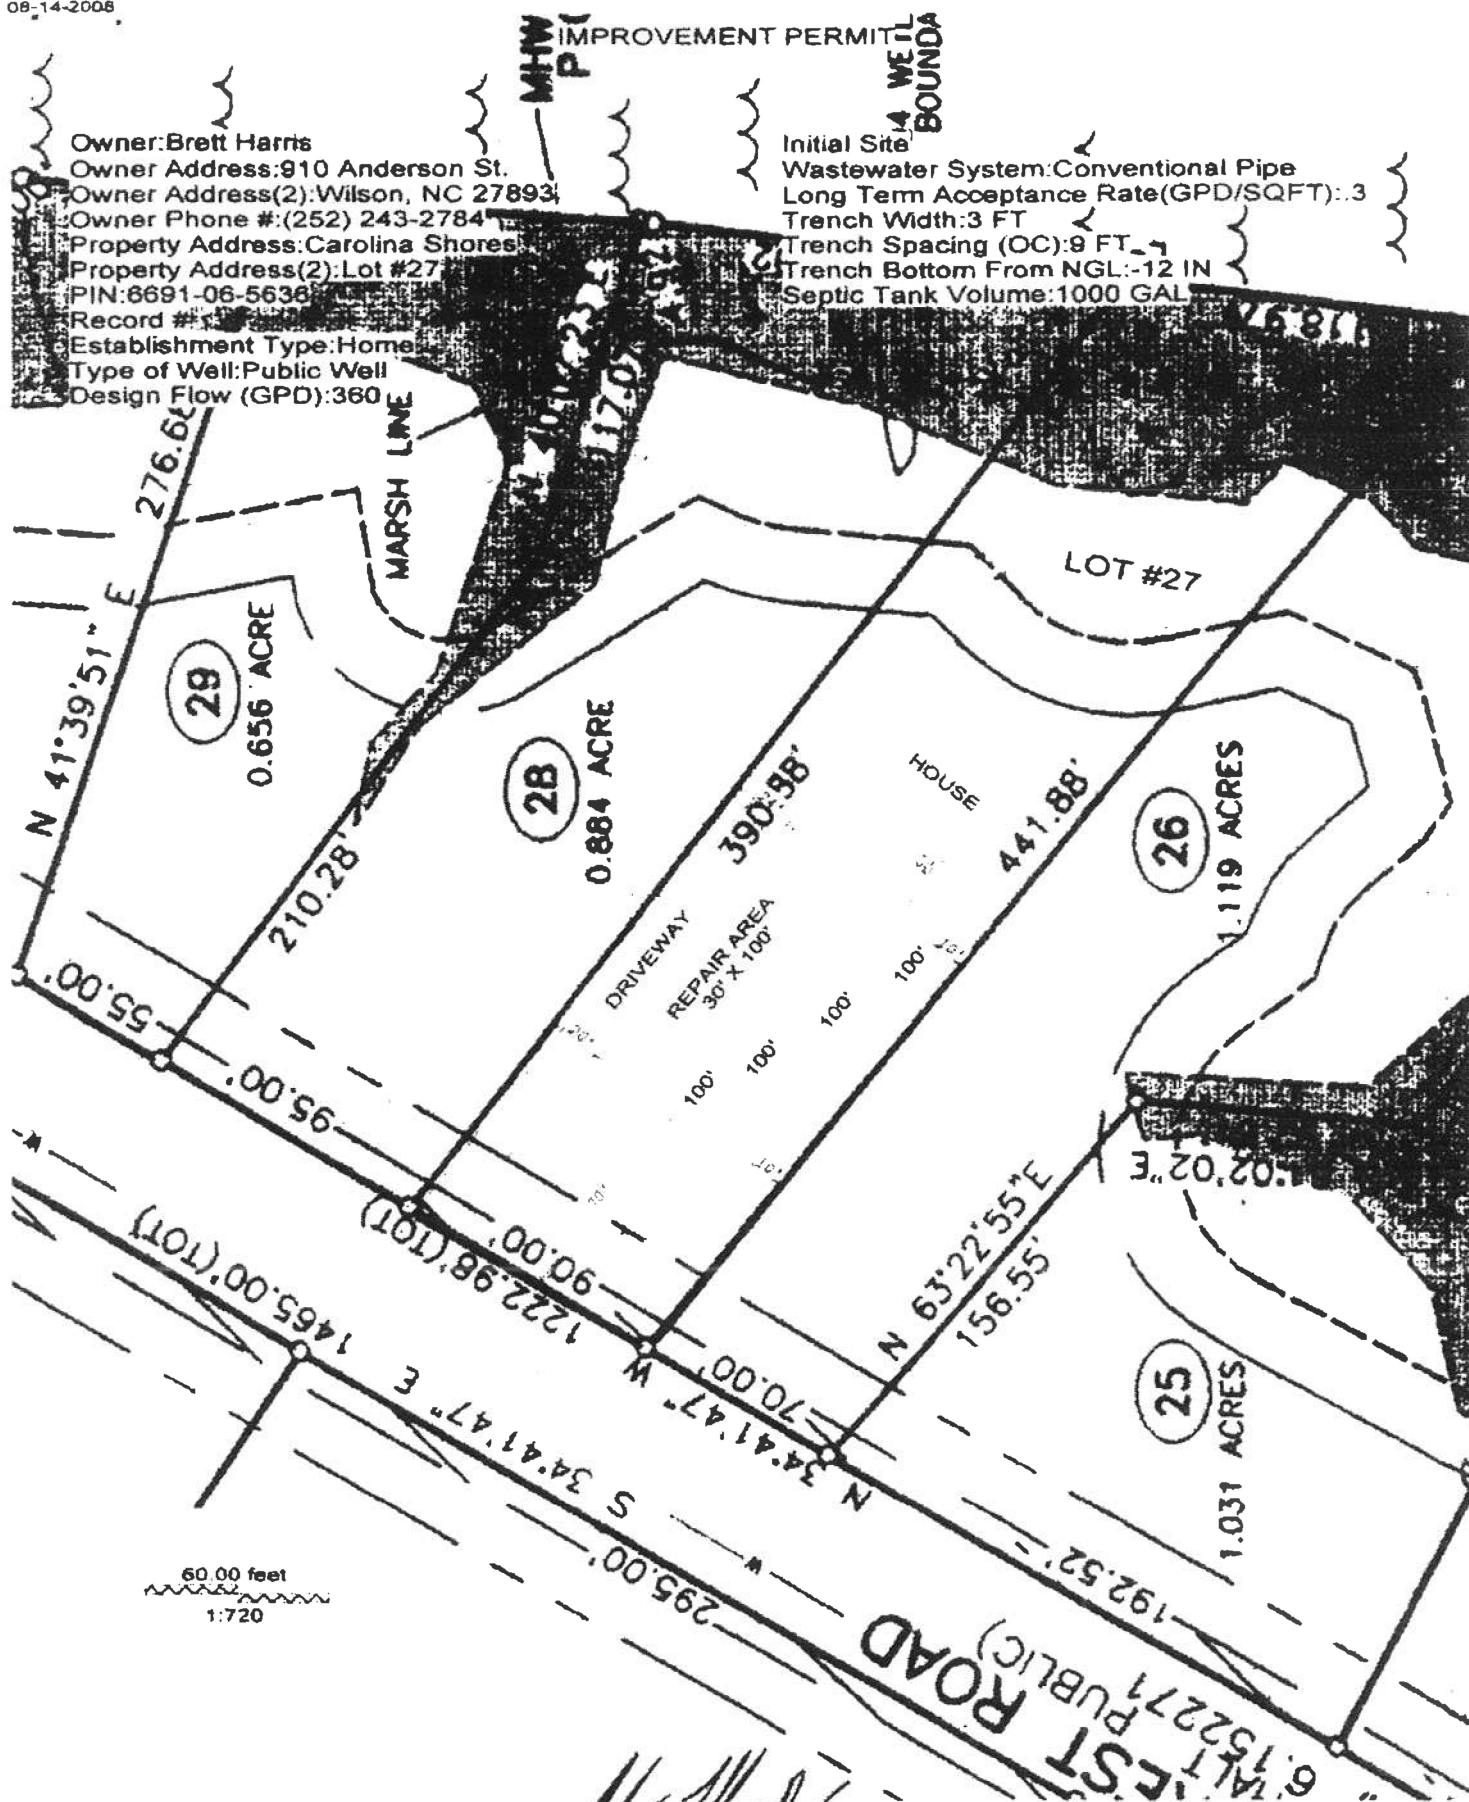

Authorized Agent:

Date 2008-08-14