

Nash County Environmental Health
 On-Site Wastewater Permit
 120 W. Washington Street, Nashville, NC 27856
 252-459-9829



Permit Number: E-24-1135
 PIN: 381400471377
 Applicant: Felicia Manning
 Company:

Parcel ID: 355794

Owner: Four Seasons Contractors


Subdivision: Parker's Creek Sect: Ph: Lot: , 49
 Address of Property: 7575 SWEETWATER DR NASHVILLE, NC 27856
 Design Specifications: New Subsurface Disposal System Non-Residential Use:
 Design Flow: 480 LTAR: .30 Trench Length: 400' X 3'
 Size Tank: 1000 Pump Tank: 1000 Grease Trap:
 Type System: 25% Reduction Max Trench Depth: 18 Bedrooms: 4
 Max Occupants: 8
 Additional Inspections Required: Installer:

This permit is valid for 5 years from Improvement Permit date.

Conditions: Do not drive, park, build, pave or concrete over any part of the system or repair. Site alterations or variations from the site plan may void permit and/or make the site unsuitable. System must be installed as permitted. Install drain lines on contour. Install drain field in dry conditions. If a pump system is required, a pressure manifold shall be used. This permit is written for a four (4) bedroom home with eight (8) resident maximum and a pumping system. Install four 100' X 3' PA or C lines on 9' centers. Lines run at the back of the property and become 1" to 3" deeper. No benchmark was used on this property. Shape cover to shed surface water. Original system area has been flagged. Do not remove flags. Dose volume shall be 173 to 196 gallons. Draw down shall be 8.5" to 9.5". It is highly recommended to pump out your septic tank once every 3 to 5 years for maintenance. Call the Environmental Health with any further questions.

Improvement Permit: September 19, 2024	Authorized State Agent (Digitally Signed By): Eric Griffin REHS
Construction Authorization: September 19, 2024	Authorized State Agent (Digitally Signed By): Eric Griffin REHS
Operation Permit:	Authorized State Agent (Digitally Signed By):

ps 1 of 2

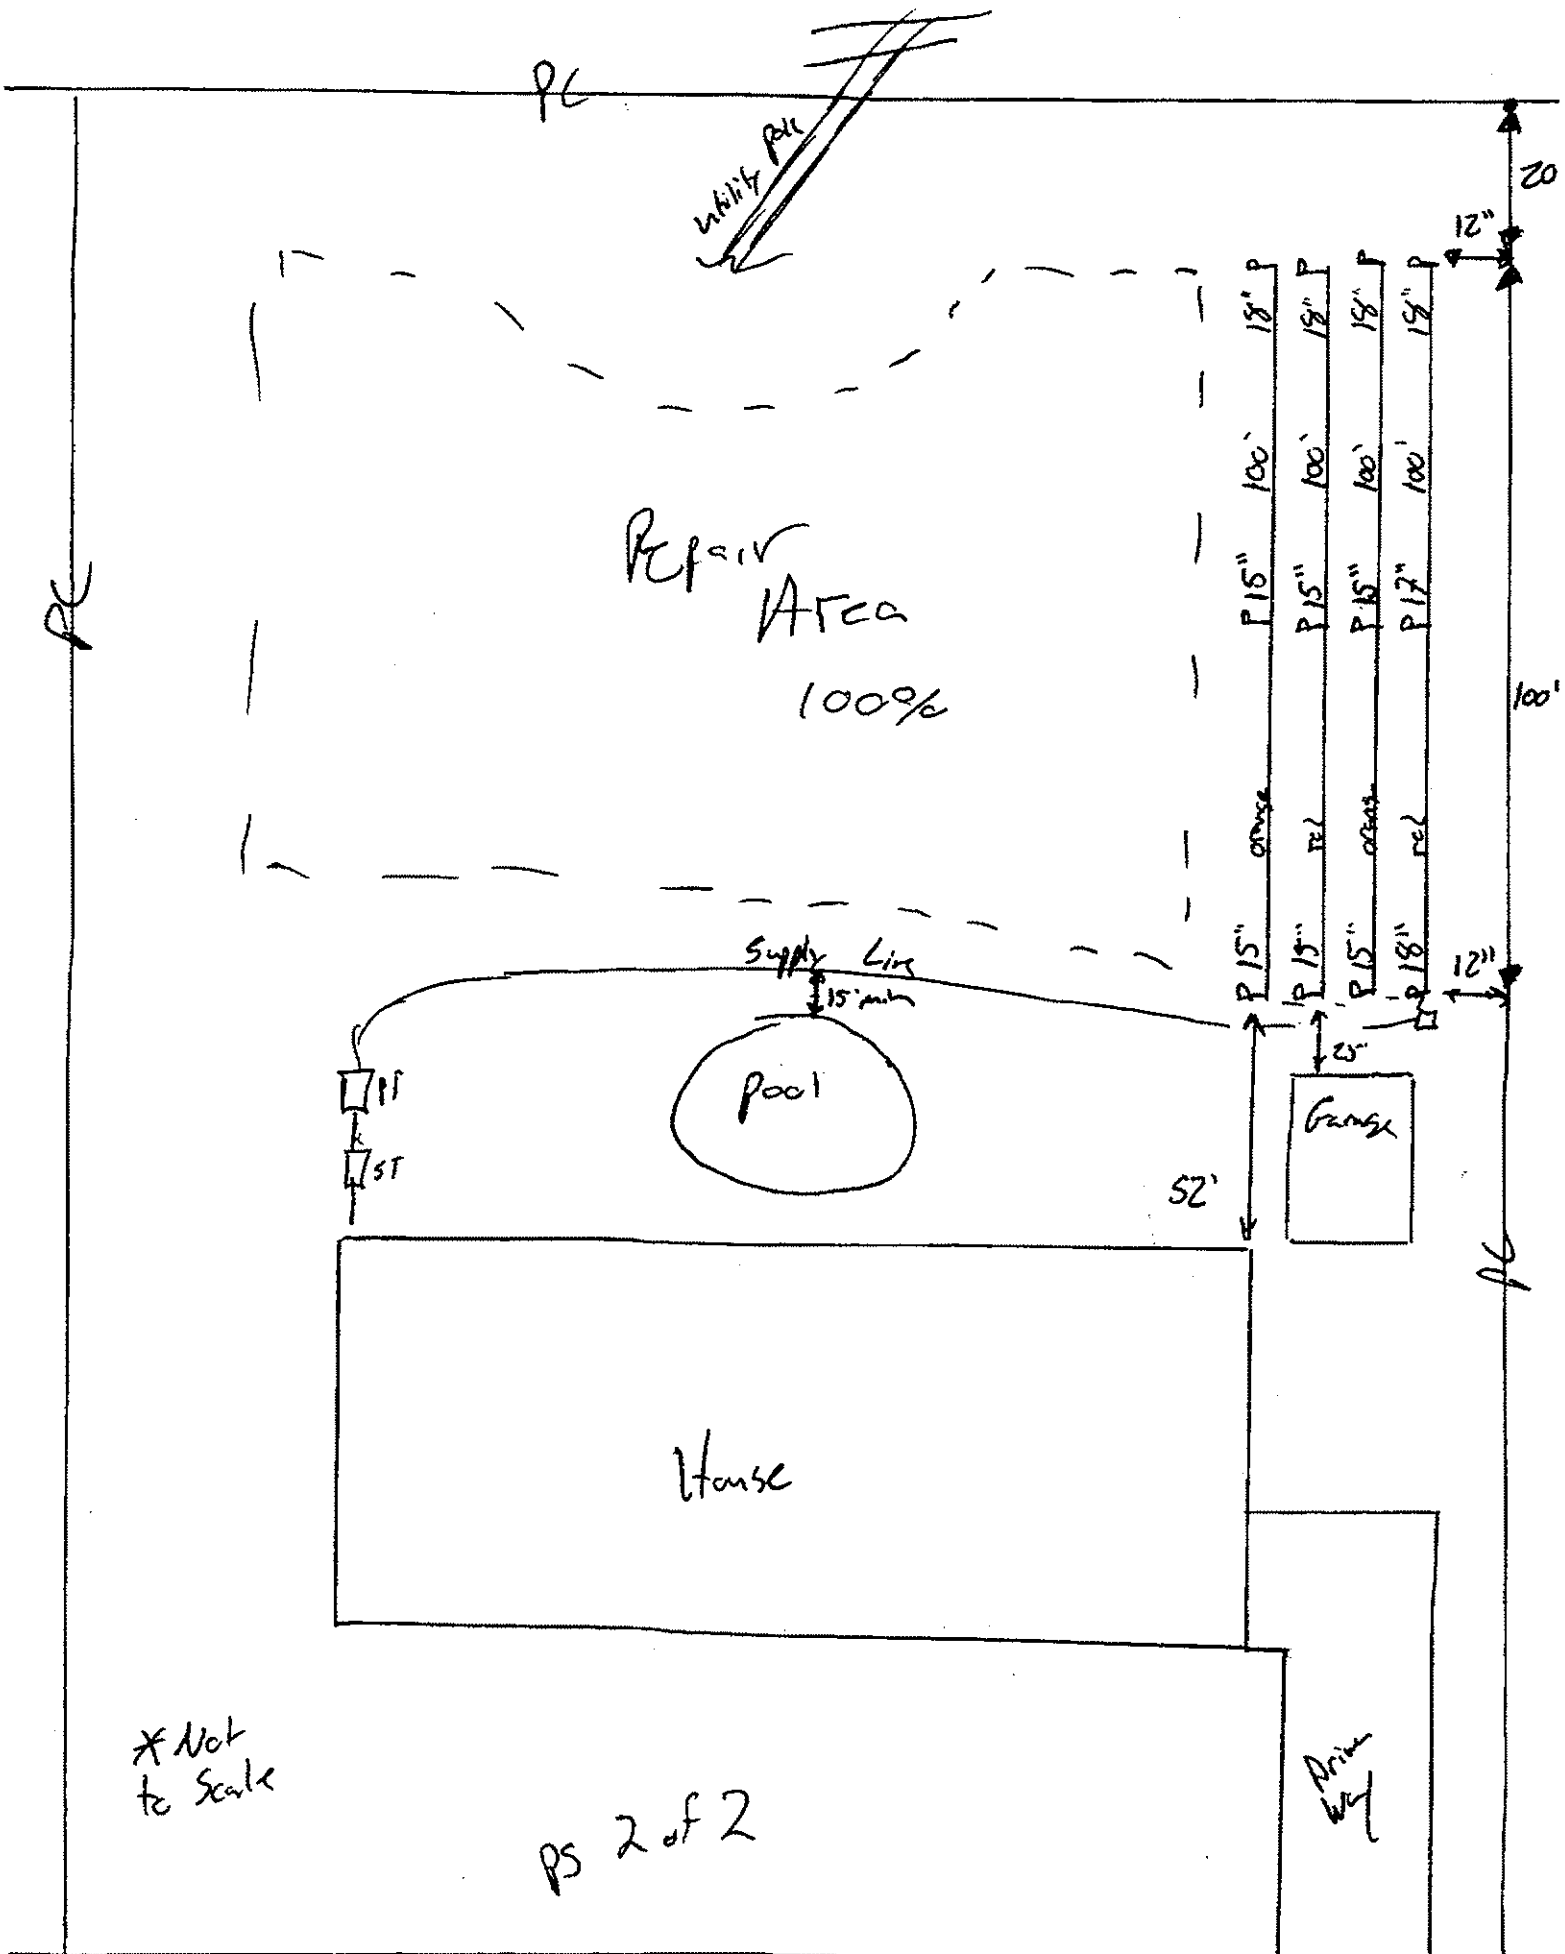

*Not to Scale

PS 2 of 2

Driveway