Nash County Environmental Health

On-site Wastewater Permit
120 W. Washington Street, Nashville NC 27856
252-459-9829

Permit Number: E19-000470
Mail: 71600735624
Applicant: David Williams
Company:

Parcel ID: 107163

Township: Rocky

Owner: WILLIAMS BUIDERS OF ROCKY MT
8820 THOMAS ST
ROCKY MOUNT, NC 27803

Subdivision: Winstead Crossing Sect: Ph: Lot: B5
Address of Property: 8700 COMMERCIAL RD ELM CITY, NC 27822
Design Specifications: Revision of Permit ($50) Non-Residential Use:
Design Flow: 360 LTAR: .5 Trench Length: 240
Size Tank: 1000 Pump Tank: Grease Trap:
Type System: 25% Reduction Max Trench Depth: 15 inch Bedrooms: 3
Max Occupants: 6
Additional Inspections Required: Installer: Pridgen
This permit is valid for 5 years from Improvement Permit date.

Conditions: **Do not drive, park, build, pave or concrete over any part of the system or repair**. Site alterations or variations from the site plan may void permit and/or make the site unsuitable. System must be installed as permitted. Install drain lines on contour. Install drain field in dry conditions. This permit was written for a three (3) bedroom home with six (6) residents maximum. Install 4(60'x3') PA or C lines on 9' centers. Lines run in front of the home and to the left of the driveway. Water line shall be located a minimum of 10' from all parts of the septic system and all parts of the foundation shall be a minimum of 5' from the septic system. The septic tank may be above ground level to achieve gravity fall. No benchmark was record on this lot. Refer to the drawing for trench depth. Shape cover to shed surface water. Original and repair (pump to serial distribution PA or C lines) areas have been flagged. Call the Environmental Health Department with any further questions.

Refer to Page 2 of the permit for construction details.

ST 8.5.19
ORP. 628
1000
EZ Flow 3(80' x3')
Top Line A 12.7½ → 12.8
C 13.1 → 13.1½

Improvement Permit: 5-3-2019 Authorized State Agent: Tuamki T. Pridgen, REHS
Construction Authorization: 5-3-2019 Authorized State Agent: Tuamki T. Pridgen, REHS
Operation Permit: 9-12-2019 Authorized State Agent: Tuamki T. Pridgen, REHS

*Drawing for IP and CA. 5-3-2019
Franki T. Ridgen, REHS
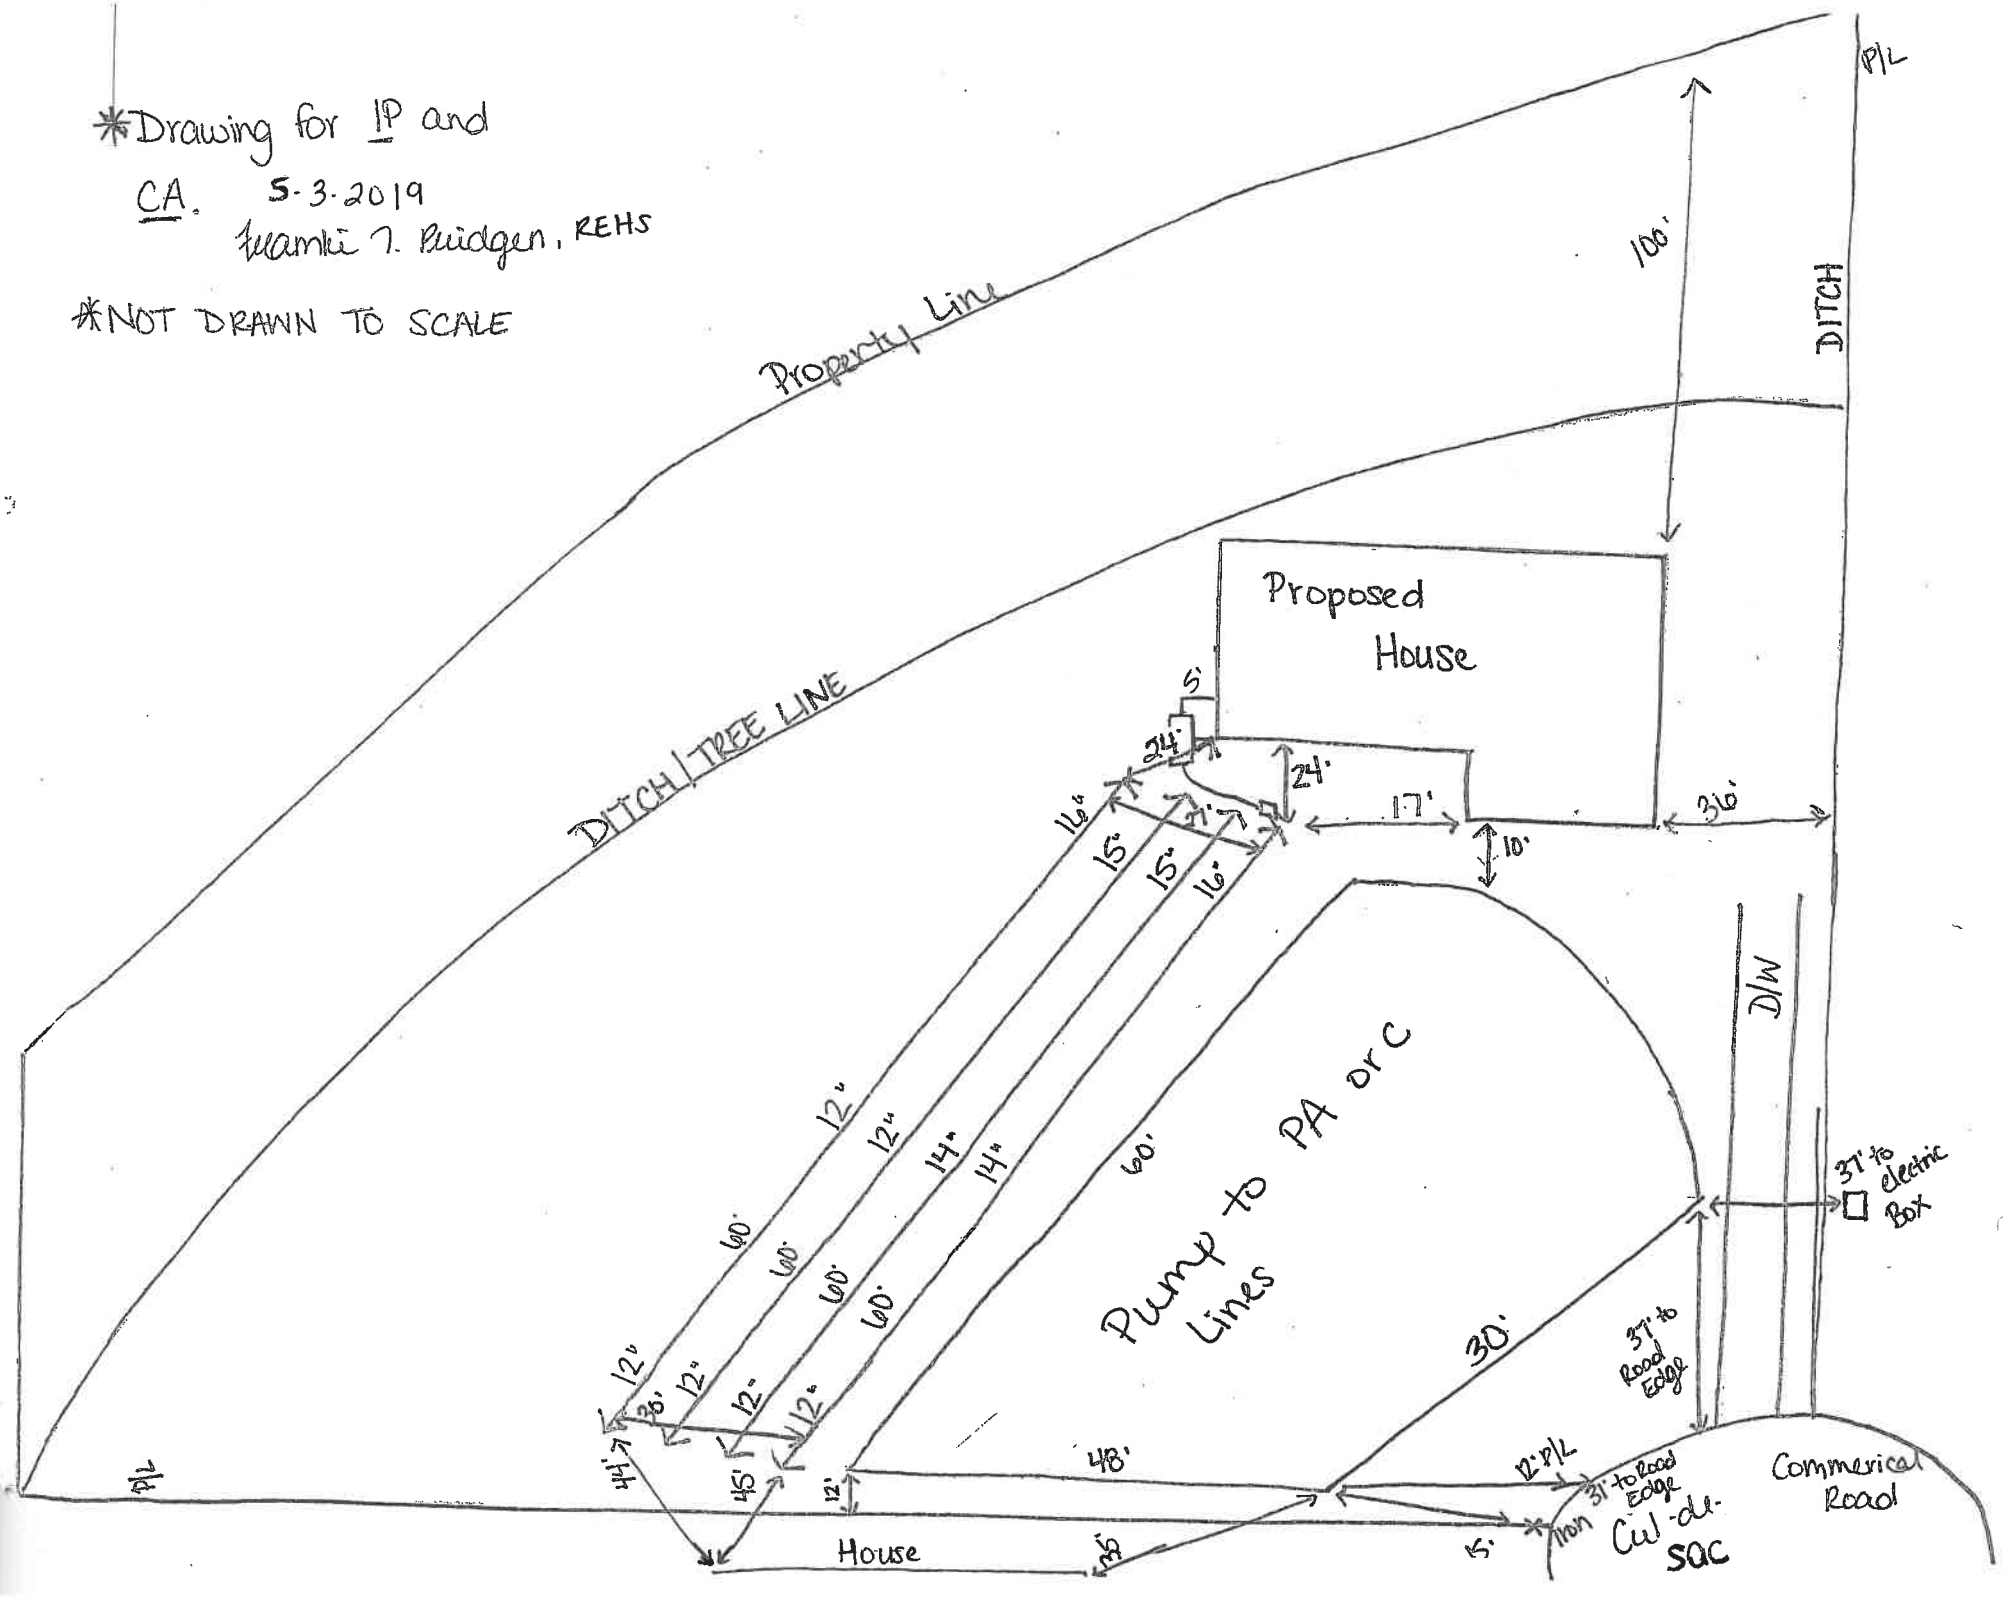
*NOT DRAWN TO SCALE