



Owner's Name: FREEMAN MAVIS K
Property Address: 7239 WESTBROOK AVE SW 28469
Subdivision: SEASIDE HEIGHTS Lot: 44 Block: Section:
Water Supply: [X] Public Water or [] Private Water Project Type: [X] Residential or [] Commercial

Existing System Reuse Authorization

- Maintain 10 feet minimum to any water line.
Do not drive, park, pave, or build any structure over the initial septic system area or repair septic system area.
Maintain 5 feet to any structure.
Maintain gravity flow to the septic system.
Maintain the following setback to any well: [X] 50 feet or [] 100 feet
Type of Repair Wastewater System: N/A
The existing septic system appears to be functioning and continued use is approved per this authorization. Maintenance and/or repair may be necessary at any given time.
[] The owner and a Public Management Entity/Subsurface System Certified Operator shall execute a contract which addresses all of the requirements for maintenance, monitoring, schedule and operation, and reporting in Section .1961. Provisions of said contract shall be in effect for as long as the system is in use. Management of the wastewater system should be provided at all times.
[] Maintain a minimum of 25 feet between a well(s) and any structure.
[] Other:
[] Other:

Actions of local health services representatives, or the State, engaged in the evaluation and determination of measures required to effect compliance with the applicable laws and rules, shall in no way be taken as a warranty that sewage treatment and disposal systems approved and permitted will function in a satisfactory manner for any given period of time.

Existing System Reuse Issuance Date: 2/23/2023

REHS Signature: [Signature]

REHS Registration Number: 3077

See Existing System Reuse Site Plan for Septic System Location and Further Detail




Brunswick County Environmental Health Services
Onsite Wastewater Information

BCHS File Number: 2008069931A
Tax Parcel: 2423A044

Site Plan For (Check One):

- Improvement Permit Fill Plan Authorization to Construct Permit
 Well Permit Proposal Existing System Reuse
 Other: _____

SITE PLAN ONLY. THIS IS NOT A PERMIT

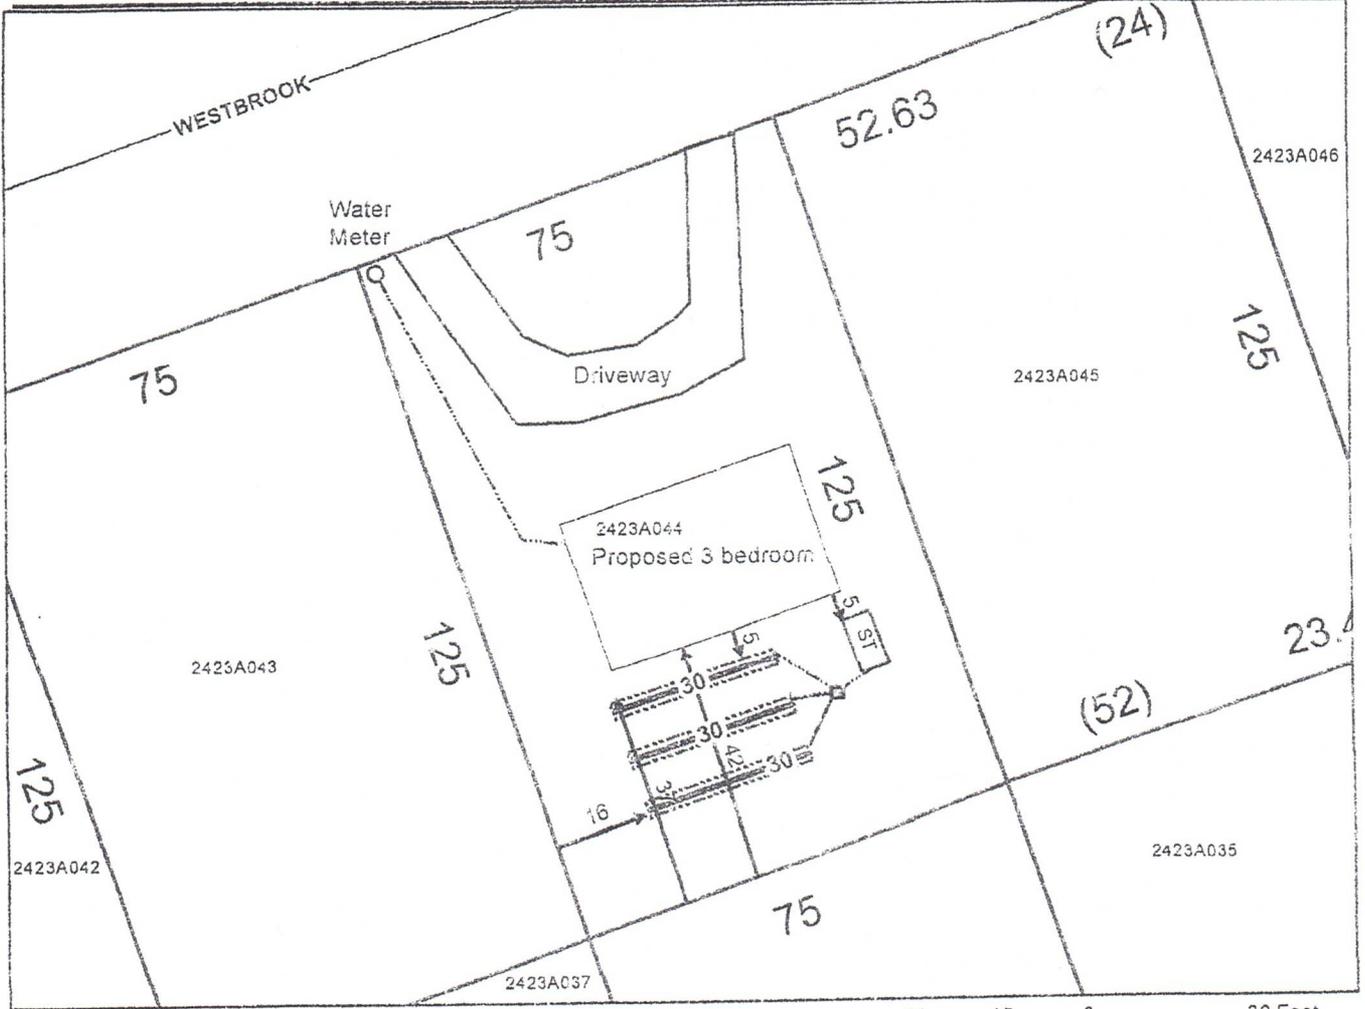

1 inch = 30 feet



Onsite Wastewater System Design Criteria

Type of Initial Wastewater System: <u>III-G 25% Reduction</u>	Number of Occupants/Employees (Max): <u>6</u>
Number of Bedrooms (Max.): <u>3</u>	LTAR (gpd/ft ²): <u>1.0</u>
Design Flow (GPD): <u>360</u>	Length of Lines (Feet): <u>30</u>
Number of Lines: <u>3</u>	Width of Lines (Feet): <u>3</u>
Trench Bottom Depth From Top of Final Cover (Max. Inches): <u>existing</u>	Drainfield Square Feet: <u>270</u>
Min. Size of Septic Tank (Gal.): <u>existing 900</u>	Bed Dimensions (Feet x Feet): _____
Min. Size of Pump Tank (Gal.): _____	Other Information: _____
Min. Size of Grease Trap (Gal.): _____	Other Information: _____

[Signature]

REHS Signature

2/23/2023

Date

BRUNSWICK COUNTY HEALTH DEPARTMENT

FILE NO.: 2008069931
ZONING:

DATE REC.: 7/3/2008

P.I.N.:

POPE ROBERT E

REC. FROM

200.00 AMT. PD. 2423A044

TAX PARCEL

1037 ROY LEE ROAD

HAMER

SC

29547

(843) 845-1143

ADDRESS

CITY

ST

ZIP

PHONE

POPE ROBERT E

44

CURRENT PROPERTY OWNER

LOT

BLK

SEC

PROPERTY LOCATED, TOWN/CITY/AREA BRUNSWICK COUNTY

SUBDIVISION

SEASIDE HEIGHTS

Directions: 7239 WESTBROOK AVENUE SW

AWWS-05-01

AUTHORIZATION FOR WASTEWATER CONSTRUCTION PERMIT

NEW REVISION RELOCATION UPGRADE REPAIR
 Design Flow: 360 gpd. Septic Tank Size: Existing 900 gal. Type: NEW 11' x 11' x 11' PUC
 No. Bedrooms 3 No. occupants/employees 6 Max. Trench/Bed Bottom Depth: 22" inches
 No. Lines: 2 Length Each: 40' each Bed Dimensions: 30' x 40'

NOTES:
 1. Septic Tank shall have an approved effluent filter and access devices as applicable.
 2. Maintain all setback distances for septic tank systems and wells.
 3. All components of the septic systems shall be located 100 feet from well.
 4. An "Accepted" system may be used in the place of a "conventional" system.

Fill Check: Approved:
 Date Authorized Agent

PERMIT ISSUE DATE: 7/1/08 Permit expires 60 months from date of issue unless otherwise specified


30 days from date of issue Other 9/1/08

Authorized Agent

Registration: RS 1710

NOTE: PERMIT IS SUBJECT TO REVOCATION IF SITE PLANS OR THE INTENDED USE CHANGES.

IMPROVEMENT PERMIT CONDITIONS MUST BE MET.

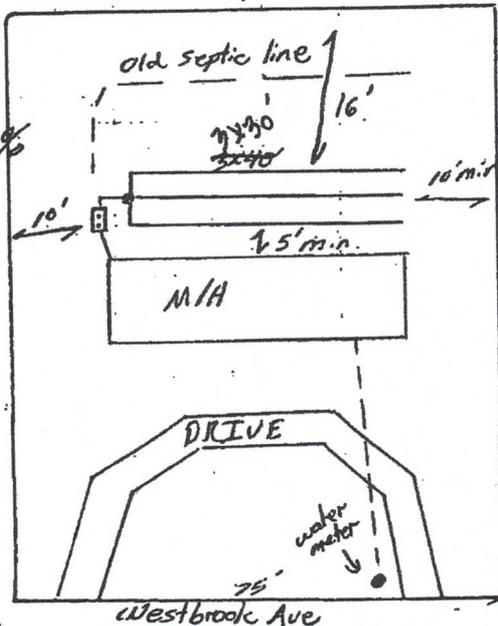

3 lines
 3x40 -> 3x30 w/25% Red.
 - May use Stone, Chamber, or Polystyrene 125'
 - Maintain 40' line length at owners request.

- Check 'T' inside of tank.
 - Replace w/new PUC 'T' & Filter if needed.
 - Set new 'D' Box

24 Chambers w/25% Red.

Wastewater System Installer: Offree Evans Date: 7/1/08

Comments: (tank info/barrier approved) Existing tank 900gal New 'T' installed

Rock Polystyrene Aggregate Chamber Other

OPERATION PERMIT: Date: 7/1/08

Authorized Agent Signature

Actions of local health department representatives or the State engaged in the evaluation and determination of measures required to effect compliance with the applicable laws and rules shall in no way be taken as a warranty that sewage treatment and disposal systems approved and permitted will function in a satisfactory manner for any given period of time. The issuance of this permit does not preclude the Permittee from complying with any and all statutes, rules and regulations or ordinances which may be imposed by other government agencies (local state, and federal) which have jurisdiction.

Rev. 1/07