

SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION

Maine Department of Human Services
Division of Health Engineering, 10 SHS
(207) 287-5672 Fax: (207) 287-3165

51-31

PROPERTY LOCATION		>> CAUTION: PERMIT REQUIRED - ATTACH IN SPACE BELOW <<	
City, Town, or Plantation	ELLSWORTH	ELLSWORTH	4259 TOWN COPY
Street or Road	169 LAKES LANE	Date Permit Issued: 6/11/04	\$ 1100 FEE ☐ If Double Fee Charged
Subdivision, Lot #		Local Plumbing Inspector Signature: [Signature]	L.P.I. # 1008
OWNER/APPLICANT INFORMATION			
Name (last, first, MI)	BROUGHTON, JENNIFER		
	☒ Owner ☐ Applicant		
Mailing Address of Owner/Applicant	290 POND ROAD GOULDSBORO ME. 04607		
Daytime Tel. #	(207) 963-2781	Municipal Tax Map # 51	Lot # 31
OWNER OR APPLICANT STATEMENT		CAUTION: INSPECTION REQUIRED	
I state and acknowledge that the information submitted is correct to the best of my knowledge and understand that any falsification is reason for the Department and/or Local Plumbing Inspector to deny a Permit.		I have inspected the installation authorized above and found it to be in compliance with the Subsurface Wastewater Disposal Rules Application.	
Signature of Owner or Applicant: [Signature] Date: 6/7/04		Local Plumbing Inspector Signature: [Signature] (2nd) date approved: 7-9-04	

PERMIT INFORMATION	
TYPE OF APPLICATION	THIS APPLICATION REQUIRES
☒ 1. First Time System ☐ 2. Replacement System Type replaced: _____ Year installed: _____ ☐ 3. Expanded System ☐ a. Minor Expansion ☐ b. Major Expansion ☐ 4. Experimental System ☐ 5. Seasonal Conversion	☐ 1. No Rule Variance ☐ 2. First Time System Variance ☐ a. Local Plumbing Inspector Approval ☐ b. State & Local Plumbing Inspector Approval ☐ 3. Replacement System Variance ☐ a. Local Plumbing Inspector Approval ☐ b. State & Local Plumbing Inspector Approval ☐ 4. Minimum Lot Size Variance ☐ 5. Seasonal Conversion Permit
SIZE OF PROPERTY	DISPOSAL SYSTEM TO SERVE
40± ☐ SQ. FT. ☒ ACRES	☒ 1. Single Family Dwelling Unit, No. of Bedrooms: 4 ☐ 2. Multiple Family Dwelling, No. of Units: _____ ☐ 3. Other: _____ (specify) Current Use ☐ Seasonal ☐ Year Round ☒ Undeveloped
SHORELAND ZONING	DISPOSAL SYSTEM COMPONENTS
☐ Yes ☒ No	☒ 1. Complete Non-engineered System ☐ 2. Primitive System (graywater & alt. toilet) ☐ 3. Alternative Toilet, specify: _____ ☐ 4. Non-engineered Treatment Tank (only) ☐ 5. Holding Tank, _____ gallons ☐ 6. Non-engineered Disposal Field (only) ☐ 7. Separated Laundry System ☐ 8. Complete Engineered System (2000 gpd or more) ☐ 9. Engineered Treatment Tank (only) ☐ 10. Engineered Disposal Field (only) ☐ 11. Pre-treatment, specify: _____ ☐ 12. Miscellaneous Components
	TYPE OF WATER SUPPLY TO BE
	☒ 1. Drilled Well ☐ 2. Dug Well ☐ 3. Private ☐ 4. Public ☐ 5. Other

DESIGN DETAILS (SYSTEM LAYOUT SHOWN ON PAGE 3)			
TREATMENT TANK	DISPOSAL FIELD TYPE & SIZE	GARBAGE DISPOSAL UNIT	DESIGN FLOW
☒ 1. Concrete ☒ a. Regular ☒ b. Low Profile ☐ 2. Plastic ☐ 3. Other: _____ CAPACITY: 1000 GAL.	☒ 1. Stone Bed ☐ 2. Stone Trench ☐ 3. Proprietary Device ☐ a. cluster array ☐ c. Linear ☐ b. regular load ☐ d. H-20 load ☐ 4. Other: _____ SIZE: 1200 sq. ft. ☐ lin. ft.	☒ 1. No ☐ 2. Yes ☐ 3. Maybe If Yes or Maybe, specify one below: ☐ a. multi-compartment tank ☐ b. _____ tanks in series ☐ c. increase in tank capacity ☐ d. Filter on Tank Outlet	360 gallons per day BASED ON: ☒ 1. Table 501.1 (dwelling unit(s)) ☐ 2. Table 501.2 (other facilities) SHOW CALCULATIONS --- for other facilities ---
SOIL DATA & DESIGN CLASS	DISPOSAL FIELD SIZING	EFFLUENT/EJECTOR PUMP	
PROFILE CONDITION DESIGN 3 / C / 1 at Observation Hole # 2 Depth 16" of Most Limiting Soil Factor	☐ 1. Small--2.0 sq. ft. / gpd ☐ 2. Medium--2.6 sq. ft. / gpd ☒ 3. Medium--Large 3.3 sq. ft. / gpd ☐ 4. Large--4.1 sq. ft. / gpd ☐ 5. Extra Large--5.0 sq. ft. / gpd	☒ 1. Not Required ☐ 2. May Be Required ☐ 3. Required Specify only for engineered systems: DOSE: _____ gallons	☐ 3. Section 503.0 (meter readings) ATTACH WATER METER DATA

SITE EVALUATOR STATEMENT		
I certify that on 11-17-03 (date) I completed a site evaluation on this property and state that the data reported are accurate and that the proposed system is in compliance with the State of Maine Subsurface Wastewater Disposal Rules (10-144A CMR 241).		
Site Evaluator Signature: [Signature]	SE #: 319	Date: 11-19-03
Site Evaluator Name Printed: WILLIAM A. LABELLE, JR.	Telephone Number: (207) 537-5900	E-mail Address: labelleseptic@rivah.net

Note: Changes to or deviations from the design should be confirmed with the Site Evaluator.

HHE-200 Rev. 8/01

check # 2993

SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION

Department of Human Services
Division of Health Engineering
(207) 287-5672 FAX (207) 287-4172

Town, City, Plantation
ELLSWORTH


Street, Road Subdivision
LAKES LANE

Owner's Name
JENNIFER BROUGHTON

SITE PLAN

Scale 1" = 60 Ft.
or as shown

SITE LOCATION PLAN
(Map from Maine Atlas recommended)



(SEE ATTACHED SITE PLAN)

SOIL DESCRIPTION AND CLASSIFICATION

(Location of Observation Holes Shown Above)

Observation Hole #1 ☒ Test Pit ☐ Boring
1 " Depth of Organic Horizon Above Mineral Soil

Observation Hole #2 ☒ Test Pit ☐ Boring
1 " Depth of Organic Horizon Above Mineral Soil

Texture	Consistency	Color	Mottling
0		BLACK GRAY	
10	FRIABLE	YELLOW	N.E.
20		BROWN	
30	FIRM	PALE BROWN	FEW FAINT
40			
50			

Soil Classification <u>3</u> Profile	Slope <u>7</u> %	Limiting Factor <u>18</u> "	☒ Ground Water ☐ Restrictive Layer ☐ Bedrock ☐ Pit Depth
Condition <u>C</u>			

Texture	Consistency	Color	Mottling
0		BLACK	
10	FRIABLE	PALE BROWN	N.E.
20			FEW DISTINCT
30	FIRM		
40			
50			

Soil Classification <u>3</u> Profile	Slope <u>7</u> %	Limiting Factor <u>16</u> "	☒ Ground Water ☐ Restrictive Layer ☐ Bedrock ☐ Pit Depth
Condition <u>C</u>			

Will G. Jr.
Site Evaluator Signature

319
SE

11-19-03
Date

SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION

Maine Department of Human Services
Division of Health Engineering, Station 10
(207) 287-5672 FAX (207) 287-4172

Town, City, Plantation

ELLSWORTH

Street, Road, Subdivision


LAKES LANE

Owner or Applicant Name

JENNIFER BROUGHTON

SUBSURFACE WASTEWATER DISPOSAL PLAN

Scale 1"= 20 ft.

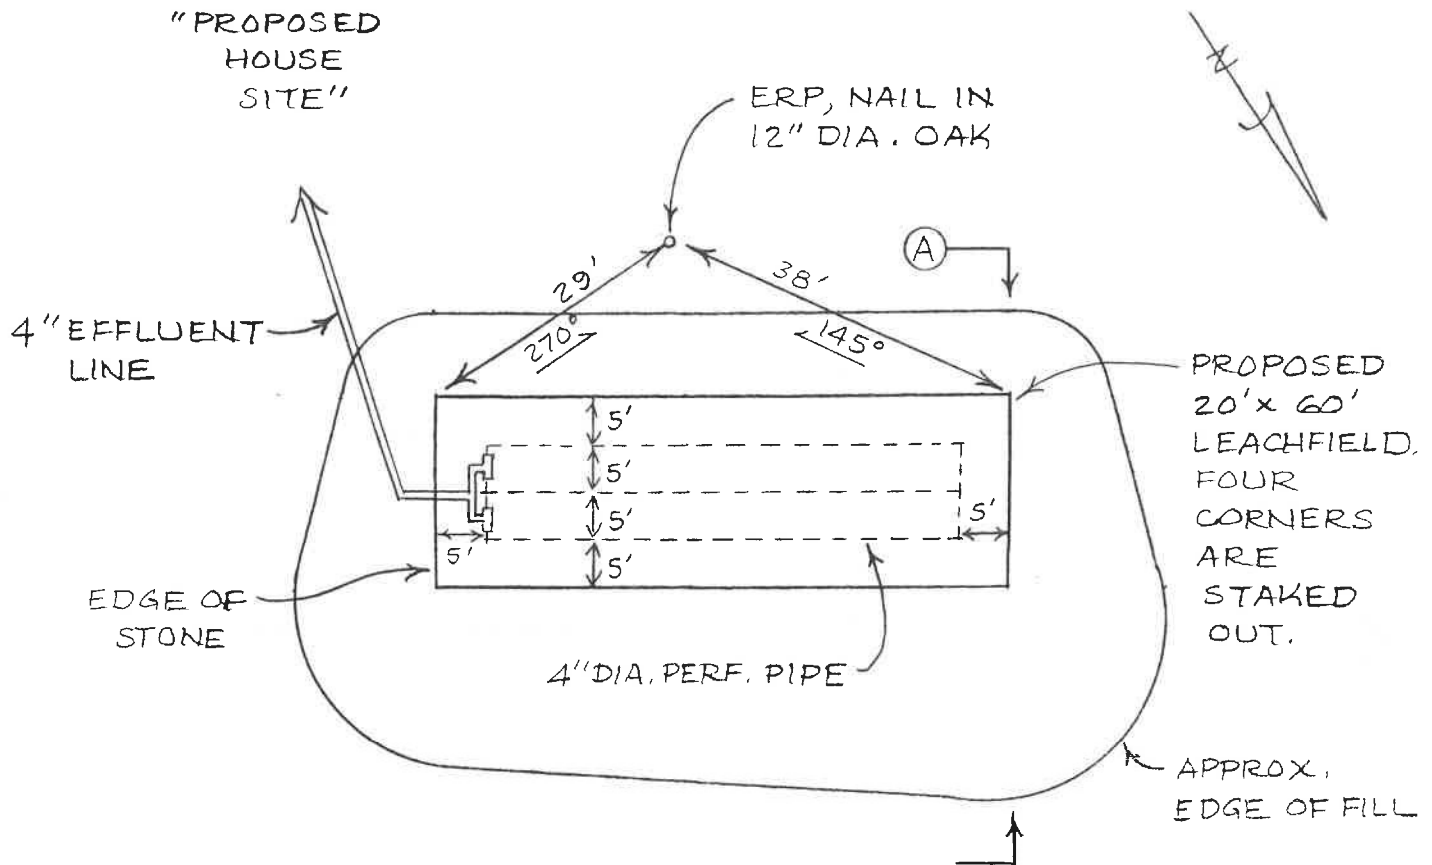

BACKFILL REQUIREMENTS

Depth of Backfill (upslope) 22"
Depth of Backfill (downslope) 36"-40"
DEPTHS AT CROSS-SECTION (shown below)

CONSTRUCTION ELEVATIONS

Finished Grade Elevation -36"
Top of Distribution Pipe or Proprietary Device -49"
Bottom of Disposal Field -60"

ELEVATION REFERENCE POINT

Location & Description: NAIL 29' ABOVE
GROUND IN 12" DIA. OAK
Reference Elevation is: 0.0"

DISPOSAL FIELD CROSS-SECTION

(SEE ATTACHED CROSS SECTION)

Scales:

Vertical: 1"= ft.
Horizontal: 1"= ft.

NOTES:

1. TANK MUST BE 8' MINIMUM FROM BUILDING.
2. BUILDING ON FOUNDATION MUST BE 20' MINIMUM FROM STONE AND BUILDING SLAB MUST BE 15' MINIMUM FROM STONE.
3. WELL MUST BE 100' MINIMUM FROM TANK AND STONE,
4. GRADE SURROUNDING AREA TO DIVERT SURFACE WATER AWAY FROM SYSTEM.

Will G. Leary
Site Evaluator Signature

319
SE #

11-19-03
Date

DISPOSAL BED CROSS SECTION



(A)

FILL MATERIAL SHALL BE 8"-12" THICK OVER STONE AND SHALL BE GRAVELLY COARSE SAND TO THE STANDARDS IN SEC. 804.0 IN THE SUBSURFACE RULES.

CROWN FINISH GRADE FROM CENTER AT 3 % SLOPE

2" COMPRESSED HAY (OR FILTER FABRIC) SEC. 805.3 RECOMMENDED OVER STONE.

REMOVE VEGETATION AND SCARIFY ORIGINAL SOIL UNDER ENTIRE FILL AREA.

BOTTOM OF STONE MUST BE LEVEL WITH MAXIMUM GRADE TOLERANCE OF 2" PER 100'.

SYSTEM MUST BE INSTALLED ACCORDING TO THE RULES AND PRACTICES SET FORTH IN THE SUBSURFACE WASTEWATER RULES, IN EFFECT AT THIS TIME.

ELEVATIONS:

ELEV. REF. PT. (ERP):

FINISHED GRADE:

TOP OF DISTRIBUTION PIPE:

BOTTOM OF STONE:

0"

-36"

-49"

-60"

OWNER: JENNIFER BROUGHTON

LOCATION: ELLSWORTH


WILLIAM A. LABELLE

319 S.E.#

DATE

11-19-03

SITE PLAN:
SCALE: 1"=60'

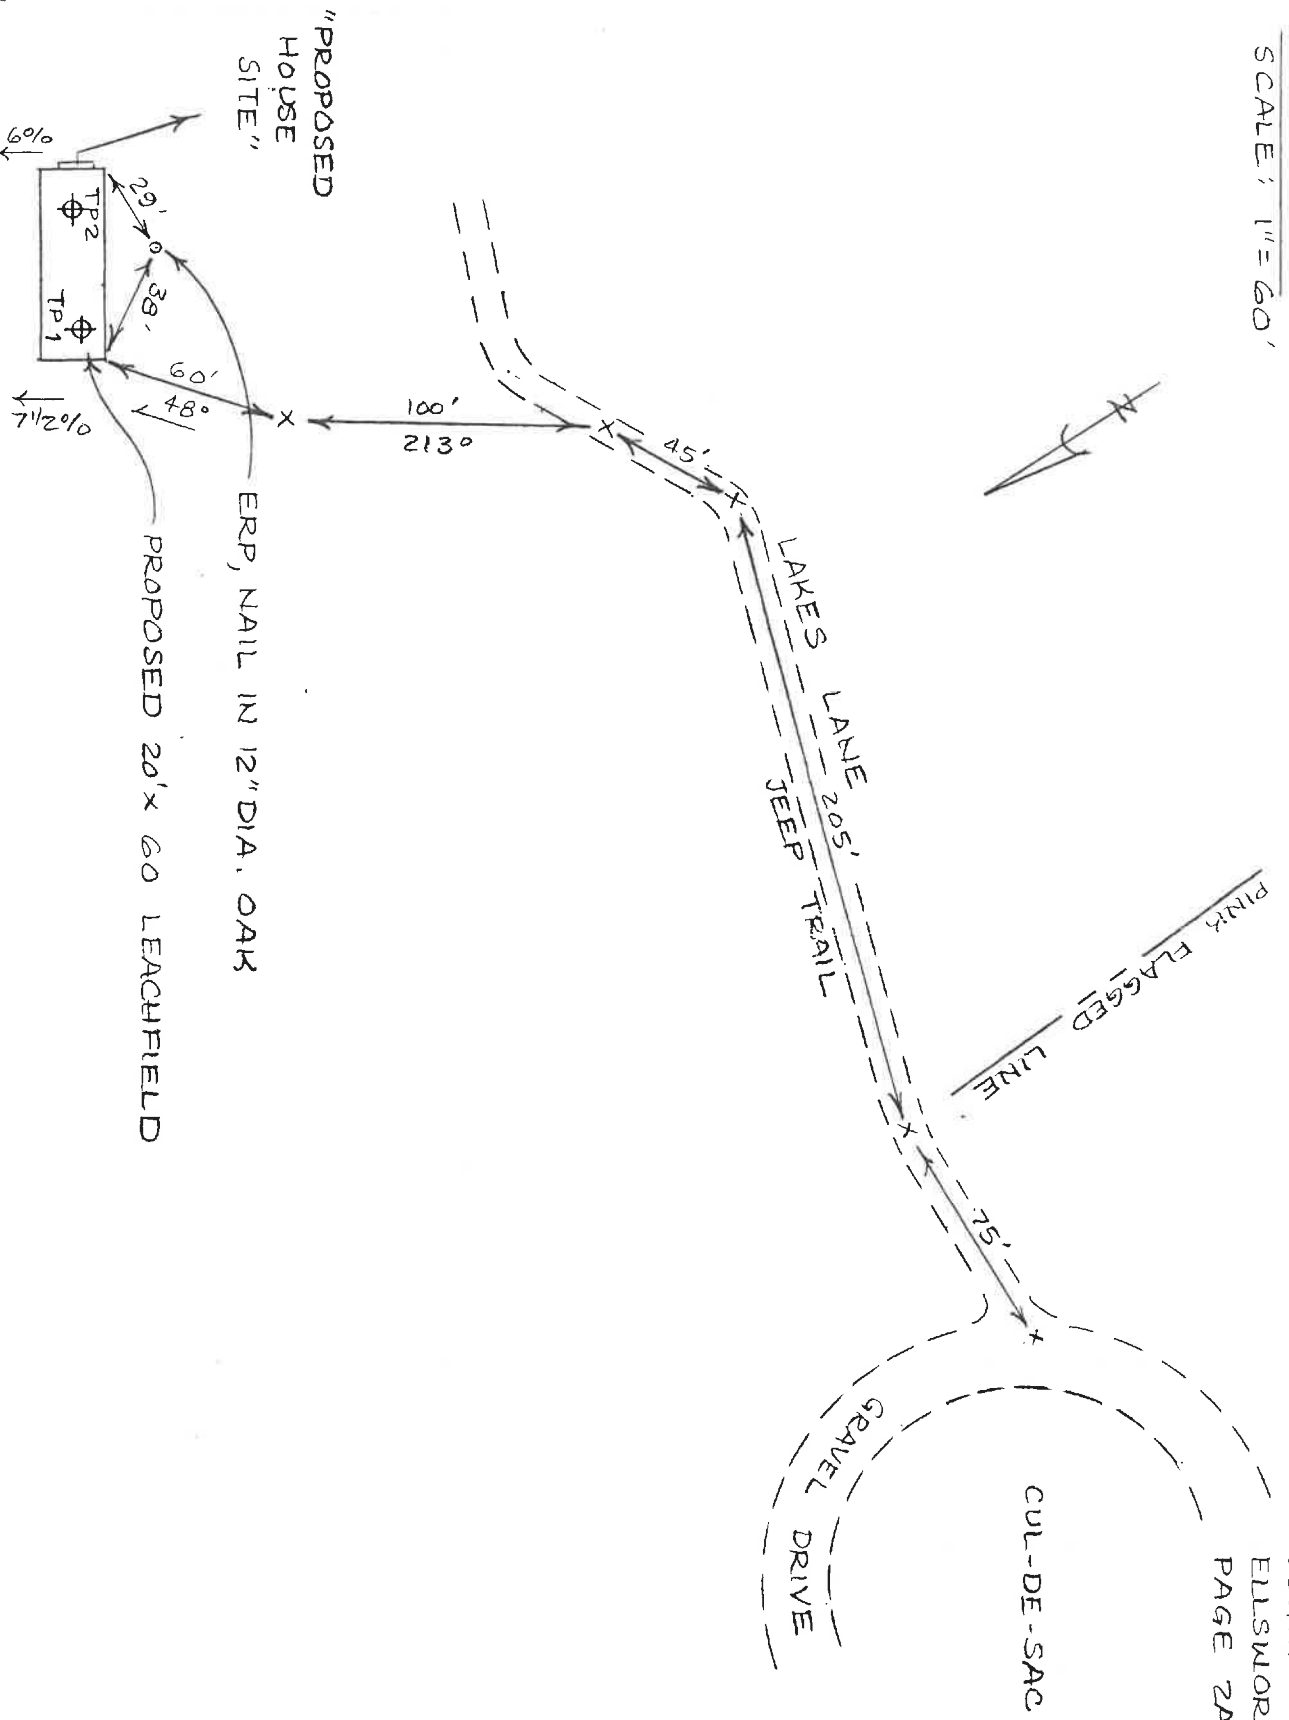

JENNIFER BROUGHTON
ELLSWORTH
PAGE 2A

Will G. G. G.
SITE EVALUATOR'S SIGNATURE

319
S.E.#

11-19-03
DATE